

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P1212699

Luminaire Tested: **LDSQA6A70935D010TE LARH20SP 6LSQA1H**

Issue Date: 3/3/2020



Test Information

Test Method: LM-41-14
Report Number: P1212699
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P26676)
Test Lab: INNOVATION CENTER-P2
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LDSQA6A70935D010TE LARH20SP 6LSQA1H
Description: PORTFOLIO 6" SQUARE ADJUSTABLE REFLECTOR, ANGLE-CUT TRIM,
SELF-FLANGED, 20° SPOT
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5034.3 lumens
Efficiency: N/A
Efficacy: 64.5 lumens/watt
Spacing Criteria (0/90/45): 0.4 / 0.4 / 0.48
Luminous Opening: Rectangular (W 0.5' x L: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 78.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P1212699

CATALOG NUMBER: LDSQA6A70935D010TE LARH20SP 6LSQA1H

Luminous Intensity Polar Plot

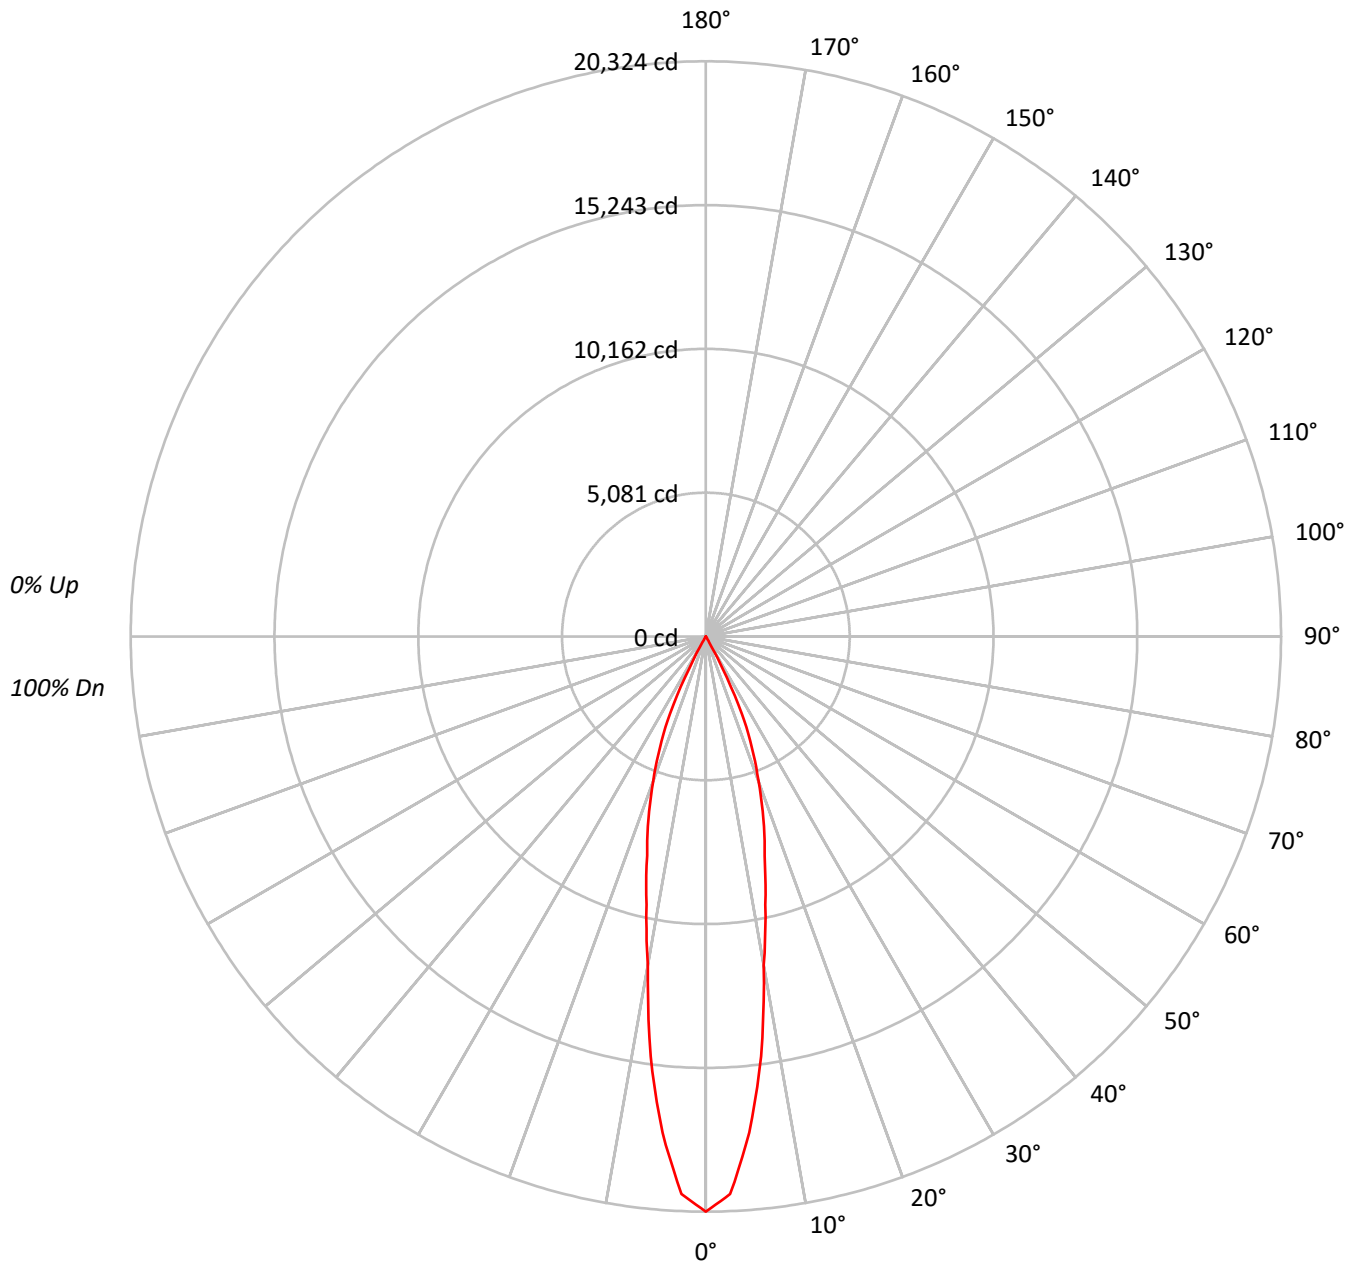

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



TEST NUMBER: P1212699

CATALOG NUMBER: LDSQA6A70935D010TE LARH20SP 6LSQA1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	115	113	111	109	113	111	109	107	107	105	104		103	102	101		100
2	111	107	104	102	109	106	103	101	103	100	98		100	98	96		97
3	107	103	99	96	106	101	98	95	99	96	94		97	94	92		94
4	104	98	94	91	102	97	94	91	95	92	90		94	91	89		92
5	101	95	90	87	99	94	90	87	92	89	86		91	88	86		89
6	98	91	87	84	96	91	87	84	89	86	83		88	85	83		87
7	95	88	84	81	94	87	83	81	86	83	80		85	82	80		84
8	92	85	81	78	91	85	81	78	84	80	78		83	80	77		82
9	89	82	78	75	88	82	78	75	81	78	75		80	77	75		80
10	87	80	76	73	86	80	76	73	79	75	73		78	75	73		78

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	875068
5°	760761
10°	515475
15°	357327
20°	249016
25°	143294
30°	11241
35°	925
40°	467
45°	317
50°	281
55°	233
60°	267
65°	316
70°	264
75°	166
80°	248
85°	0

Classified

Scaled Data Report

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



TEST NUMBER: P1212699

CATALOG NUMBER: LDSQA6A70935D010TE LARH20SP 6LSQA1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1498.0	29.8
10°-20°	2256.3	44.8
20°-30°	1243.0	24.7
30°-40°	25.7	0.5
40°-50°	4.2	0.1
50°-60°	3.1	0.1
60°-70°	2.7	0.1
70°-80°	1.2	0.0
80°-90°	0.1	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4997.3	99.3
0°-40°	5023.0	99.8
0°-60°	5030.3	99.9
0°-90°	5034.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5034.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	20324	
5°	17602	###
15°	8016	2256
25°	3016	1243
35°	18	26
45°	5	4
55°	3	3
65°	3	3
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P1212699

CATALOG NUMBER: LDSQA6A70935D010TE LARH20SP 6LSQA1H

CANDELA DISTRIBUTION (FULL):

0°	
0°	20324.1
2.5°	19716.1
5°	17602.0
7.5°	14961.4
10°	11790.4
12.5°	9709.3
15°	8016.4
17.5°	6758.2
20°	5434.8
22.5°	4250.9
25°	3016.3
27.5°	1287.3
30°	226.1
32.5°	28.9
35°	17.6
37.5°	11.3
40°	8.3
42.5°	6.2
45°	5.2
47.5°	4.2
50°	4.2
52.5°	4.2
55°	3.1
57.5°	3.1
60°	3.1
62.5°	3.1
65°	3.1
67.5°	2.1
70°	2.1
72.5°	1.0
75°	1.0
77.5°	1.0
80°	1.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Classified

Scaled Data Report

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)