

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P1212701

Luminaire Tested: **LDSQA6A70935D010TE LARH30NF 6LSQA1H**

Issue Date: 3/3/2020



Test Information

Test Method: LM-41-14
Report Number: P1212701
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P26623)
Test Lab: INNOVATION CENTER-P2
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LDSQA6A70935D010TE LARH30NF 6LSQA1H
Description: PORTFOLIO 6" SQUARE ADJUSTABLE REFLECTOR, ANGLE-CUT TRIM,
SELF-FLANGED, 30° NARROW FLOOD
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5692.8 lumens
Efficiency: N/A
Efficacy: 72.9 lumens/watt
Spacing Criteria (0/90/45): 0.57 / 0.57 / 0.55
Luminous Opening: Rectangular (W 0.5' x L: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 78.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P1212701

CATALOG NUMBER: LDSQA6A70935D010TE LARH30NF 6LSQA1H

Luminous Intensity Polar Plot

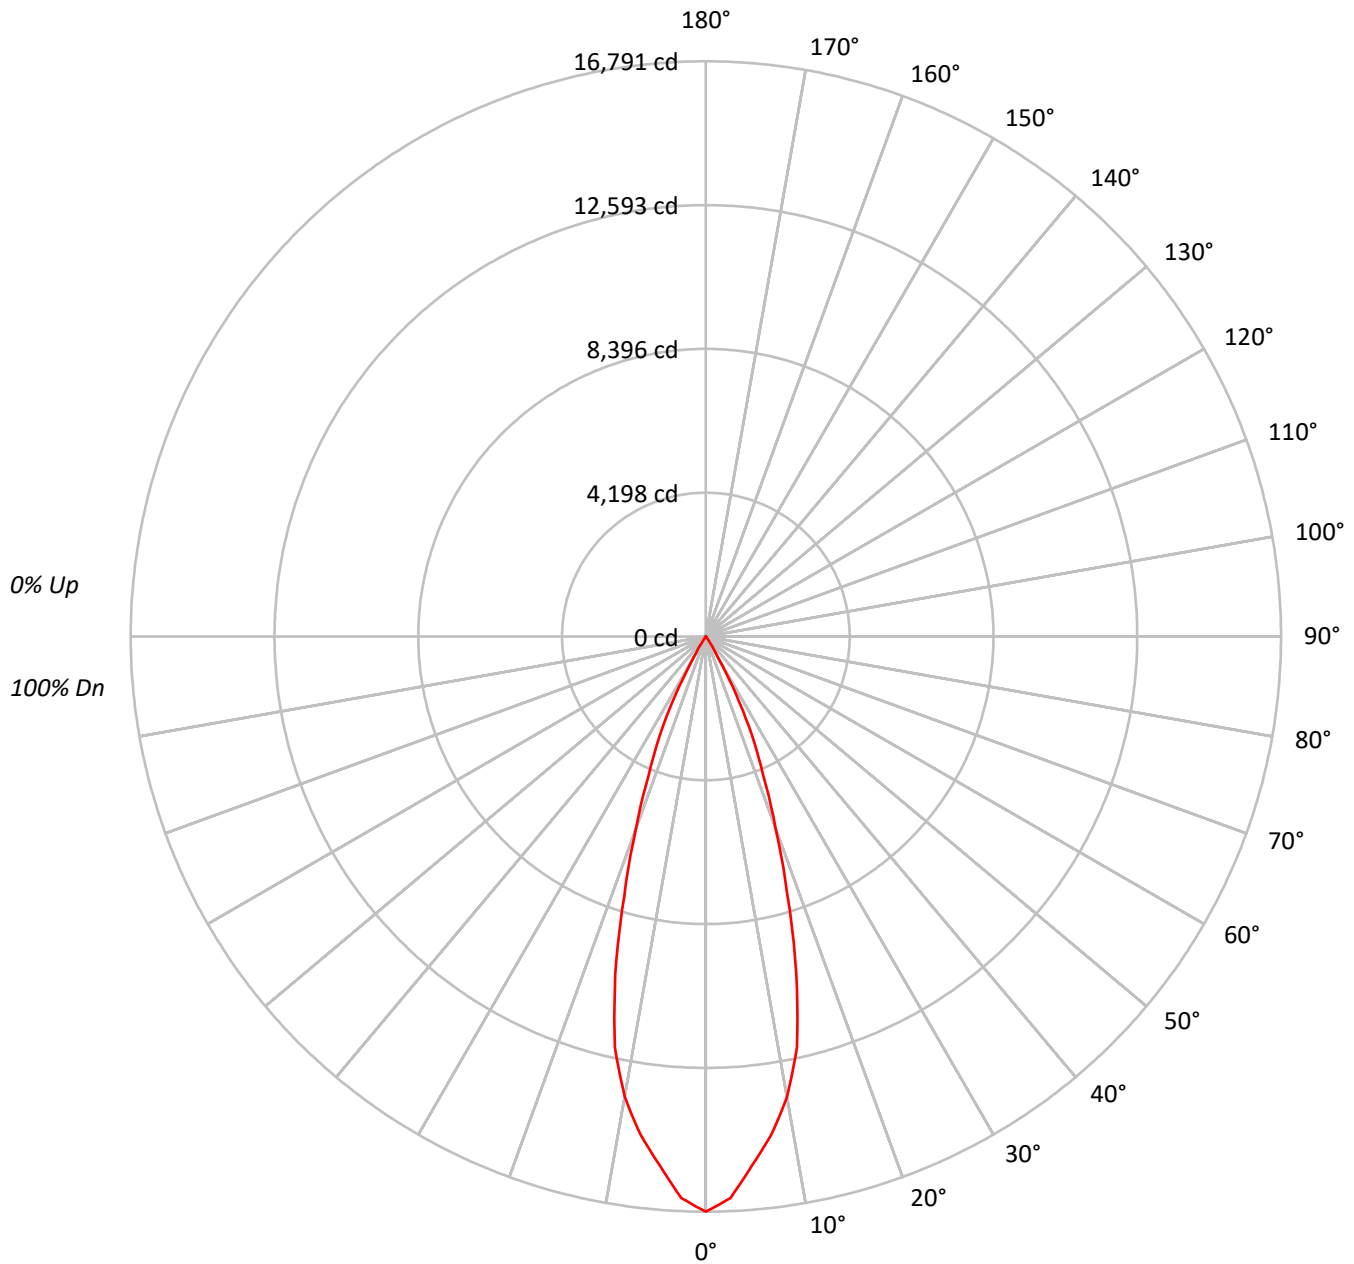



TEST NUMBER: P1212701

CATALOG NUMBER: LDSQA6A70935D010TE LARH30NF 6LSQA1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	115	113	111	109	112	110	109	107	106	105	104		103	102	101		99
2	111	107	104	101	109	105	103	100	102	100	98		99	98	96		97
3	107	102	98	95	105	101	97	95	98	95	93		96	94	92		94
4	103	98	94	90	102	97	93	90	95	91	89		93	90	88		91
5	100	94	89	86	99	93	89	86	91	88	85		90	87	84		88
6	97	90	86	82	95	89	85	82	88	84	82		87	84	81		86
7	94	87	82	79	93	86	82	79	85	81	79		84	81	78		83
8	91	84	79	76	90	83	79	76	82	78	76		81	78	75		80
9	88	81	76	73	87	80	76	73	80	76	73		79	75	73		78
10	85	78	74	71	84	78	74	71	77	73	71		76	73	70		76

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	722965
5°	669648
10°	596562
15°	455217
20°	272911
25°	150406
30°	37208
35°	2875
40°	809
45°	317
50°	141
55°	158
60°	181
65°	102
70°	126
75°	166
80°	248
85°	0



TEST NUMBER: P1212701

CATALOG NUMBER: LDSQA6A70935D010TE LARH30NF 6LSQA1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1425.4	25.0
10°-20°	2732.7	48.0
20°-30°	1411.2	24.8
30°-40°	114.3	2.0
40°-50°	4.7	0.1
50°-60°	1.9	0.0
60°-70°	1.4	0.0
70°-80°	1.1	0.0
80°-90°	0.1	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5569.3	97.8
0°-40°	5683.7	99.8
0°-60°	5690.2	100.0
0°-90°	5692.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5692.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	16791	
5°	15494	###
15°	10212	2733
25°	3166	1411
35°	55	114
45°	5	5
55°	2	2
65°	1	1
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P1212701

CATALOG NUMBER: LDSQA6A70935D010TE LARH30NF 6LSQA1H

CANDELA DISTRIBUTION (FULL):

0°	
0°	16791.4
2.5°	16408.5
5°	15493.9
7.5°	14660.8
10°	13645.1
12.5°	12279.3
15°	10212.5
17.5°	7917.8
20°	5956.3
22.5°	4366.7
25°	3166.0
27.5°	1906.7
30°	748.4
32.5°	318.0
35°	54.7
37.5°	26.8
40°	14.4
42.5°	8.3
45°	5.2
47.5°	3.1
50°	2.1
52.5°	2.1
55°	2.1
57.5°	2.1
60°	2.1
62.5°	2.1
65°	1.0
67.5°	1.0
70°	1.0
72.5°	1.0
75°	1.0
77.5°	1.0
80°	1.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Classified

Scaled Data Report

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)