

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P600692

Luminaire Tested: PRLX-215-90-30K-LL6-UNV-STD-X-X-WHHR-FL-X

Issue Date: 7/6/2022

Test Information

Test Method: LM-79-2019
Report Number: P600692
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2203-582-13)
Test Lab: INNOVATION CENTER
Issue Date: 7/6/2022
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PentaLux
Catalog Number: PRLX-215-90-30K-LL6-UNV-STD-X-X-WHHR-FL-X
Description: PentaLux 200 SERIES 3D PRINTED LUMINAIRE
Light Source: 3000K CCT, 90 CRI LEDS
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3755.1 lumens
Efficiency: N/A
Efficacy: 95.5 lumens/watt
Spacing Criteria (0/90/45): 0.9 / 0.9 / 0.85
Luminous Opening: Circular (Dia: 1' x H: 0')
CIE Type: Direct

Input Watts (W): 39.3
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P600692
CATALOG NUMBER: PRLX-215-90-30K-LL6-UNV-STD-X-X-WHHR-FL-X

Luminous Intensity Polar Plot

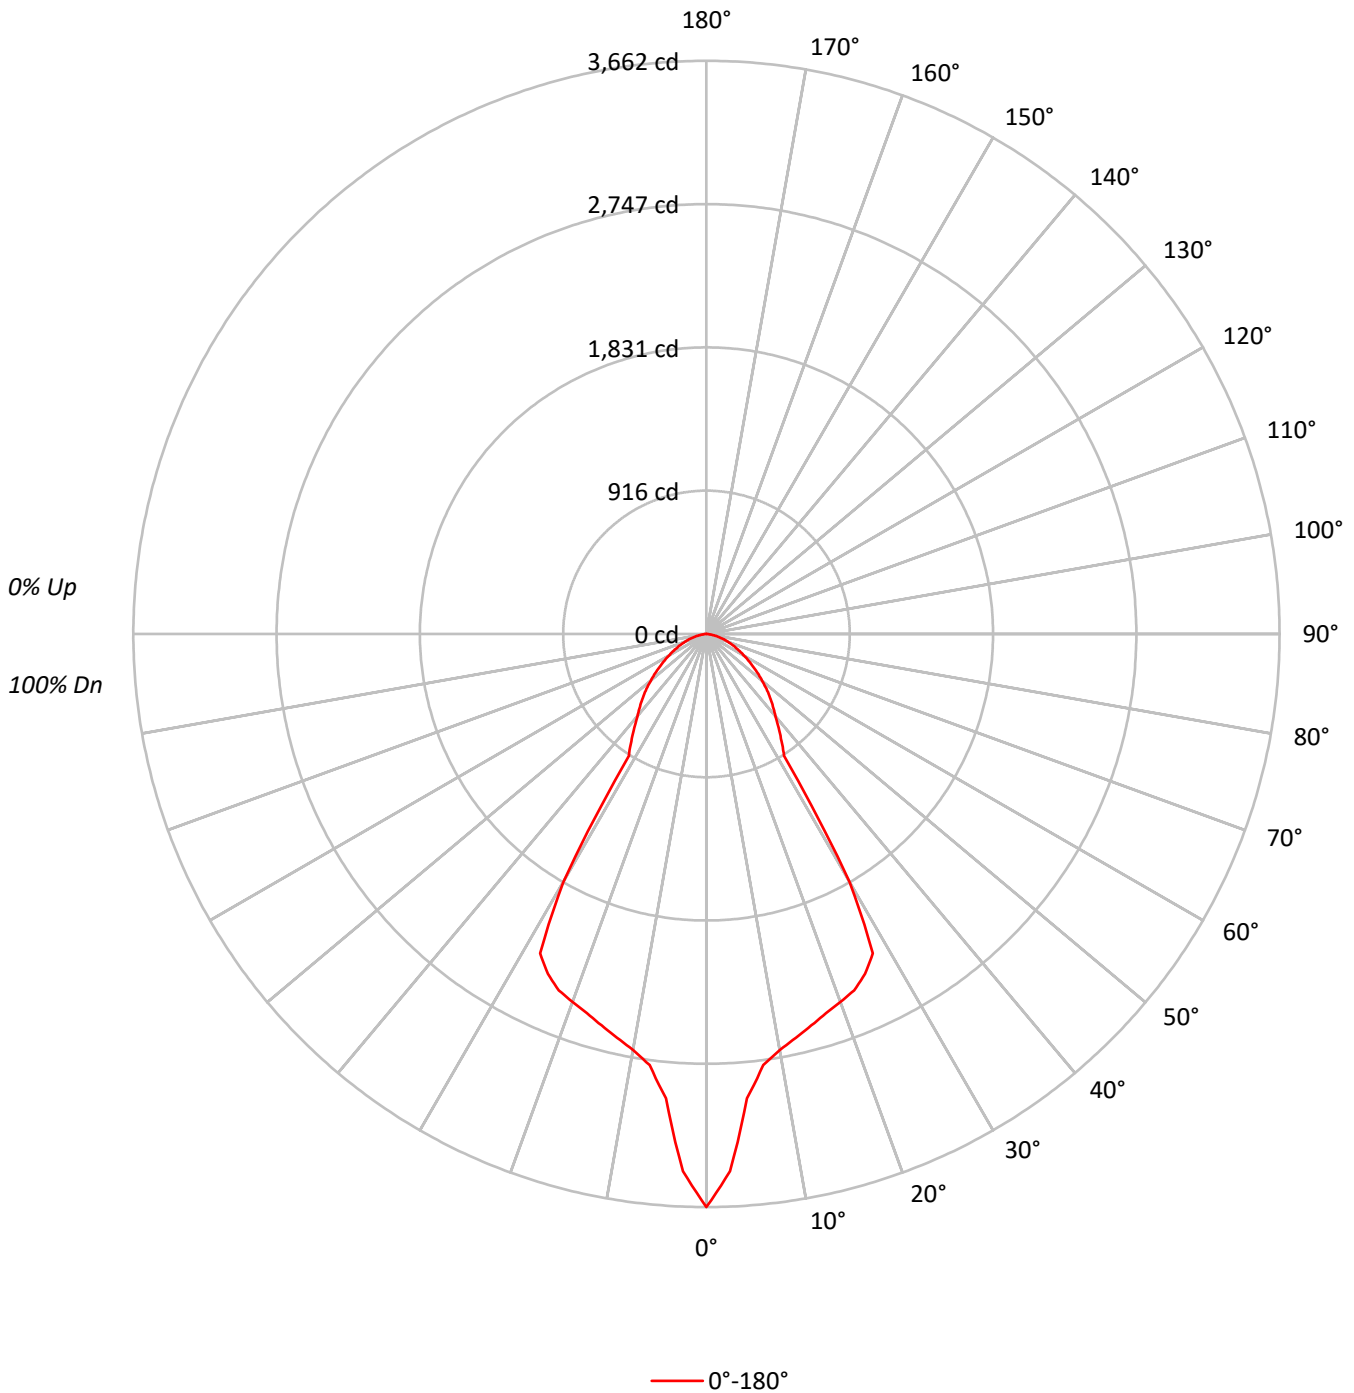



TEST NUMBER: P600692

CATALOG NUMBER: PRLX-215-90-30K-LL6-UNV-STD-X-X-WHHR-FL-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|--|-----|-----|-----|--|-----|-----|-----|-----|
| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | | | |
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | 0 | | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | | 50 | 30 | 10 | | 50 | 30 | 10 | 0 |
| RCR | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | | 106 | 106 | 106 | | 102 | 102 | 102 | 100 |
| 1 | 112 | 108 | 105 | 102 | 109 | 106 | 103 | 100 | 102 | 99 | 97 | | 98 | 96 | 94 | | 95 | 93 | 92 | 90 |
| 2 | 104 | 98 | 93 | 89 | 102 | 96 | 92 | 87 | 93 | 89 | 86 | | 90 | 87 | 84 | | 87 | 84 | 82 | 80 |
| 3 | 97 | 89 | 83 | 78 | 95 | 88 | 82 | 77 | 85 | 80 | 76 | | 82 | 78 | 75 | | 80 | 77 | 74 | 72 |
| 4 | 91 | 82 | 75 | 70 | 89 | 81 | 74 | 69 | 78 | 73 | 68 | | 76 | 71 | 67 | | 74 | 70 | 67 | 65 |
| 5 | 85 | 75 | 68 | 63 | 84 | 74 | 67 | 62 | 72 | 66 | 62 | | 70 | 65 | 61 | | 69 | 64 | 61 | 59 |
| 6 | 80 | 70 | 62 | 57 | 79 | 69 | 62 | 57 | 67 | 61 | 56 | | 66 | 60 | 56 | | 64 | 59 | 56 | 54 |
| 7 | 76 | 65 | 57 | 52 | 74 | 64 | 57 | 52 | 62 | 56 | 52 | | 61 | 56 | 52 | | 60 | 55 | 51 | 50 |
| 8 | 71 | 60 | 53 | 48 | 70 | 60 | 53 | 48 | 58 | 52 | 48 | | 57 | 52 | 48 | | 56 | 51 | 47 | 46 |
| 9 | 68 | 56 | 49 | 45 | 66 | 56 | 49 | 45 | 55 | 49 | 45 | | 54 | 48 | 44 | | 53 | 48 | 44 | 43 |
| 10 | 64 | 53 | 46 | 42 | 63 | 52 | 46 | 42 | 51 | 46 | 42 | | 51 | 45 | 41 | | 50 | 45 | 41 | 40 |

AVERAGE LUMINANCE (cd/sqm):

| | |
|-----|-------|
| | 0° |
| 0° | 50185 |
| 5° | 40967 |
| 10° | 37561 |
| 15° | 36743 |
| 20° | 36488 |
| 25° | 36247 |
| 30° | 28987 |
| 35° | 13995 |
| 40° | 12264 |
| 45° | 11137 |
| 50° | 9887 |
| 55° | 8688 |
| 60° | 7601 |
| 65° | 6645 |
| 70° | 5802 |
| 75° | 4893 |
| 80° | 3402 |
| 85° | 1211 |

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 11137 cd/sqm



TEST NUMBER: P600692

CATALOG NUMBER: PRLX-215-90-30K-LL6-UNV-STD-X-X-WHHR-FL-X

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 278.8 | 7.4 |
| 10°-20° | 732.2 | 19.5 |
| 20°-30° | 1072.4 | 28.6 |
| 30°-40° | 582.9 | 15.5 |
| 40°-50° | 442.4 | 11.8 |
| 50°-60° | 327.2 | 8.7 |
| 60°-70° | 205.6 | 5.5 |
| 70°-80° | 98.2 | 2.6 |
| 80°-90° | 15.5 | 0.4 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 2083.4 | 55.5 |
| 0°-40° | 2666.3 | 71.0 |
| 0°-60° | 3435.8 | 91.5 |
| 0°-90° | 3755.1 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 3755.1 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 3662 | |
| 5° | 2978 | 279 |
| 15° | 2590 | 732 |
| 25° | 2397 | 1072 |
| 35° | 836 | 583 |
| 45° | 575 | 442 |
| 55° | 364 | 327 |
| 65° | 205 | 206 |
| 75° | 92 | 98 |
| 85° | 8 | 15 |
| 90° | 0 | |



TEST NUMBER: P600692

CATALOG NUMBER: PRLX-215-90-30K-LL6-UNV-STD-X-X-WHHR-FL-X

CANDELA DISTRIBUTION (FULL):

| | 0° |
|-------|--------|
| 0° | 3661.8 |
| 2.5° | 3435.3 |
| 5° | 2977.8 |
| 7.5° | 2777.5 |
| 10° | 2699.0 |
| 12.5° | 2642.0 |
| 15° | 2589.6 |
| 17.5° | 2540.3 |
| 20° | 2501.8 |
| 22.5° | 2464.8 |
| 25° | 2397.0 |
| 27.5° | 2301.5 |
| 30° | 1831.7 |
| 32.5° | 924.3 |
| 35° | 836.5 |
| 37.5° | 756.4 |
| 40° | 685.5 |
| 42.5° | 628.5 |
| 45° | 574.6 |
| 47.5° | 519.1 |
| 50° | 463.7 |
| 52.5° | 412.9 |
| 55° | 363.6 |
| 57.5° | 318.9 |
| 60° | 277.3 |
| 62.5° | 240.3 |
| 65° | 204.9 |
| 67.5° | 175.6 |
| 70° | 144.8 |
| 72.5° | 118.6 |
| 75° | 92.4 |
| 77.5° | 67.8 |
| 80° | 43.1 |
| 82.5° | 24.6 |
| 85° | 7.7 |
| 87.5° | 3.1 |
| 90° | 0.0 |

(END OF REPORT)