

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P979282

Luminaire Tested: PRLX-240-927-23L-F-U-S-BLAK-X

Issue Date: 4/3/2025

Test Information

Test Method: LM-79-2019
Report Number: P979282
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2502-353-7)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 4/3/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-240-927-23L-F-U-S-BLAK-X
Description: 3D PRINTED LUMINAIRE, INTEGRAL LED LIGHT ENGINE, BLACK 240 SHADE WITH FROSTED LENS
Light Source: 2700K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1543.2 lumens
Efficiency: N/A
Efficacy: 102.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.2 / 1.33
Luminous Opening: Circular (Dia: 1.17' x H: 0')
CIE Type: Direct

Input Watts (W): 15
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P979282

CATALOG NUMBER: PRLX-240-927-23L-F-U-S-BLAK-X

Luminous Intensity Polar Plot

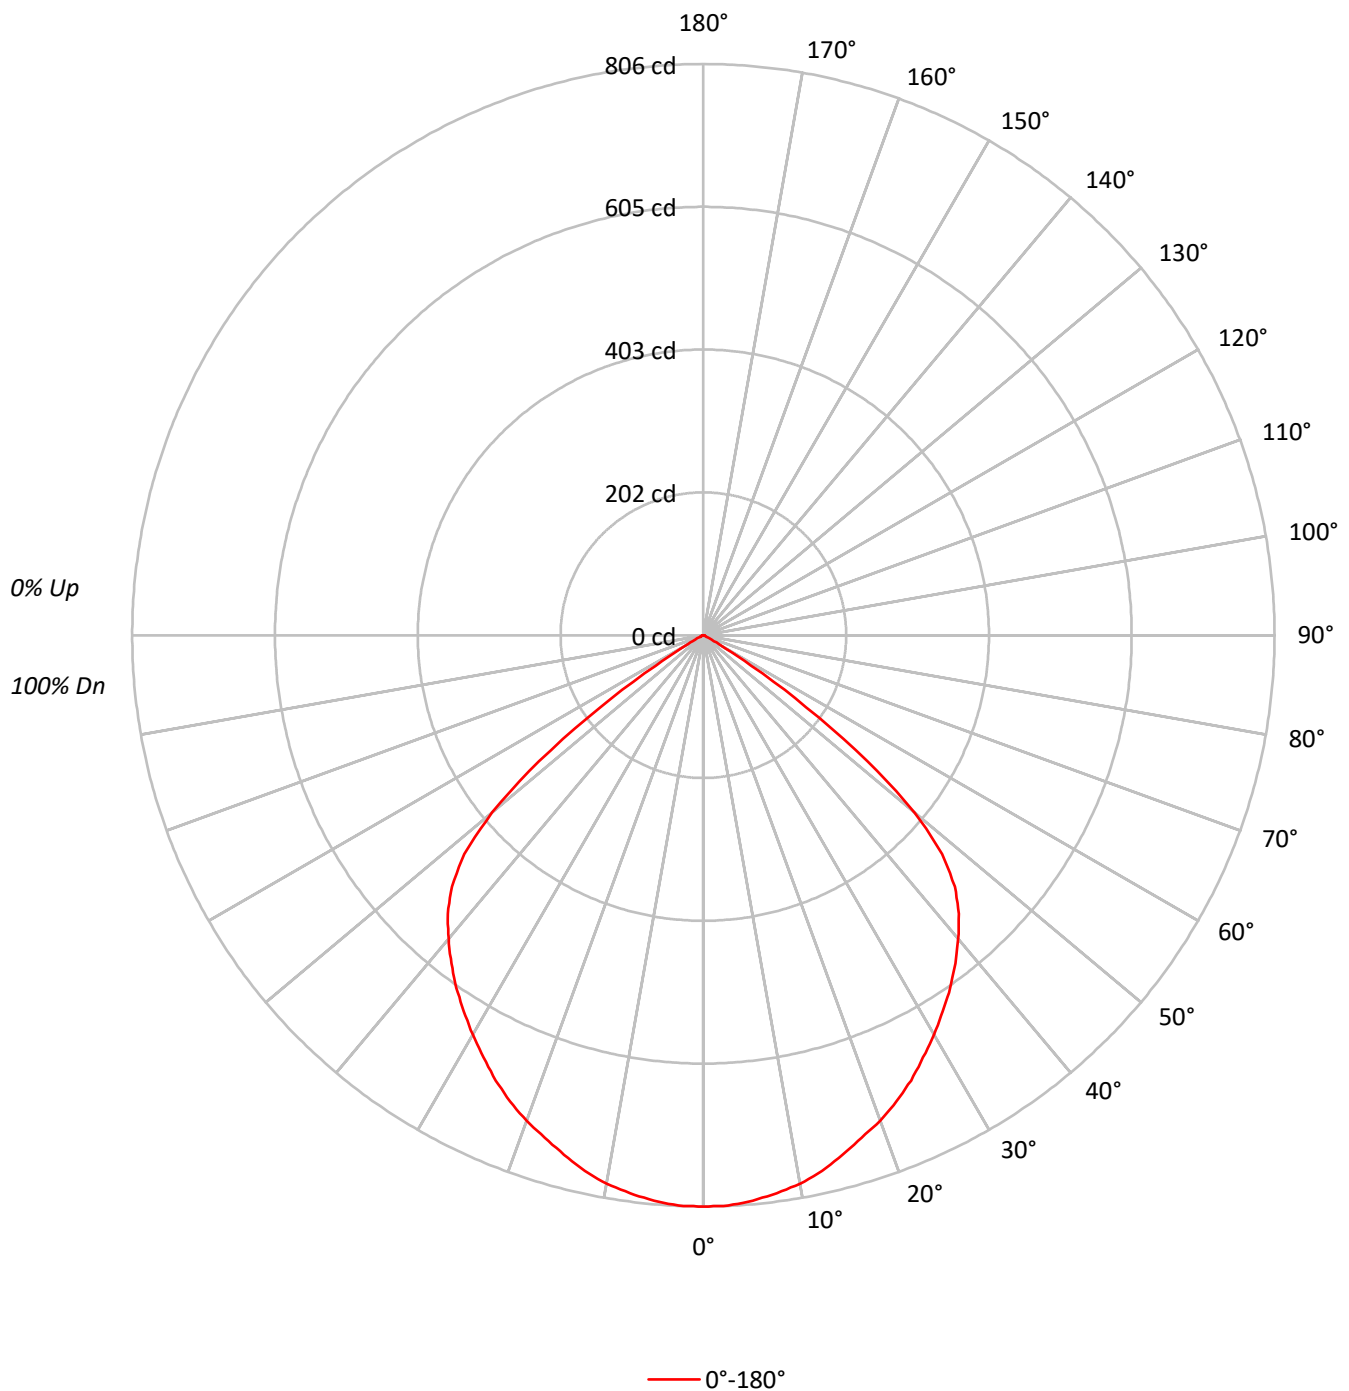

TEST NUMBER: P979282

CATALOG NUMBER: PRLX-240-927-23L-F-U-S-BLAK-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	112	109	106	103	110	106	104	101	102	100	98		99	97	95		95
2	105	98	93	89	102	97	92	88	93	89	86		90	87	84		87
3	97	89	83	78	95	88	82	77	85	80	76		82	78	75		80
4	90	81	74	68	88	80	73	68	77	72	67		75	70	66		73
5	84	73	66	61	82	72	65	60	70	64	60		69	63	59		67
6	78	67	59	54	77	66	59	54	64	58	53		63	57	53		61
7	73	61	54	48	71	61	53	48	59	53	48		58	52	48		57
8	68	56	49	44	67	56	49	44	54	48	43		53	47	43		52
9	64	52	45	40	63	51	44	40	50	44	39		49	43	39		48
10	60	48	41	36	59	48	41	36	47	40	36		46	40	36		45

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	8119
5°	8095
10°	8036
15°	7911
20°	7814
25°	7703
30°	7565
35°	7466
40°	7353
45°	7147
50°	6092
55°	3111
60°	503
65°	64
70°	59
75°	78
80°	81
85°	81

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 7147 cd/sqm

TEST NUMBER: P979282

CATALOG NUMBER: PRLX-240-927-23L-F-U-S-BLAK-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	76.0	4.9
10°-20°	214.2	13.9
20°-30°	319.1	20.7
30°-40°	379.8	24.6
40°-50°	379.1	24.6
50°-60°	166.3	10.8
60°-70°	5.7	0.4
70°-80°	2.0	0.1
80°-90°	1.0	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	609.3	39.5
0°-40°	989.1	64.1
0°-60°	1534.5	99.4
0°-90°	1543.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1543.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	806	
5°	801	76
15°	759	214
25°	693	319
35°	607	380
45°	502	379
55°	177	166
65°	3	6
75°	2	2
85°	1	1
90°	0	

TEST NUMBER: P979282

CATALOG NUMBER: PRLX-240-927-23L-F-U-S-BLAK-X

CANDELA DISTRIBUTION (FULL):

0°	
0°	806.3
2.5°	805.6
5°	800.9
7.5°	794.1
10°	786.0
12.5°	774.5
15°	758.9
17.5°	743.4
20°	729.2
22.5°	712.3
25°	693.3
27.5°	671.7
30°	650.7
32.5°	629.1
35°	607.4
37.5°	583.8
40°	559.4
42.5°	533.7
45°	501.9
47.5°	457.3
50°	388.9
52.5°	292.2
55°	177.2
57.5°	79.8
60°	25.0
62.5°	5.4
65°	2.7
67.5°	2.0
70°	2.0
72.5°	2.0
75°	2.0
77.5°	2.0
80°	1.4
82.5°	1.4
85°	0.7
87.5°	0.7
90°	0.0

TEST NUMBER: P979282

CATALOG NUMBER: PRLX-240-927-23L-F-U-S-BLAK-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.58	10.92	9.94	11.24	11.55	9.58	10.92	9.94	11.24	11.55
	3H	9.46	10.63	9.83	10.96	11.33	9.46	10.63	9.83	10.96	11.33
	4H	9.39	10.48	9.79	10.83	11.22	9.39	10.48	9.79	10.83	11.22
	6H	9.32	10.32	9.73	10.69	11.08	9.32	10.32	9.73	10.69	11.08
	8H	9.28	10.23	9.71	10.62	11.02	9.28	10.23	9.71	10.62	11.02
	12H	9.24	10.15	9.67	10.53	10.96	9.24	10.15	9.67	10.53	10.96
4H	2H	9.38	10.47	9.78	10.82	11.21	9.38	10.47	9.78	10.82	11.21
	3H	9.26	10.14	9.67	10.54	10.94	9.26	10.14	9.67	10.54	10.94
	4H	9.18	9.96	9.62	10.38	10.82	9.18	9.96	9.62	10.38	10.82
	6H	9.11	9.78	9.58	10.23	10.69	9.11	9.78	9.58	10.23	10.69
	8H	9.06	9.69	9.53	10.13	10.61	9.06	9.69	9.53	10.13	10.61
	12H	9.02	9.57	9.51	10.05	10.53	9.02	9.57	9.51	10.05	10.53
8H	4H	9.04	9.67	9.51	10.12	10.59	9.04	9.67	9.51	10.12	10.59
	6H	8.95	9.47	9.46	9.97	10.45	8.95	9.47	9.46	9.97	10.45
	8H	8.90	9.37	9.42	9.88	10.37	8.90	9.37	9.42	9.88	10.37
	12H	8.85	9.28	9.37	9.77	10.34	8.85	9.28	9.37	9.77	10.34
12H	4H	9.00	9.55	9.48	10.03	10.51	9.00	9.55	9.48	10.03	10.51
	6H	8.89	9.35	9.41	9.87	10.36	8.89	9.35	9.41	9.87	10.36
	8H	8.85	9.27	9.36	9.77	10.34	8.85	9.27	9.36	9.77	10.34

END OF REPORT