

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2024 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P979260

Luminaire Tested: PRLX-240-927-LL1-C-U-S-BLAK-X

Issue Date: 4/3/2025

Test Information

Test Method: LM-79-2024
Report Number: P979260
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2502-353-6)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 4/3/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-240-927-LL1-C-U-S-BLAK-X
Description: 3D PRINTED LUMINAIRE, INTEGRAL LED LIGHT ENGINE, BLACK 240 SHADE WITH CLEAR LENS
Light Source: 2700K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 884.5 lumens
Efficiency: N/A
Efficacy: 117.9 lumens/watt
Spacing Criteria (0/90/45): 1.25 / 1.25 / 1.39
Luminous Opening: Circular (Dia: 1.17' x H: 0')
CIE Type: Direct


Input Watts (W): 7.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P979260

CATALOG NUMBER: PRLX-240-927-LL1-C-U-S-BLAK-X

Luminous Intensity Polar Plot

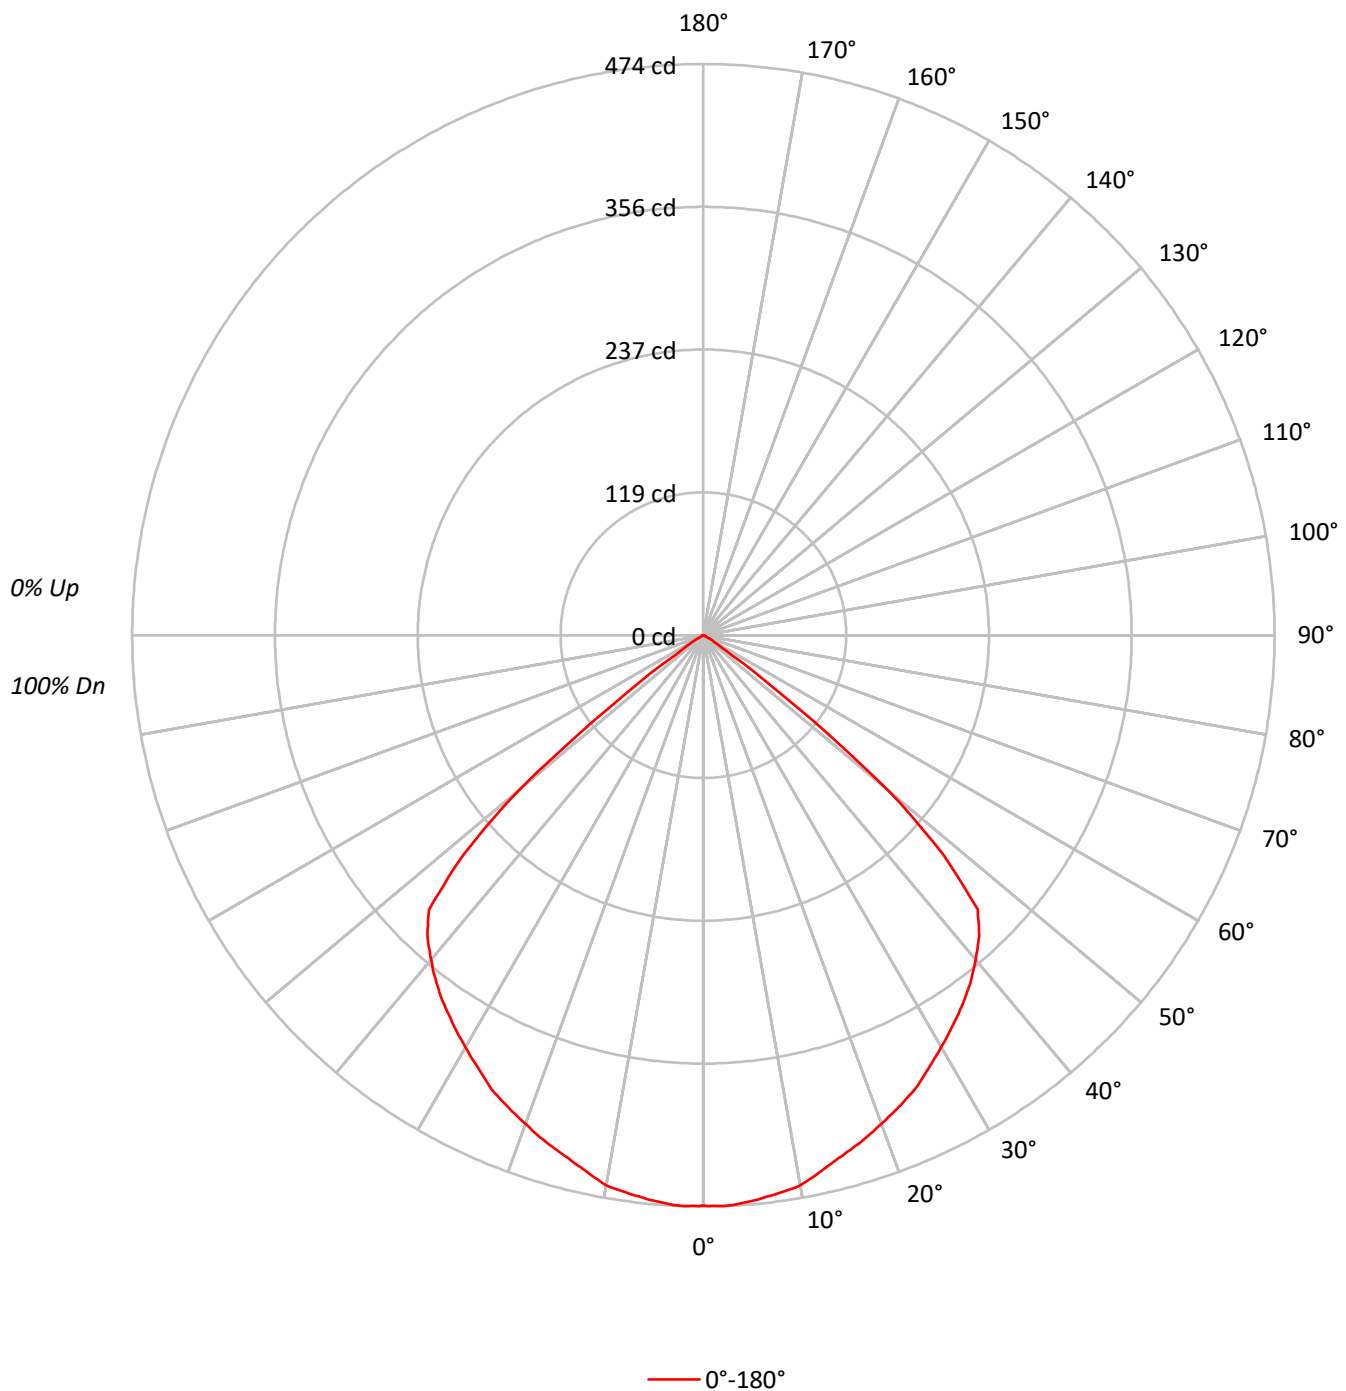

TEST NUMBER: P979260

CATALOG NUMBER: PRLX-240-927-LL1-C-U-S-BLAK-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	112	109	106	103	110	107	104	102	103	100	99		99	97	96		95
2	105	99	94	90	103	97	93	89	94	90	87		91	88	85		88
3	98	90	84	79	96	89	83	78	86	81	77		83	79	76		81
4	91	82	75	70	89	81	74	69	78	73	69		76	72	68		74
5	85	75	68	62	83	74	67	62	72	66	61		70	65	61		68
6	79	68	61	56	78	67	60	55	66	60	55		64	59	55		63
7	74	63	55	50	73	62	55	50	61	54	50		59	54	49		58
8	69	58	50	45	68	57	50	45	56	49	45		55	49	45		54
9	65	53	46	41	64	53	46	41	52	45	41		51	45	41		50
10	61	49	42	38	60	49	42	38	48	42	37		47	41	37		46

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	4768
5°	4762
10°	4741
15°	4656
20°	4625
25°	4618
30°	4591
35°	4607
40°	4620
45°	4584
50°	3138
55°	490
60°	121
65°	26
70°	32
75°	43
80°	64
85°	46

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4584 cd/sqm

TEST NUMBER: P979260

CATALOG NUMBER: PRLX-240-927-LL1-C-U-S-BLAK-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	44.7	5.1
10°-20°	126.3	14.3
20°-30°	191.3	21.6
30°-40°	234.5	26.5
40°-50°	232.2	26.3
50°-60°	51.8	5.9
60°-70°	1.9	0.2
70°-80°	1.2	0.1
80°-90°	0.6	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	362.4	41.0
0°-40°	596.9	67.5
0°-60°	880.8	99.6
0°-90°	884.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	884.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	474	
5°	471	45
15°	447	126
25°	416	191
35°	375	235
45°	322	232
55°	28	52
65°	1	2
75°	1	1
85°	0	1
90°	0	

TEST NUMBER: P979260

CATALOG NUMBER: PRLX-240-927-LL1-C-U-S-BLAK-X

CANDELA DISTRIBUTION (FULL):

0°	
0°	473.5
2.5°	473.9
5°	471.1
7.5°	467.6
10°	463.7
12.5°	454.9
15°	446.7
17.5°	439.7
20°	431.6
22.5°	423.8
25°	415.7
27.5°	404.8
30°	394.9
32.5°	384.7
35°	374.8
37.5°	363.9
40°	351.5
42.5°	338.9
45°	321.9
47.5°	270.4
50°	200.3
52.5°	93.4
55°	27.9
57.5°	13.4
60°	6.0
62.5°	2.1
65°	1.1
67.5°	1.1
70°	1.1
72.5°	1.1
75°	1.1
77.5°	1.1
80°	1.1
82.5°	0.7
85°	0.4
87.5°	0.4
90°	0.0

TEST NUMBER: P979260

CATALOG NUMBER: PRLX-240-927-LL1-C-U-S-BLAK-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	0.55	0.00	0.86	1.17	0.00	0.55	0.00	0.86	1.17
	3H	0.00	0.30	0.00	0.63	0.99	0.00	0.30	0.00	0.63	0.99
	4H	0.00	0.19	0.00	0.55	0.93	0.00	0.19	0.00	0.55	0.93
	6H	0.00	0.13	0.00	0.50	0.90	0.00	0.13	0.00	0.50	0.90
	8H	0.00	0.09	0.00	0.48	0.89	0.00	0.09	0.00	0.48	0.89
	12H	0.00	0.03	0.00	0.42	0.85	0.00	0.03	0.00	0.42	0.85
4H	2H	0.00	0.10	0.00	0.45	0.84	0.00	0.10	0.00	0.45	0.84
	3H	0.00	0.00	0.00	0.24	0.64	0.00	0.00	0.00	0.24	0.64
	4H	0.00	0.00	0.00	0.16	0.61	0.00	0.00	0.00	0.16	0.61
	6H	0.00	0.00	0.00	0.19	0.66	0.00	0.00	0.00	0.19	0.66
	8H	0.00	0.00	0.00	0.18	0.65	0.00	0.00	0.00	0.18	0.65
	12H	0.00	0.00	0.00	0.15	0.63	0.00	0.00	0.00	0.15	0.63
8H	4H	0.00	0.00	0.00	0.00	0.43	0.00	0.00	0.00	0.00	0.43
	6H	0.00	0.00	0.00	0.06	0.54	0.00	0.00	0.00	0.06	0.54
	8H	0.00	0.00	0.00	0.10	0.59	0.00	0.00	0.00	0.10	0.59
	12H	0.00	0.00	0.00	0.07	0.64	0.00	0.00	0.00	0.07	0.64
12H	4H	0.00	0.00	0.00	0.00	0.37	0.00	0.00	0.00	0.00	0.37
	6H	0.00	0.00	0.00	0.01	0.50	0.00	0.00	0.00	0.01	0.50
	8H	0.00	0.00	0.00	0.03	0.61	0.00	0.00	0.00	0.03	0.61

END OF REPORT