

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P979362

Luminaire Tested: PRLX-240-930-23L-F-U-S-BLAK-X

Issue Date: 4/3/2025

Test Information

Test Method: LM-79-2019
Report Number: P979362
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2502-353-7)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 4/3/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-240-930-23L-F-U-S-BLAK-X
Description: 3D PRINTED LUMINAIRE, INTEGRAL LED LIGHT ENGINE, BLACK 240 SHADE WITH FROSTED LENS
Light Source: 3000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1636.0 lumens
Efficiency: N/A
Efficacy: 109.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.2 / 1.33
Luminous Opening: Circular (Dia: 1.17' x H: 0')
CIE Type: Direct

Input Watts (W): 15
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P979362

CATALOG NUMBER: PRLX-240-930-23L-F-U-S-BLAK-X

Luminous Intensity Polar Plot

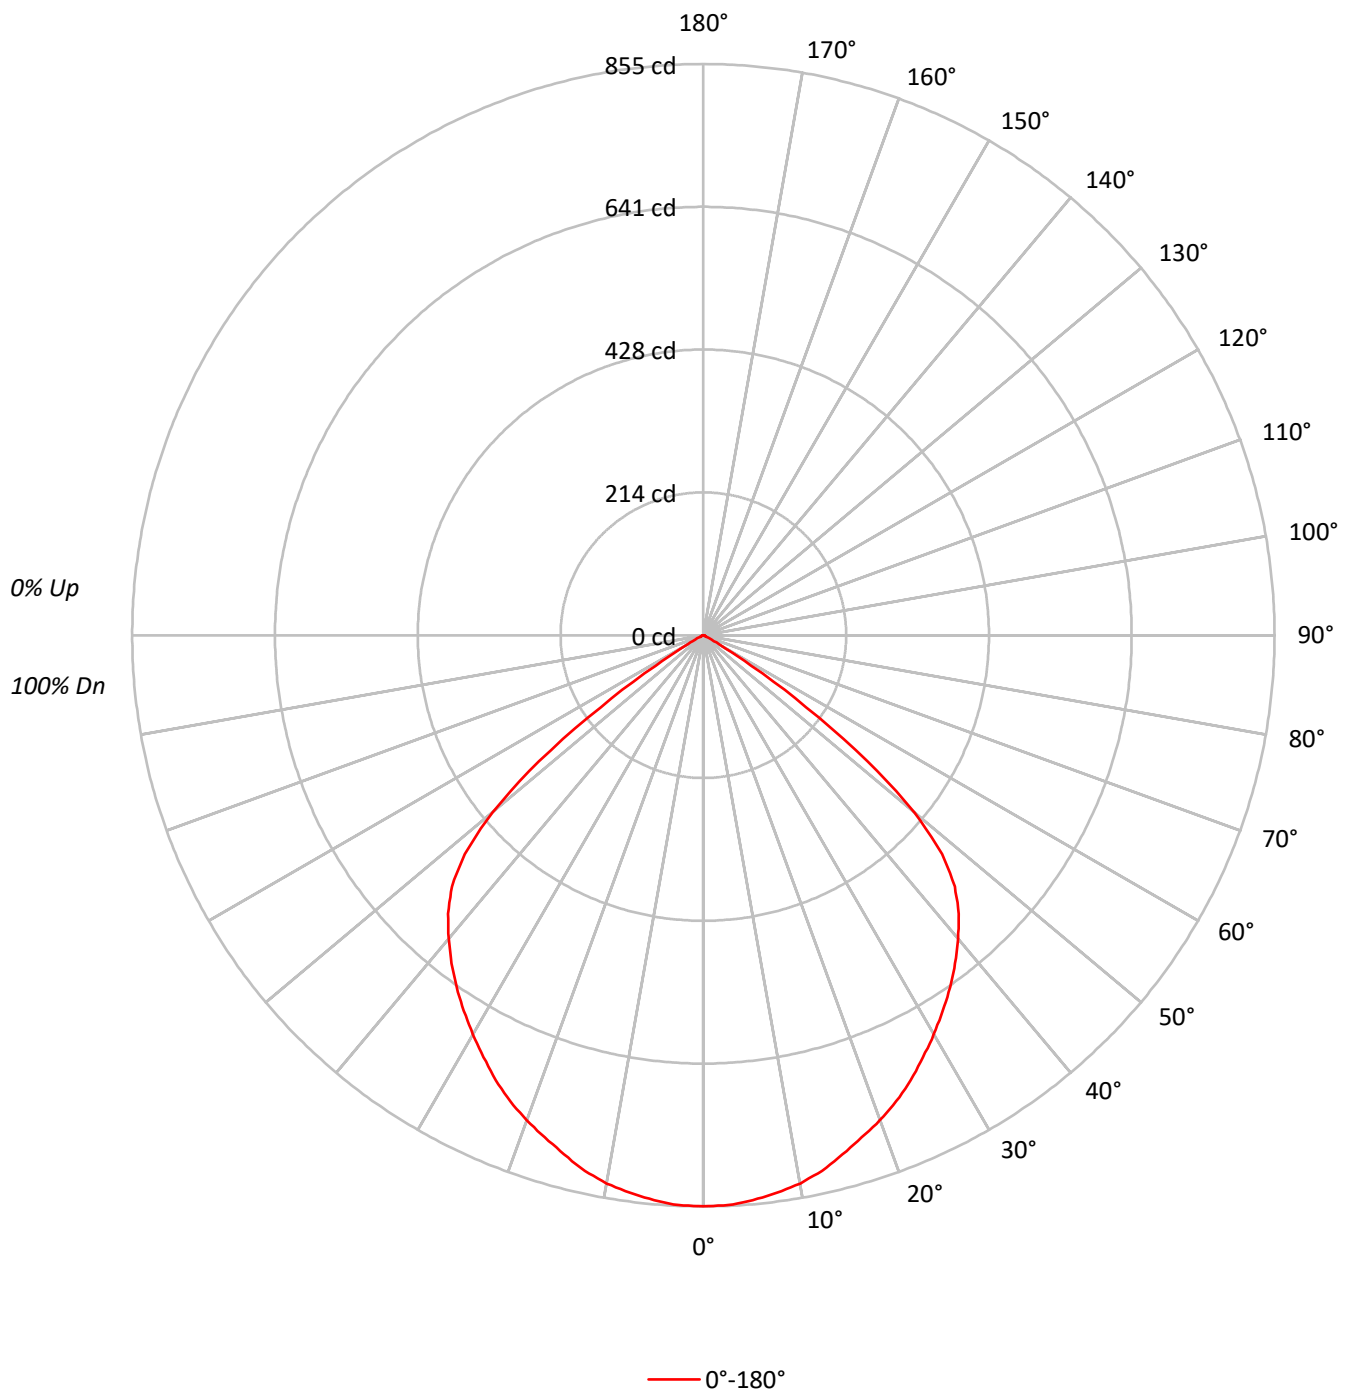



TEST NUMBER: P979362

CATALOG NUMBER: PRLX-240-930-23L-F-U-S-BLAK-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10			
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	112	109	106	103	110	106	104	101	102	100	98	99	97	95	95	94	92	90		
2	105	98	93	89	102	97	92	88	93	89	86	90	87	84	87	85	82	81		
3	97	89	83	78	95	88	82	77	85	80	76	82	78	75	80	76	73	72		
4	90	81	74	68	88	80	73	68	77	72	67	75	70	66	73	69	65	64		
5	84	73	66	61	82	72	65	60	70	64	60	69	63	59	67	62	59	57		
6	78	67	59	54	77	66	59	54	64	58	53	63	57	53	61	56	53	51		
7	73	61	54	48	71	61	53	48	59	53	48	58	52	48	57	51	47	46		
8	68	56	49	44	67	56	49	44	54	48	43	53	47	43	52	47	43	41		
9	64	52	45	40	63	51	44	40	50	44	39	49	43	39	48	43	39	37		
10	60	48	41	36	59	48	41	36	47	40	36	46	40	36	45	40	36	34		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	8607
5°	8581
10°	8520
15°	8387
20°	8283
25°	8166
30°	8020
35°	7915
40°	7794
45°	7577
50°	6459
55°	3299
60°	534
65°	69
70°	65
75°	86
80°	81
85°	81

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 7577 cd/sqm

TEST NUMBER: P979362

CATALOG NUMBER: PRLX-240-930-23L-F-U-S-BLAK-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	80.5	4.9
10°-20°	227.1	13.9
20°-30°	338.3	20.7
30°-40°	402.6	24.6
40°-50°	401.9	24.6
50°-60°	176.3	10.8
60°-70°	6.1	0.4
70°-80°	2.2	0.1
80°-90°	1.0	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	645.9	39.5
0°-40°	1048.5	64.1
0°-60°	1626.7	99.4
0°-90°	1636.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1636.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	855	
5°	849	81
15°	805	227
25°	735	338
35°	644	403
45°	532	402
55°	188	176
65°	3	6
75°	2	2
85°	1	1
90°	0	

TEST NUMBER: P979362

CATALOG NUMBER: PRLX-240-930-23L-F-U-S-BLAK-X

CANDELA DISTRIBUTION (FULL):

	0°
0°	854.8
2.5°	854.1
5°	849.0
7.5°	841.9
10°	833.3
12.5°	821.1
15°	804.6
17.5°	788.1
20°	773.0
22.5°	755.1
25°	735.0
27.5°	712.1
30°	689.8
32.5°	666.9
35°	643.9
37.5°	618.9
40°	593.0
42.5°	565.8
45°	532.1
47.5°	484.8
50°	412.3
52.5°	309.8
55°	187.9
57.5°	84.6
60°	26.5
62.5°	5.7
65°	2.9
67.5°	2.2
70°	2.2
72.5°	2.2
75°	2.2
77.5°	2.2
80°	1.4
82.5°	1.4
85°	0.7
87.5°	0.7
90°	0.0

TEST NUMBER: P979362

CATALOG NUMBER: PRLX-240-930-23L-F-U-S-BLAK-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.78	11.13	10.14	11.44	11.75	9.78	11.13	10.14	11.44	11.75
	3H	9.66	10.84	10.04	11.17	11.53	9.66	10.84	10.04	11.17	11.53
	4H	9.59	10.69	10.00	11.04	11.42	9.59	10.69	10.00	11.04	11.42
	6H	9.52	10.52	9.94	10.89	11.29	9.52	10.52	9.94	10.89	11.29
	8H	9.48	10.43	9.91	10.82	11.23	9.48	10.43	9.91	10.82	11.23
	12H	9.45	10.35	9.88	10.73	11.16	9.45	10.35	9.88	10.73	11.16
4H	2H	9.58	10.68	9.99	11.03	11.41	9.58	10.68	9.99	11.03	11.41
	3H	9.47	10.34	9.88	10.74	11.15	9.47	10.34	9.88	10.74	11.15
	4H	9.39	10.16	9.82	10.58	11.03	9.39	10.16	9.82	10.58	11.03
	6H	9.32	9.98	9.78	10.43	10.90	9.32	9.98	9.78	10.43	10.90
	8H	9.27	9.89	9.74	10.34	10.81	9.27	9.89	9.74	10.34	10.81
	12H	9.22	9.77	9.71	10.26	10.73	9.22	9.77	9.71	10.26	10.73
8H	4H	9.25	9.87	9.72	10.32	10.79	9.25	9.87	9.72	10.32	10.79
	6H	9.16	9.67	9.66	10.17	10.65	9.16	9.67	9.66	10.17	10.65
	8H	9.10	9.57	9.62	10.08	10.58	9.10	9.57	9.62	10.08	10.58
	12H	9.05	9.48	9.57	9.97	10.54	9.05	9.48	9.57	9.97	10.54
12H	4H	9.20	9.75	9.69	10.24	10.71	9.20	9.75	9.69	10.24	10.71
	6H	9.09	9.56	9.61	10.07	10.57	9.09	9.56	9.61	10.07	10.57
	8H	9.05	9.47	9.56	9.97	10.54	9.05	9.47	9.56	9.97	10.54

END OF REPORT