

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P979410

Luminaire Tested: PRLX-240-930-74L-C-U-S-BLAK-X

Issue Date: 4/3/2025

Test Information

Test Method: LM-79-2019
Report Number: P979410
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2502-353-6)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 4/3/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-240-930-74L-C-U-S-BLAK-X
Description: 3D PRINTED LUMINAIRE, INTEGRAL LED LIGHT ENGINE, BLACK 240 SHADE WITH CLEAR LENS
Light Source: 3000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5732.7 lumens
Efficiency: N/A
Efficacy: 93.2 lumens/watt
Spacing Criteria (0/90/45): 1.25 / 1.25 / 1.39
Luminous Opening: Circular (Dia: 1.17' x H: 0')
CIE Type: Direct

Input Watts (W): 61.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P979410

CATALOG NUMBER: PRLX-240-930-74L-C-U-S-BLAK-X

Luminous Intensity Polar Plot

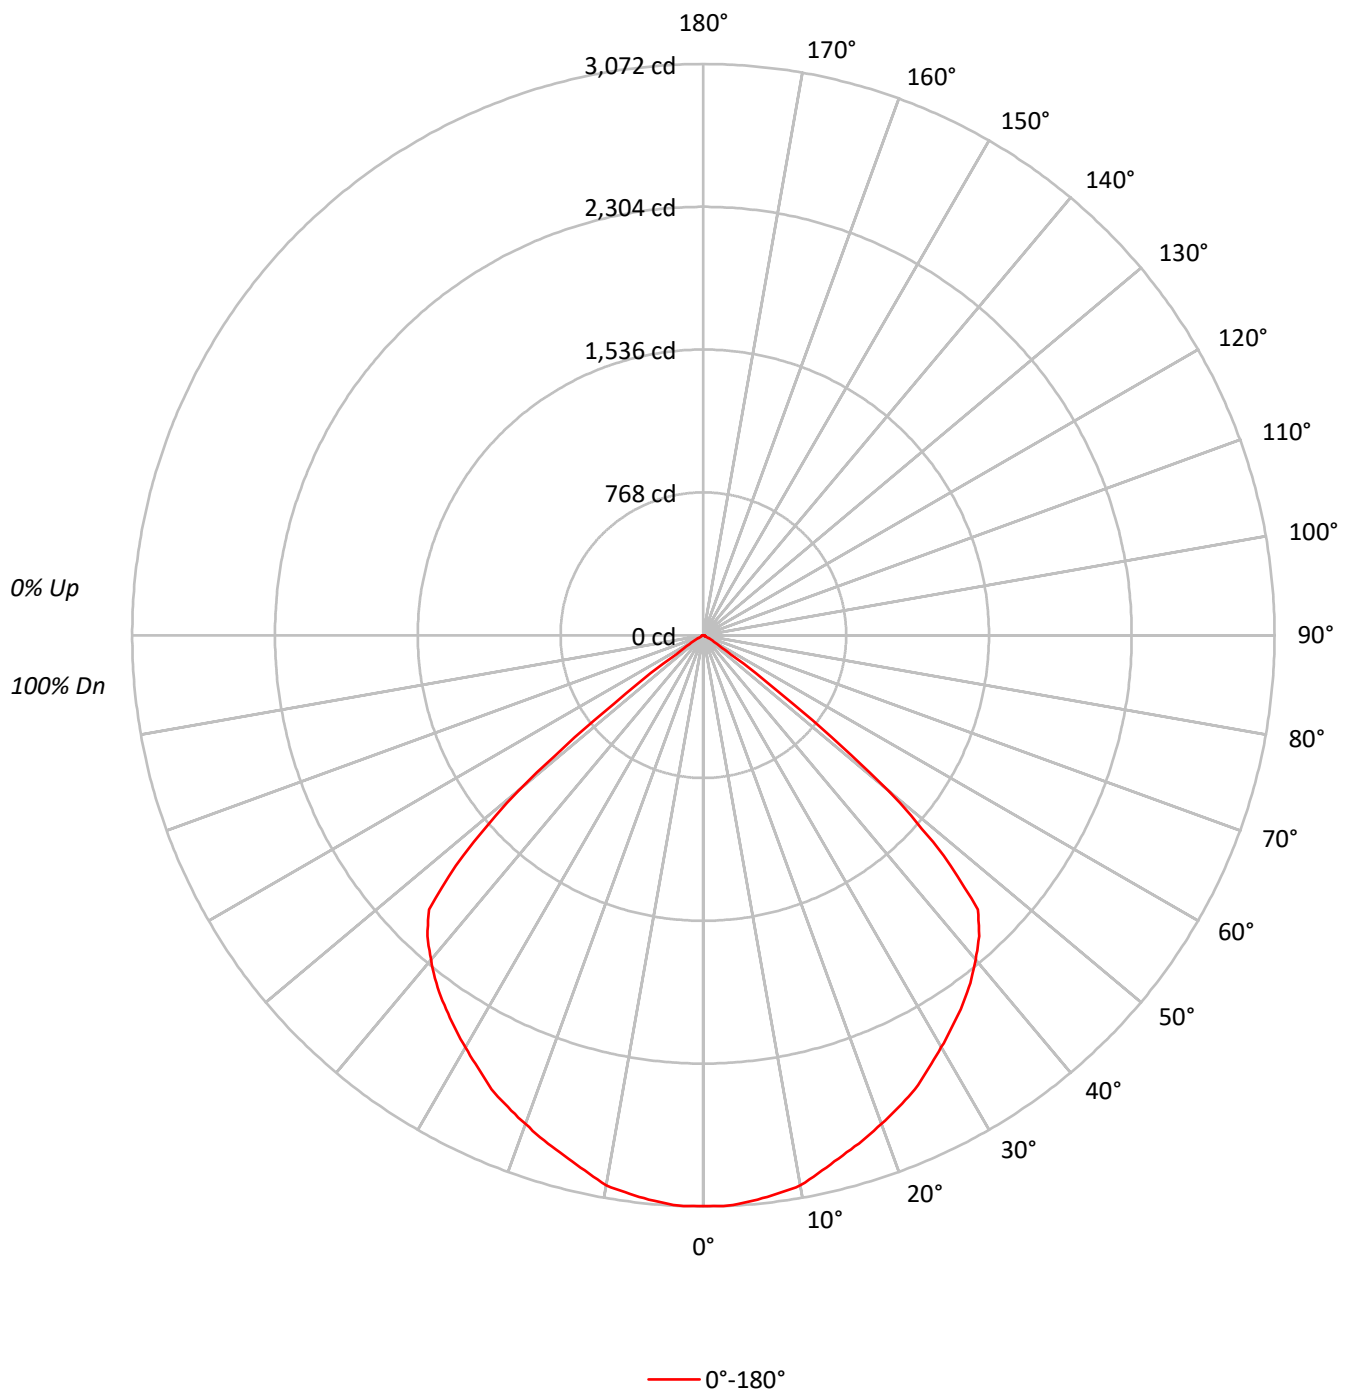

TEST NUMBER: P979410

CATALOG NUMBER: PRLX-240-930-74L-C-U-S-BLAK-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	112	109	106	103	110	107	104	102	103	100	99		99	97	96		95
2	105	99	94	90	103	97	93	89	94	90	87		91	88	85		88
3	98	90	84	79	96	89	83	78	86	81	77		83	79	76		81
4	91	82	75	70	89	81	74	69	78	73	69		76	72	68		74
5	85	75	68	62	83	74	67	62	72	66	61		70	65	61		68
6	79	68	61	56	78	67	60	55	66	60	55		64	59	55		63
7	74	63	55	50	73	62	55	50	61	54	50		59	54	49		58
8	69	58	50	45	68	57	50	45	56	49	45		55	49	45		54
9	65	53	46	41	64	53	46	41	52	45	41		51	45	41		50
10	61	49	42	38	60	49	42	38	48	42	37		47	41	37		46

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	30907
5°	30863
10°	30729
15°	30186
20°	29976
25°	29938
30°	29762
35°	29863
40°	29952
45°	29714
50°	20336
55°	3170
60°	783
65°	164
70°	203
75°	268
80°	400
85°	266

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 29714 cd/sqm

TEST NUMBER: P979410

CATALOG NUMBER: PRLX-240-930-74L-C-U-S-BLAK-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	289.9	5.1
10°-20°	818.8	14.3
20°-30°	1240.0	21.6
30°-40°	1520.1	26.5
40°-50°	1505.0	26.3
50°-60°	335.7	5.9
60°-70°	12.3	0.2
70°-80°	7.3	0.1
80°-90°	3.4	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2348.8	41.0
0°-40°	3868.9	67.5
0°-60°	5709.6	99.6
0°-90°	5732.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5732.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3070	
5°	3054	290
15°	2896	819
25°	2695	1240
35°	2430	1520
45°	2087	1505
55°	181	336
65°	7	12
75°	7	7
85°	2	3
90°	0	

TEST NUMBER: P979410

CATALOG NUMBER: PRLX-240-930-74L-C-U-S-BLAK-X

CANDELA DISTRIBUTION (FULL):

	0°
0°	3069.5
2.5°	3071.8
5°	3053.5
7.5°	3030.6
10°	3005.5
12.5°	2948.4
15°	2895.8
17.5°	2850.1
20°	2797.5
22.5°	2747.2
25°	2694.7
27.5°	2623.8
30°	2559.8
32.5°	2493.5
35°	2429.5
37.5°	2358.7
40°	2278.7
42.5°	2196.4
45°	2086.7
47.5°	1753.0
50°	1298.2
52.5°	605.7
55°	180.6
57.5°	86.9
60°	38.9
62.5°	13.7
65°	6.9
67.5°	6.9
70°	6.9
72.5°	6.9
75°	6.9
77.5°	6.9
80°	6.9
82.5°	4.6
85°	2.3
87.5°	2.3
90°	0.0

TEST NUMBER: P979410

CATALOG NUMBER: PRLX-240-930-74L-C-U-S-BLAK-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	5.74	7.04	6.11	7.36	7.67	5.74	7.04	6.11	7.36	7.67
	3H	5.66	6.79	6.04	7.12	7.49	5.66	6.79	6.04	7.12	7.49
	4H	5.63	6.69	6.04	7.04	7.42	5.63	6.69	6.04	7.04	7.42
	6H	5.66	6.62	6.07	6.99	7.38	5.66	6.62	6.07	6.99	7.38
	8H	5.66	6.57	6.09	6.96	7.37	5.66	6.57	6.09	6.96	7.37
	12H	5.65	6.52	6.08	6.90	7.33	5.65	6.52	6.08	6.90	7.33
4H	2H	5.55	6.60	5.95	6.95	7.34	5.55	6.60	5.95	6.95	7.34
	3H	5.48	6.33	5.90	6.73	7.13	5.48	6.33	5.90	6.73	7.13
	4H	5.48	6.23	5.92	6.65	7.09	5.48	6.23	5.92	6.65	7.09
	6H	5.57	6.22	6.04	6.66	7.13	5.57	6.22	6.04	6.66	7.13
	8H	5.60	6.20	6.07	6.65	7.12	5.60	6.20	6.07	6.65	7.12
	12H	5.60	6.13	6.09	6.62	7.09	5.60	6.13	6.09	6.62	7.09
8H	4H	5.39	5.99	5.86	6.44	6.91	5.39	5.99	5.86	6.44	6.91
	6H	5.54	6.03	6.04	6.53	7.01	5.54	6.03	6.04	6.53	7.01
	8H	5.60	6.05	6.12	6.56	7.06	5.60	6.05	6.12	6.56	7.06
	12H	5.63	6.03	6.14	6.53	7.10	5.63	6.03	6.14	6.53	7.10
12H	4H	5.36	5.89	5.85	6.37	6.85	5.36	5.89	5.85	6.37	6.85
	6H	5.51	5.95	6.03	6.47	6.96	5.51	5.95	6.03	6.47	6.96
	8H	5.60	6.00	6.12	6.50	7.07	5.60	6.00	6.12	6.50	7.07

END OF REPORT