

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2024 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P979432

Luminaire Tested: PRLX-240-935-LL2-F-U-S-BLAK-X

Issue Date: 4/3/2025

Test Information

Test Method: LM-79-2024
Report Number: P979432
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2502-353-7)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 4/3/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-240-935-LL2-F-U-S-BLAK-X
Description: 3D PRINTED LUMINAIRE, INTEGRAL LED LIGHT ENGINE, BLACK 240 SHADE WITH FROSTED LENS
Light Source: 3500K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1287.9 lumens
Efficiency: N/A
Efficacy: 117.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.2 / 1.33
Luminous Opening: Circular (Dia: 1.17' x H: 0')
CIE Type: Direct

Input Watts (W): 11
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P979432
CATALOG NUMBER: PRLX-240-935-LL2-F-U-S-BLAK-X

Luminous Intensity Polar Plot

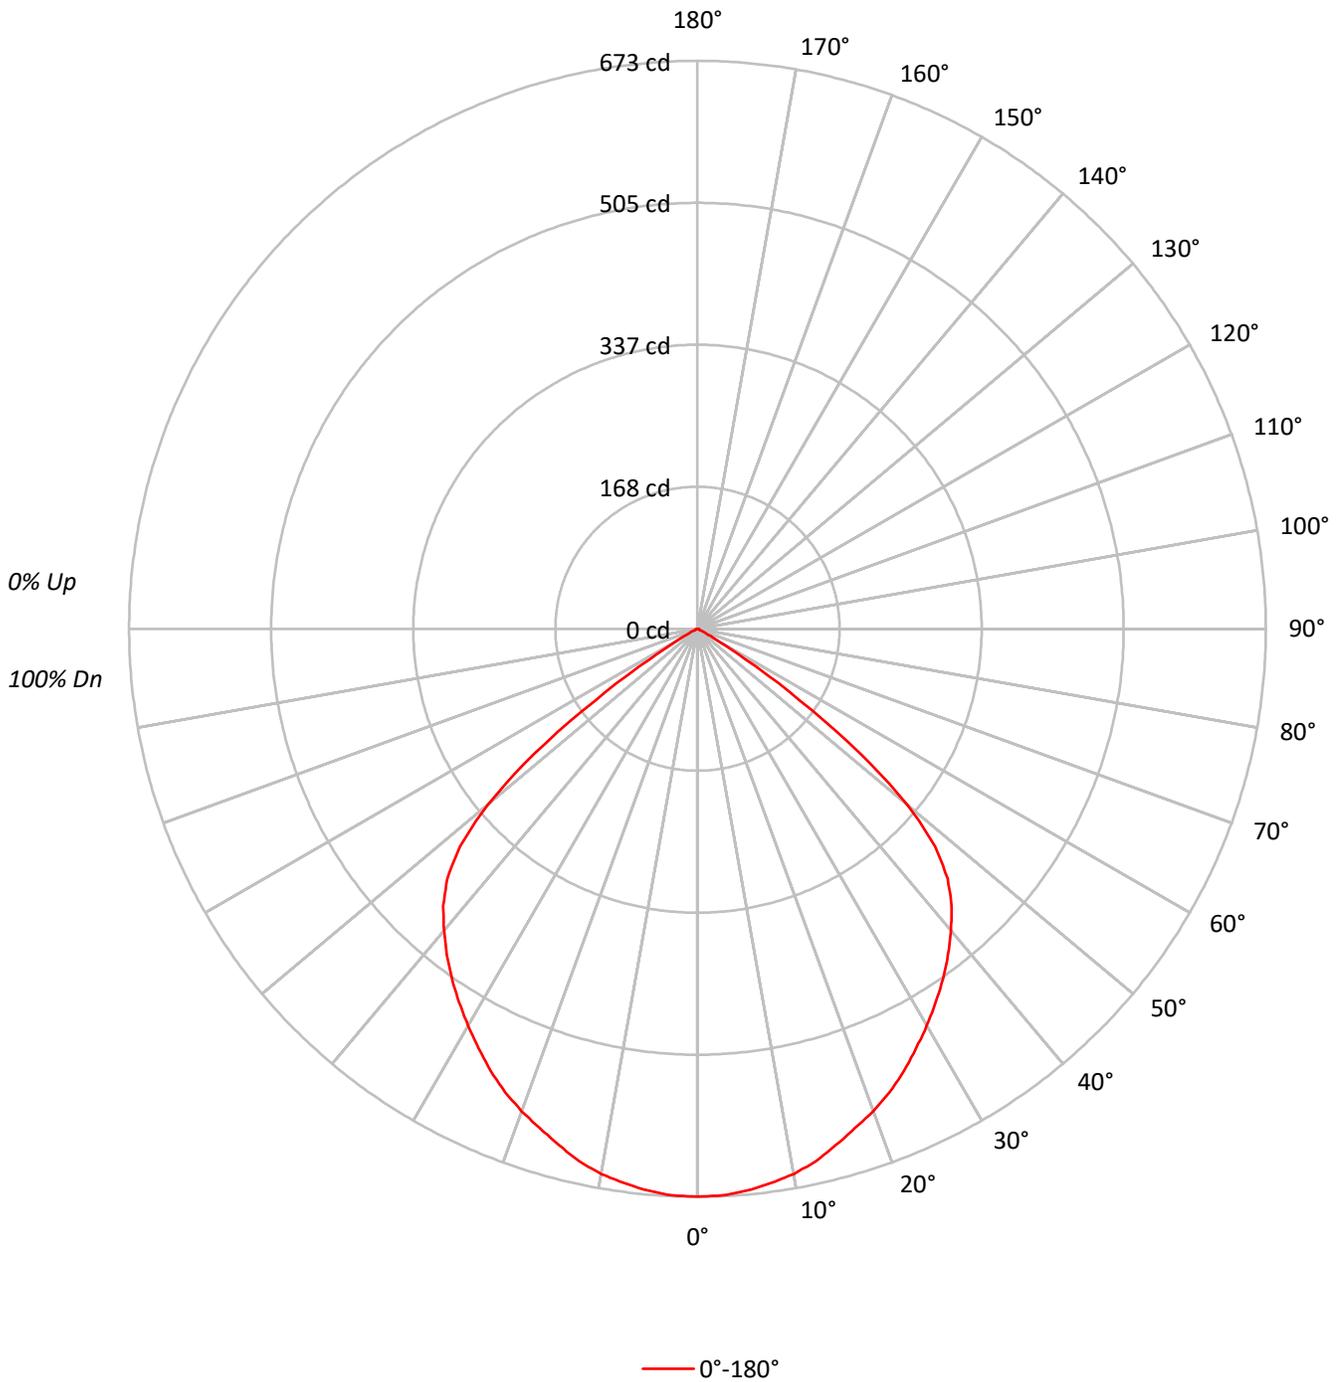



TEST NUMBER: P979432

CATALOG NUMBER: PRLX-240-935-LL2-F-U-S-BLAK-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									20									20
RC	80									70									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																														
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																												
1	112	109	106	103	110	106	104	101	102	100	98	99	97	95	95	94	92	90																												
2	105	98	93	89	102	97	92	88	93	89	86	90	87	84	87	85	82	81																												
3	97	89	83	78	95	88	82	77	85	80	76	82	78	75	80	76	73	72																												
4	90	81	74	68	88	80	73	68	77	72	67	75	70	66	73	69	65	64																												
5	84	73	66	61	82	72	65	60	70	64	60	69	63	59	67	62	59	57																												
6	78	67	59	54	77	66	59	54	64	58	53	63	57	53	61	56	53	51																												
7	73	61	54	48	71	61	53	48	59	53	48	58	52	48	57	51	47	46																												
8	68	56	49	44	67	56	49	44	54	48	43	53	47	43	52	47	43	41																												
9	64	52	45	40	63	51	44	40	50	44	39	49	43	39	48	43	39	37																												
10	60	48	41	36	59	48	41	36	47	40	36	46	40	36	45	40	36	34																												

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	6775
5°	6756
10°	6707
15°	6603
20°	6520
25°	6428
30°	6314
35°	6231
40°	6137
45°	5965
50°	5085
55°	2596
60°	421
65°	55
70°	50
75°	66
80°	64
85°	69

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 5965 cd/sqm

TEST NUMBER: P979432

CATALOG NUMBER: PRLX-240-935-LL2-F-U-S-BLAK-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	63.4	4.9
10°-20°	178.8	13.9
20°-30°	266.3	20.7
30°-40°	317.0	24.6
40°-50°	316.4	24.6
50°-60°	138.8	10.8
60°-70°	4.8	0.4
70°-80°	1.7	0.1
80°-90°	0.8	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	508.5	39.5
0°-40°	825.4	64.1
0°-60°	1280.6	99.4
0°-90°	1287.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1287.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	673	
5°	668	63
15°	633	179
25°	579	266
35°	507	317
45°	419	316
55°	148	139
65°	2	5
75°	2	2
85°	1	1
90°	0	



TEST NUMBER: P979432

CATALOG NUMBER: PRLX-240-935-LL2-F-U-S-BLAK-X

CANDELA DISTRIBUTION (FULL):

0°	
0°	672.9
2.5°	672.3
5°	668.4
7.5°	662.7
10°	656.0
12.5°	646.4
15°	633.4
17.5°	620.4
20°	608.5
22.5°	594.4
25°	578.6
27.5°	560.6
30°	543.1
32.5°	525.0
35°	506.9
37.5°	487.2
40°	466.9
42.5°	445.4
45°	418.9
47.5°	381.6
50°	324.6
52.5°	243.9
55°	147.9
57.5°	66.6
60°	20.9
62.5°	4.5
65°	2.3
67.5°	1.7
70°	1.7
72.5°	1.7
75°	1.7
77.5°	1.7
80°	1.1
82.5°	1.1
85°	0.6
87.5°	0.6
90°	0.0



TEST NUMBER: P979432
 CATALOG NUMBER: PRLX-240-935-LL2-F-U-S-BLAK-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.95	10.30	9.31	10.61	10.92	8.95	10.30	9.31	10.61	10.92
	3H	8.83	10.01	9.21	10.34	10.70	8.83	10.01	9.21	10.34	10.70
	4H	8.76	9.85	9.16	10.20	10.59	8.76	9.85	9.16	10.20	10.59
	6H	8.69	9.69	9.11	10.06	10.46	8.69	9.69	9.11	10.06	10.46
	8H	8.65	9.60	9.08	9.99	10.40	8.65	9.60	9.08	9.99	10.40
	12H	8.61	9.52	9.05	9.90	10.33	8.61	9.52	9.05	9.90	10.33
4H	2H	8.75	9.85	9.16	10.20	10.58	8.75	9.85	9.16	10.20	10.58
	3H	8.63	9.51	9.05	9.91	10.32	8.63	9.51	9.05	9.91	10.32
	4H	8.56	9.33	8.99	9.75	10.19	8.56	9.33	8.99	9.75	10.19
	6H	8.49	9.15	8.95	9.60	10.07	8.49	9.15	8.95	9.60	10.07
	8H	8.43	9.06	8.90	9.51	9.98	8.43	9.06	8.90	9.51	9.98
	12H	8.39	8.94	8.88	9.43	9.90	8.39	8.94	8.88	9.43	9.90
8H	4H	8.42	9.04	8.89	9.49	9.96	8.42	9.04	8.89	9.49	9.96
	6H	8.33	8.84	8.83	9.34	9.82	8.33	8.84	8.83	9.34	9.82
	8H	8.27	8.74	8.79	9.25	9.74	8.27	8.74	8.79	9.25	9.74
	12H	8.22	8.65	8.74	9.14	9.71	8.22	8.65	8.74	9.14	9.71
12H	4H	8.37	8.92	8.86	9.40	9.88	8.37	8.92	8.86	9.40	9.88
	6H	8.26	8.73	8.78	9.24	9.73	8.26	8.73	8.78	9.24	9.73
	8H	8.22	8.64	8.73	9.14	9.71	8.22	8.64	8.73	9.14	9.71