

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2024 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P979490

Luminaire Tested: PRLX-240-935-LL8-C-U-S-BLAK-X

Issue Date: 4/3/2025

Test Information

Test Method: LM-79-2024
Report Number: P979490
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2502-353-6)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 4/3/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-240-935-LL8-C-U-S-BLAK-X
Description: 3D PRINTED LUMINAIRE, INTEGRAL LED LIGHT ENGINE, BLACK 240 SHADE WITH CLEAR LENS
Light Source: 3500K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5922.5 lumens
Efficiency: N/A
Efficacy: 96.3 lumens/watt
Spacing Criteria (0/90/45): 1.25 / 1.25 / 1.39
Luminous Opening: Circular (Dia: 1.17' x H: 0')
CIE Type: Direct


Input Watts (W): 61.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P979490

CATALOG NUMBER: PRLX-240-935-LL8-C-U-S-BLAK-X

Luminous Intensity Polar Plot

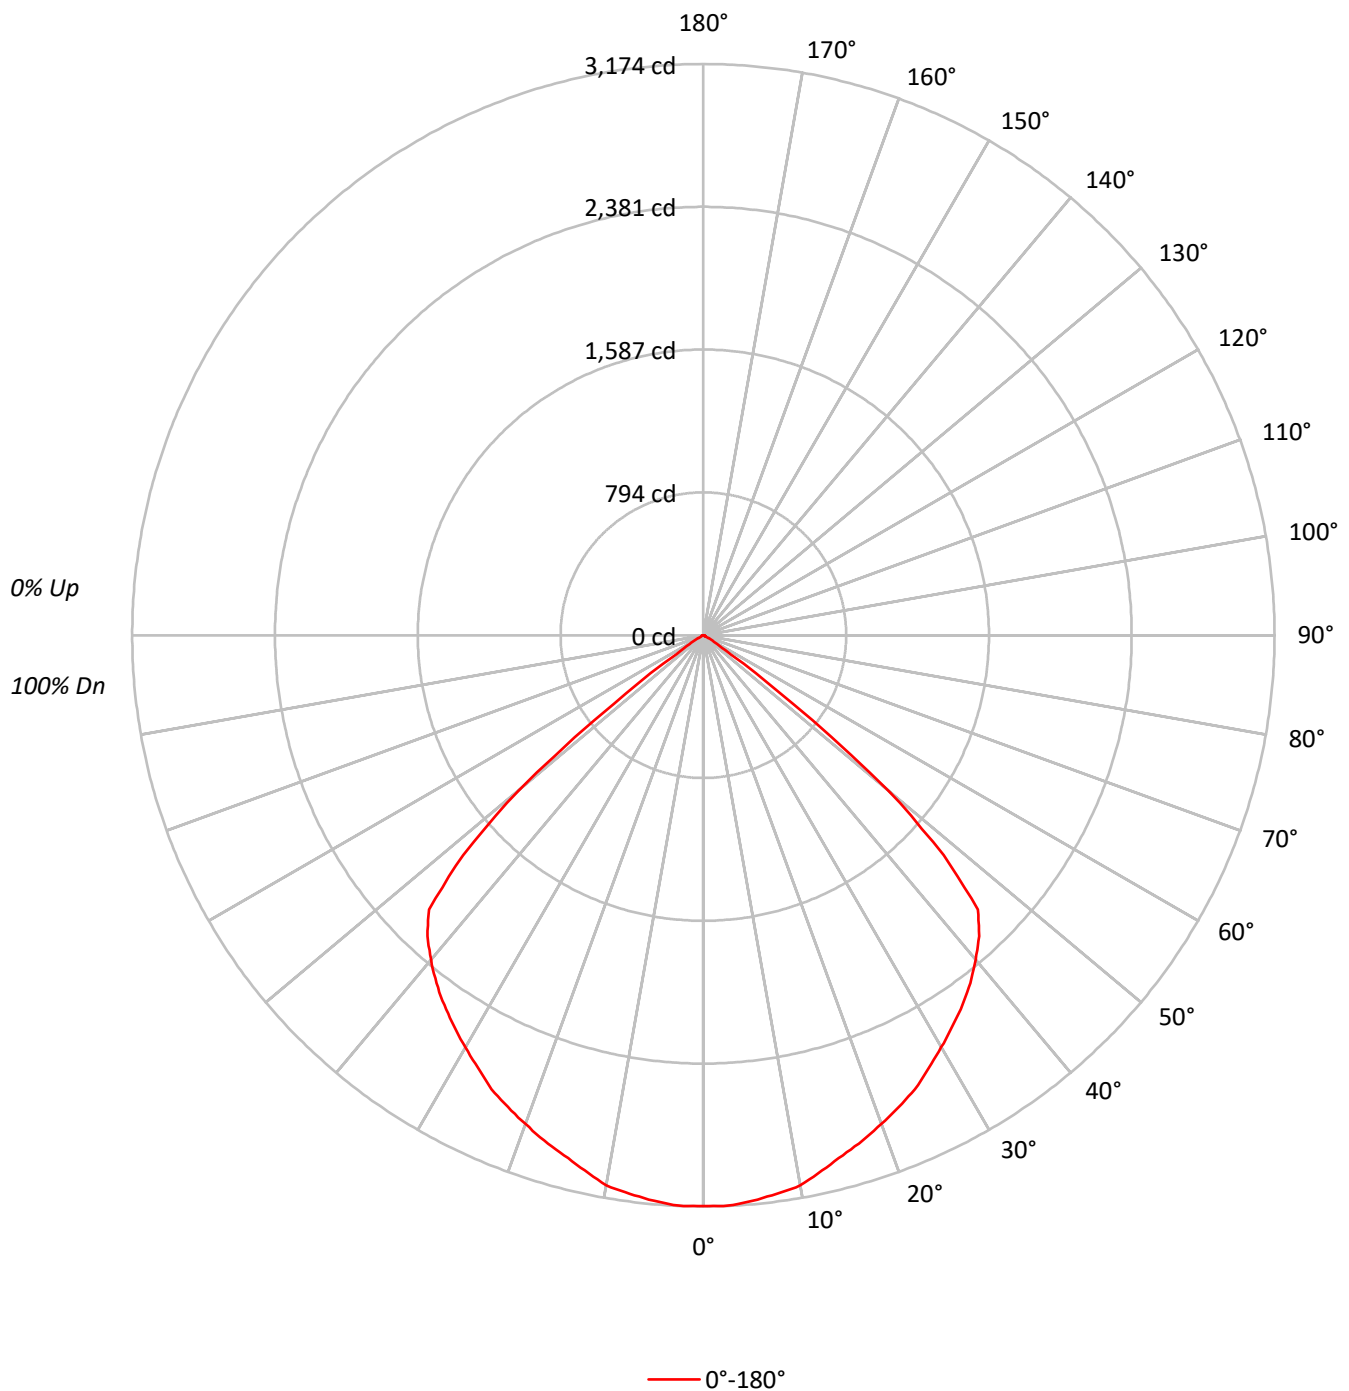

TEST NUMBER: P979490

CATALOG NUMBER: PRLX-240-935-LL8-C-U-S-BLAK-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	112	109	106	103	110	107	104	102	103	100	99		99	97	96		95
2	105	99	94	90	103	97	93	89	94	90	87		91	88	85		88
3	98	90	84	79	96	89	83	78	86	81	77		83	79	76		81
4	91	82	75	70	89	81	74	69	78	73	69		76	72	68		74
5	85	75	68	62	83	74	67	62	72	66	61		70	65	61		68
6	79	68	61	56	78	67	60	55	66	60	55		64	59	55		63
7	74	63	55	50	73	62	55	50	61	54	50		59	54	49		58
8	69	58	50	45	68	57	50	45	56	49	45		55	49	45		54
9	65	53	46	41	64	53	46	41	52	45	41		51	45	41		50
10	61	49	42	38	60	49	42	38	48	42	37		47	41	37		46

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	31931
5°	31886
10°	31748
15°	31186
20°	30969
25°	30930
30°	30748
35°	30853
40°	30944
45°	30699
50°	21009
55°	3274
60°	808
65°	169
70°	209
75°	276
80°	412
85°	277

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 30699 cd/sqm

TEST NUMBER: P979490

CATALOG NUMBER: PRLX-240-935-LL8-C-U-S-BLAK-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	299.5	5.1
10°-20°	845.9	14.3
20°-30°	1281.1	21.6
30°-40°	1570.5	26.5
40°-50°	1554.9	26.3
50°-60°	346.7	5.9
60°-70°	12.7	0.2
70°-80°	7.5	0.1
80°-90°	3.6	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2426.6	41.0
0°-40°	3997.1	67.5
0°-60°	5898.7	99.6
0°-90°	5922.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5922.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3171	
5°	3155	300
15°	2992	846
25°	2784	1281
35°	2510	1571
45°	2156	1555
55°	186	347
65°	7	13
75°	7	8
85°	2	4
90°	0	

TEST NUMBER: P979490

CATALOG NUMBER: PRLX-240-935-LL8-C-U-S-BLAK-X

CANDELA DISTRIBUTION (FULL):

0°	
0°	3171.2
2.5°	3173.6
5°	3154.7
7.5°	3131.1
10°	3105.1
12.5°	3046.1
15°	2991.7
17.5°	2944.5
20°	2890.2
22.5°	2838.3
25°	2784.0
27.5°	2710.8
30°	2644.6
32.5°	2576.2
35°	2510.0
37.5°	2436.8
40°	2354.2
42.5°	2269.2
45°	2155.9
47.5°	1811.1
50°	1341.2
52.5°	625.7
55°	186.5
57.5°	89.7
60°	40.1
62.5°	14.2
65°	7.1
67.5°	7.1
70°	7.1
72.5°	7.1
75°	7.1
77.5°	7.1
80°	7.1
82.5°	4.7
85°	2.4
87.5°	2.4
90°	0.0

TEST NUMBER: P979490

CATALOG NUMBER: PRLX-240-935-LL8-C-U-S-BLAK-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	5.85	7.15	6.22	7.46	7.78	5.85	7.15	6.22	7.46	7.78
	3H	5.76	6.90	6.14	7.23	7.59	5.76	6.90	6.14	7.23	7.59
	4H	5.74	6.79	6.14	7.14	7.53	5.74	6.79	6.14	7.14	7.53
	6H	5.76	6.72	6.18	7.09	7.49	5.76	6.72	6.18	7.09	7.49
	8H	5.77	6.68	6.20	7.07	7.47	5.77	6.68	6.20	7.07	7.47
	12H	5.75	6.62	6.18	7.00	7.43	5.75	6.62	6.18	7.00	7.43
4H	2H	5.65	6.71	6.06	7.06	7.44	5.65	6.71	6.06	7.06	7.44
	3H	5.59	6.43	6.00	6.84	7.24	5.59	6.43	6.00	6.84	7.24
	4H	5.59	6.33	6.02	6.75	7.20	5.59	6.33	6.02	6.75	7.20
	6H	5.68	6.32	6.14	6.77	7.24	5.68	6.32	6.14	6.77	7.24
	8H	5.71	6.31	6.18	6.76	7.23	5.71	6.31	6.18	6.76	7.23
	12H	5.71	6.24	6.20	6.72	7.20	5.71	6.24	6.20	6.72	7.20
8H	4H	5.50	6.10	5.97	6.55	7.02	5.50	6.10	5.97	6.55	7.02
	6H	5.64	6.13	6.14	6.63	7.11	5.64	6.13	6.14	6.63	7.11
	8H	5.70	6.15	6.22	6.67	7.16	5.70	6.15	6.22	6.67	7.16
	12H	5.73	6.13	6.25	6.63	7.20	5.73	6.13	6.25	6.63	7.20
12H	4H	5.46	5.99	5.95	6.48	6.95	5.46	5.99	5.95	6.48	6.95
	6H	5.61	6.06	6.13	6.57	7.07	5.61	6.06	6.13	6.57	7.07
	8H	5.70	6.11	6.22	6.60	7.17	5.70	6.11	6.22	6.60	7.17

END OF REPORT