

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2024 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P979522

Luminaire Tested: PRLX-240-940-LL3-F-U-S-BLAK-X

Issue Date: 4/3/2025

Test Information

Test Method: LM-79-2024
Report Number: P979522
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2502-353-7)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 4/3/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-240-940-LL3-F-U-S-BLAK-X
Description: 3D PRINTED LUMINAIRE, INTEGRAL LED LIGHT ENGINE, BLACK 240 SHADE WITH FROSTED LENS
Light Source: 4000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1753.0 lumens
Efficiency: N/A
Efficacy: 116.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.2 / 1.33
Luminous Opening: Circular (Dia: 1.17' x H: 0')
CIE Type: Direct

Input Watts (W): 15
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P979522
CATALOG NUMBER: PRLX-240-940-LL3-F-U-S-BLAK-X

Luminous Intensity Polar Plot

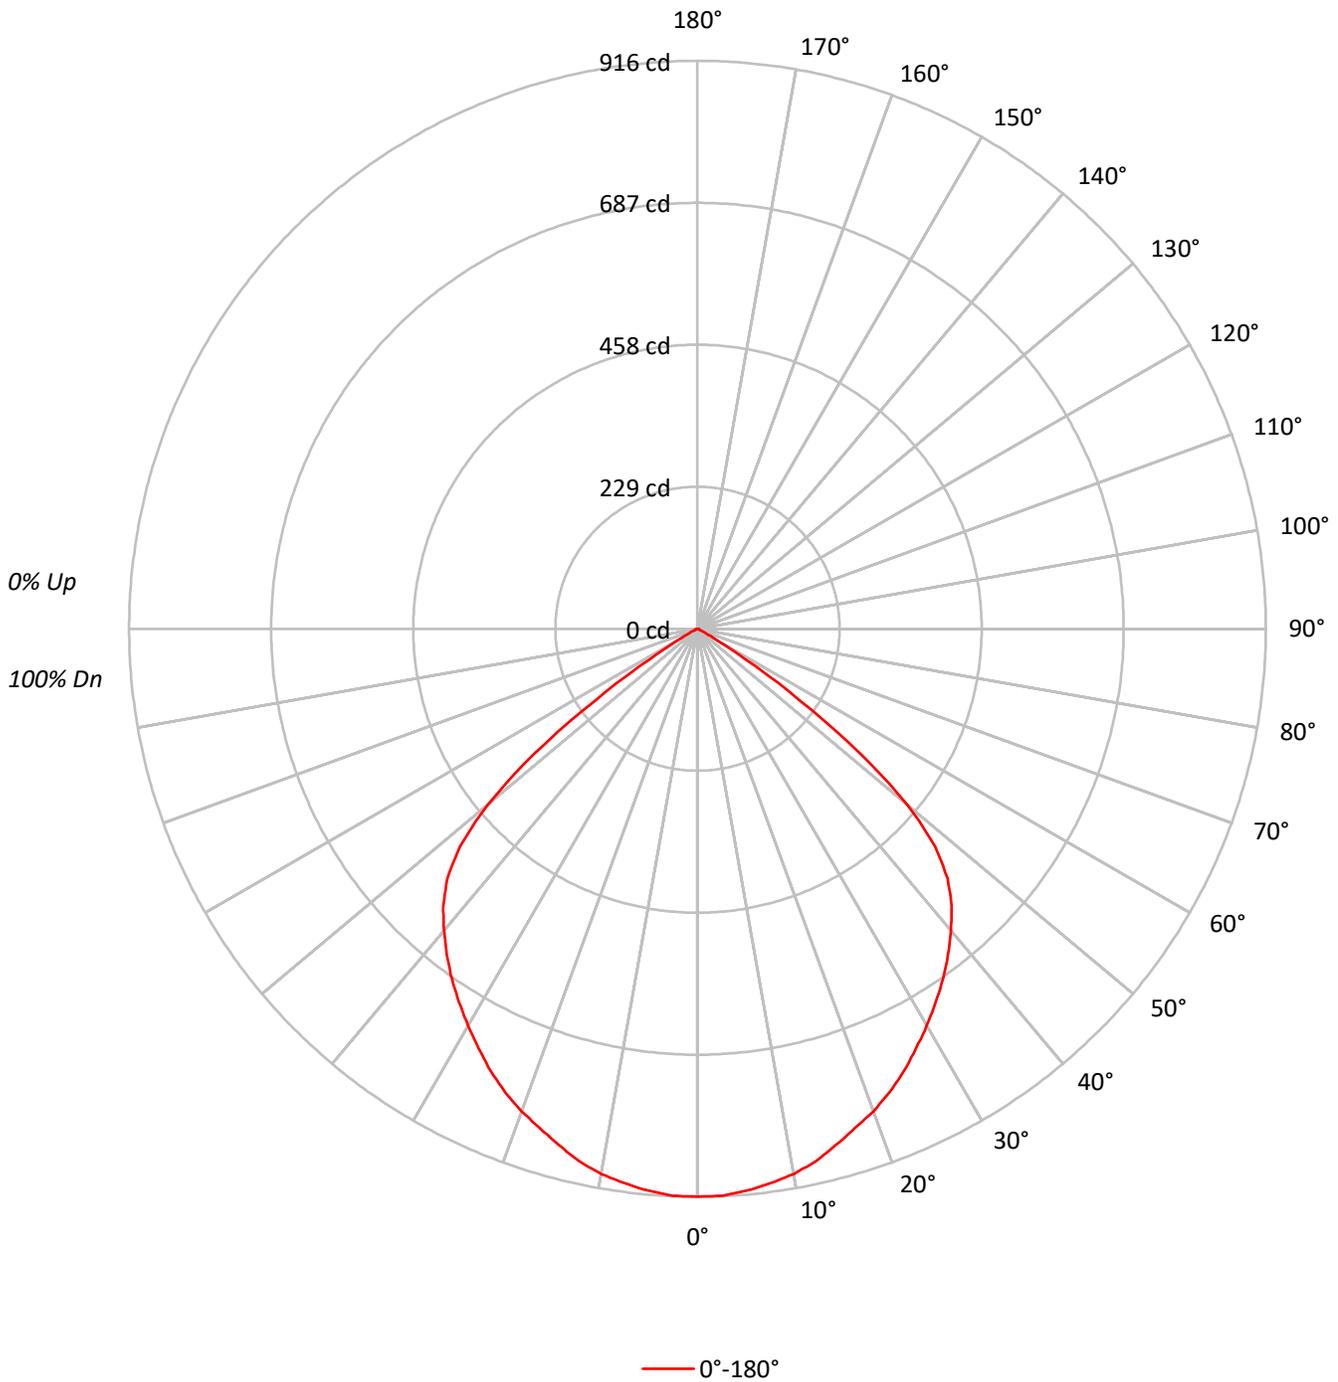



TEST NUMBER: P979522

CATALOG NUMBER: PRLX-240-940-LL3-F-U-S-BLAK-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									20									20
RC	80									70									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																														
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																												
1	112	109	106	103	110	106	104	101	102	100	98	99	97	95	95	94	92	90																												
2	105	98	93	89	102	97	92	88	93	89	86	90	87	84	87	85	82	81																												
3	97	89	83	78	95	88	82	77	85	80	76	82	78	75	80	76	73	72																												
4	90	81	74	68	88	80	73	68	77	72	67	75	70	66	73	69	65	64																												
5	84	73	66	61	82	72	65	60	70	64	60	69	63	59	67	62	59	57																												
6	78	67	59	54	77	66	59	54	64	58	53	63	57	53	61	56	53	51																												
7	73	61	54	48	71	61	53	48	59	53	48	58	52	48	57	51	47	46																												
8	68	56	49	44	67	56	49	44	54	48	43	53	47	43	52	47	43	41																												
9	64	52	45	40	63	51	44	40	50	44	39	49	43	39	48	43	39	37																												
10	60	48	41	36	59	48	41	36	47	40	36	46	40	36	45	40	36	34																												

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	9222
5°	9196
10°	9129
15°	8987
20°	8875
25°	8750
30°	8594
35°	8481
40°	8353
45°	8118
50°	6921
55°	3534
60°	572
65°	74
70°	68
75°	89
80°	87
85°	92

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 8118 cd/sqm

TEST NUMBER: P979522

CATALOG NUMBER: PRLX-240-940-LL3-F-U-S-BLAK-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	86.3	4.9
10°-20°	243.3	13.9
20°-30°	362.5	20.7
30°-40°	431.4	24.6
40°-50°	430.7	24.6
50°-60°	188.9	10.8
60°-70°	6.5	0.4
70°-80°	2.3	0.1
80°-90°	1.0	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	692.1	39.5
0°-40°	1123.6	64.1
0°-60°	1743.1	99.4
0°-90°	1753.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1753.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	916	
5°	910	86
15°	862	243
25°	788	363
35°	690	431
45°	570	431
55°	201	189
65°	3	7
75°	2	2
85°	1	1
90°	0	

TEST NUMBER: P979522

CATALOG NUMBER: PRLX-240-940-LL3-F-U-S-BLAK-X

CANDELA DISTRIBUTION (FULL):

0°	
0°	915.9
2.5°	915.2
5°	909.8
7.5°	902.1
10°	892.9
12.5°	879.8
15°	862.1
17.5°	844.5
20°	828.3
22.5°	809.1
25°	787.6
27.5°	763.0
30°	739.2
32.5°	714.6
35°	690.0
37.5°	663.1
40°	635.5
42.5°	606.3
45°	570.1
47.5°	519.4
50°	441.8
52.5°	331.9
55°	201.3
57.5°	90.7
60°	28.4
62.5°	6.1
65°	3.1
67.5°	2.3
70°	2.3
72.5°	2.3
75°	2.3
77.5°	2.3
80°	1.5
82.5°	1.5
85°	0.8
87.5°	0.8
90°	0.0

TEST NUMBER: P979522
 CATALOG NUMBER: PRLX-240-940-LL3-F-U-S-BLAK-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.02	11.37	10.39	11.68	12.00	10.02	11.37	10.39	11.68	12.00
	3H	9.90	11.08	10.28	11.41	11.78	9.90	11.08	10.28	11.41	11.78
	4H	9.84	10.93	10.24	11.28	11.66	9.84	10.93	10.24	11.28	11.66
	6H	9.77	10.77	10.18	11.14	11.53	9.77	10.77	10.18	11.14	11.53
	8H	9.73	10.67	10.16	11.06	11.47	9.73	10.67	10.16	11.06	11.47
	12H	9.69	10.59	10.12	10.97	11.40	9.69	10.59	10.12	10.97	11.40
4H	2H	9.83	10.92	10.23	11.27	11.65	9.83	10.92	10.23	11.27	11.65
	3H	9.71	10.58	10.12	10.99	11.39	9.71	10.58	10.12	10.99	11.39
	4H	9.63	10.40	10.07	10.82	11.27	9.63	10.40	10.07	10.82	11.27
	6H	9.56	10.23	10.02	10.67	11.14	9.56	10.23	10.02	10.67	11.14
	8H	9.51	10.13	9.98	10.58	11.05	9.51	10.13	9.98	10.58	11.05
	12H	9.46	10.02	9.95	10.50	10.97	9.46	10.02	9.95	10.50	10.97
8H	4H	9.49	10.12	9.96	10.56	11.04	9.49	10.12	9.96	10.56	11.04
	6H	9.40	9.91	9.90	10.41	10.89	9.40	9.91	9.90	10.41	10.89
	8H	9.34	9.81	9.86	10.33	10.82	9.34	9.81	9.86	10.33	10.82
	12H	9.30	9.72	9.81	10.21	10.79	9.30	9.72	9.81	10.21	10.79
12H	4H	9.44	10.00	9.93	10.48	10.95	9.44	10.00	9.93	10.48	10.95
	6H	9.33	9.80	9.85	10.32	10.81	9.33	9.80	9.85	10.32	10.81
	8H	9.29	9.71	9.81	10.21	10.78	9.29	9.71	9.81	10.21	10.78