

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P979632

Luminaire Tested: PRLX-241-927-48L-F-U-S-BLAK-X

Issue Date: 4/3/2025

Test Information

Test Method: LM-79-2019
Report Number: P979632
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2502-353-17)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 4/3/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-241-927-48L-F-U-S-BLAK-X
Description: 3D PRINTED LUMINAIRE, INTEGRAL LED LIGHT ENGINE, BLACK 241 SHADE WITH FROSTED LENS
Light Source: 2700K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1987.8 lumens
Efficiency: N/A
Efficacy: 59.3 lumens/watt
Spacing Criteria (0/90/45): 1.16 / 1.16 / 1.07
Luminous Opening: Circular (Dia: 1.33' x H: 0')
CIE Type: Direct

Input Watts (W): 33.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P979632

CATALOG NUMBER: PRLX-241-927-48L-F-U-S-BLAK-X

Luminous Intensity Polar Plot

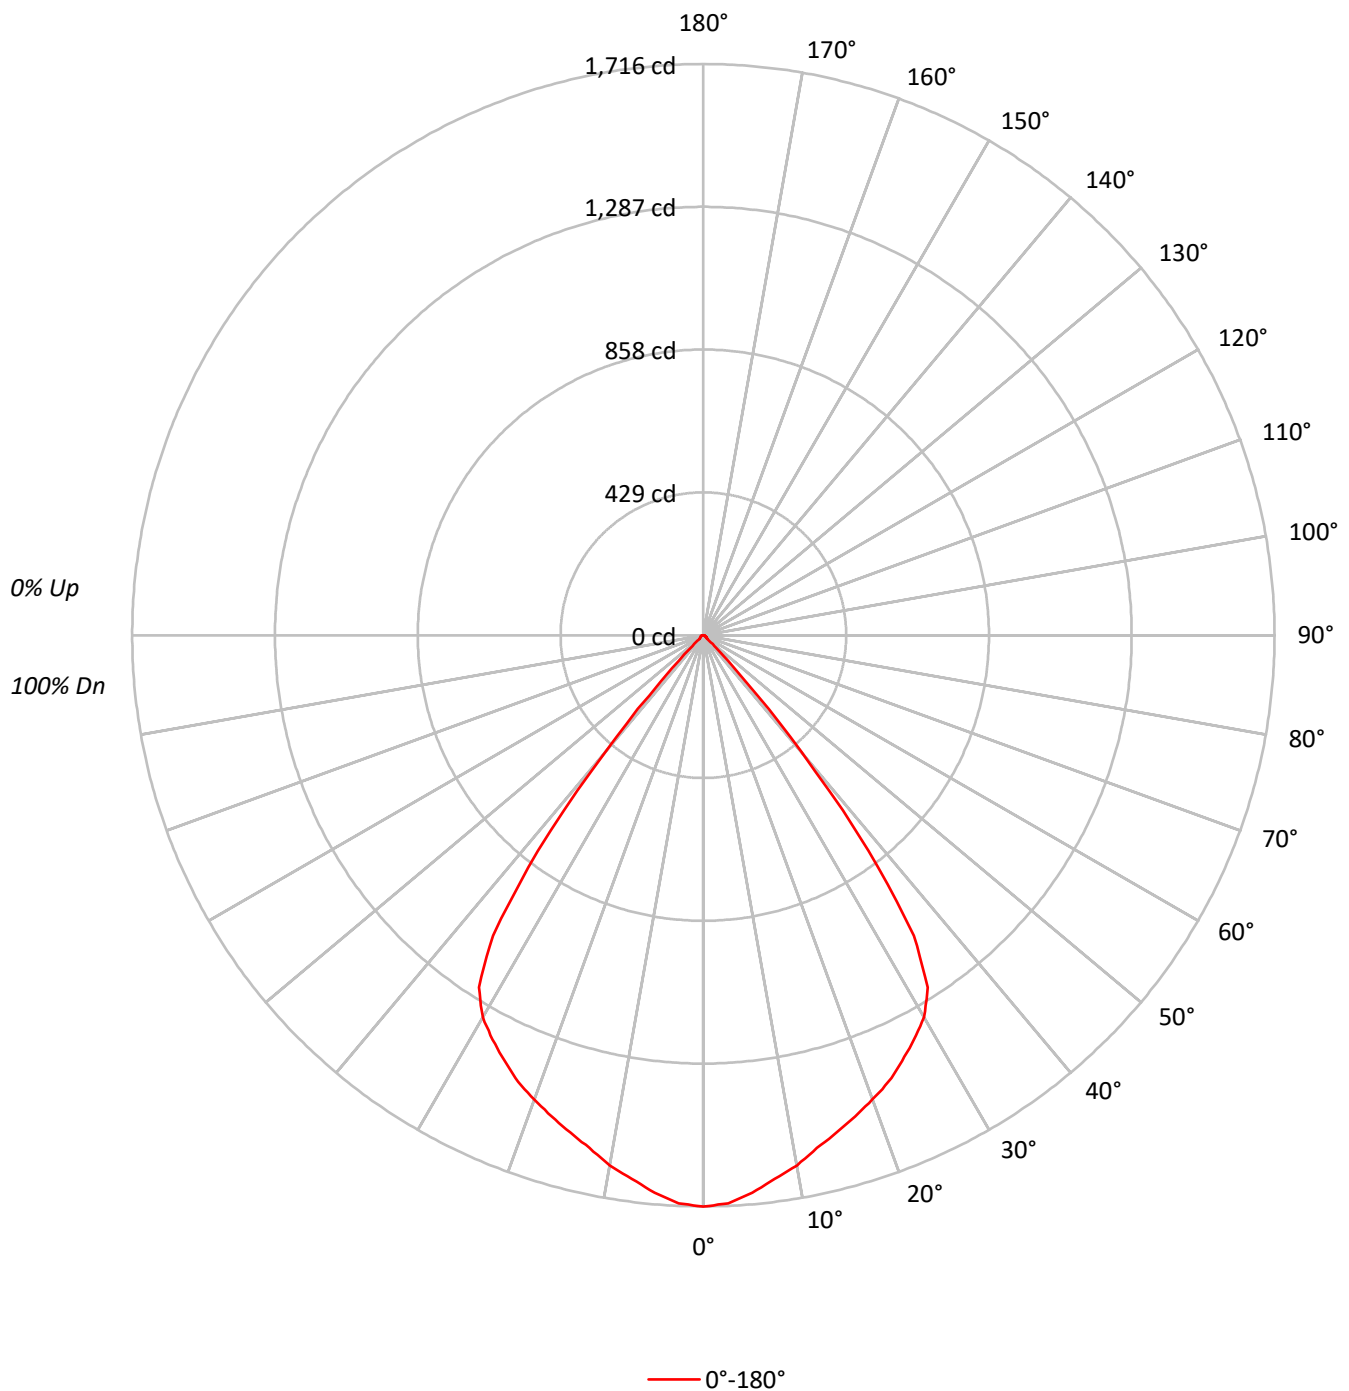

TEST NUMBER: P979632

CATALOG NUMBER: PRLX-241-927-48L-F-U-S-BLAK-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	113	110	108	105	111	108	106	104	104	102	101		100	99	98		97
2	107	102	98	95	105	101	97	93	97	94	91		94	92	89		92
3	102	95	90	86	100	93	89	85	91	87	83		88	85	82		86
4	96	88	82	78	94	87	82	77	85	80	77		83	79	76		81
5	91	82	76	71	89	81	75	71	79	74	70		78	73	70		76
6	86	77	70	66	84	76	70	65	74	69	65		73	68	65		71
7	81	71	65	61	80	71	65	61	69	64	60		68	63	60		67
8	77	67	61	56	76	66	60	56	65	60	56		64	59	56		63
9	73	63	56	52	72	62	56	52	61	56	52		60	55	52		59
10	69	59	53	49	68	58	53	49	58	52	49		57	52	48		56

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	13233
5°	13013
10°	12661
15°	12340
20°	12181
25°	12013
30°	11801
35°	10376
40°	4606
45°	578
50°	134
55°	151
60°	151
65°	153
70°	126
75°	125
80°	124
85°	124

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 578 cd/sqm

TEST NUMBER: P979632

CATALOG NUMBER: PRLX-241-927-48L-F-U-S-BLAK-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	158.4	8.0
10°-20°	436.9	22.0
20°-30°	650.5	32.7
30°-40°	627.8	31.6
40°-50°	91.3	4.6
50°-60°	9.6	0.5
60°-70°	7.8	0.4
70°-80°	4.4	0.2
80°-90°	1.1	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1245.8	62.7
0°-40°	1873.6	94.3
0°-60°	1974.4	99.3
0°-90°	1987.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1987.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1716	
5°	1682	158
15°	1546	437
25°	1412	651
35°	1102	628
45°	53	91
55°	11	10
65°	8	8
75°	4	4
85°	1	1
90°	0	

TEST NUMBER: P979632

CATALOG NUMBER: PRLX-241-927-48L-F-U-S-BLAK-X

CANDELA DISTRIBUTION (FULL):

0°	
0°	1716.5
2.5°	1708.1
5°	1681.6
7.5°	1646.7
10°	1617.4
12.5°	1578.3
15°	1546.2
17.5°	1515.5
20°	1484.8
22.5°	1452.7
25°	1412.3
27.5°	1370.4
30°	1325.7
32.5°	1254.6
35°	1102.5
37.5°	816.4
40°	457.7
42.5°	189.8
45°	53.0
47.5°	16.7
50°	11.2
52.5°	11.2
55°	11.2
57.5°	9.8
60°	9.8
62.5°	8.4
65°	8.4
67.5°	7.0
70°	5.6
72.5°	5.6
75°	4.2
77.5°	2.8
80°	2.8
82.5°	1.4
85°	1.4
87.5°	0.0
90°	0.0

TEST NUMBER: P979632

CATALOG NUMBER: PRLX-241-927-48L-F-U-S-BLAK-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
4H	2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
8H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.25	0.00	0.00	0.00	0.00	0.25
12H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.08	0.00	0.00	0.00	0.00	0.08

END OF REPORT