

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P979763

Luminaire Tested: PRLX-241-935-23L-F-U-S-WHTE-X

Issue Date: 4/3/2025

**Test Information**

Test Method: LM-79-2019  
Report Number: P979763  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2502-353-12)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 4/3/2025  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PrentaLux  
Catalog Number: PRLX-241-935-23L-F-U-S-WHTE-X  
Description: 3D PRINTED LUMINAIRE, INTEGRAL LED LIGHT ENGINE, WHITE 241 SHADE WITH FROSTED LENS  
Light Source: 3500K CCT, 90 CRI LEDS  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1972.7 lumens  
Efficiency: N/A  
Efficacy: 131.5 lumens/watt  
Spacing Criteria (0/90/45): 1.21 / 1.21 / 1.12  
Luminous Opening: Circular (Dia: 1.33' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 15  
Input Voltage (V): 120  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P979763

CATALOG NUMBER: PRLX-241-935-23L-F-U-S-WHTE-X

### Luminous Intensity Polar Plot

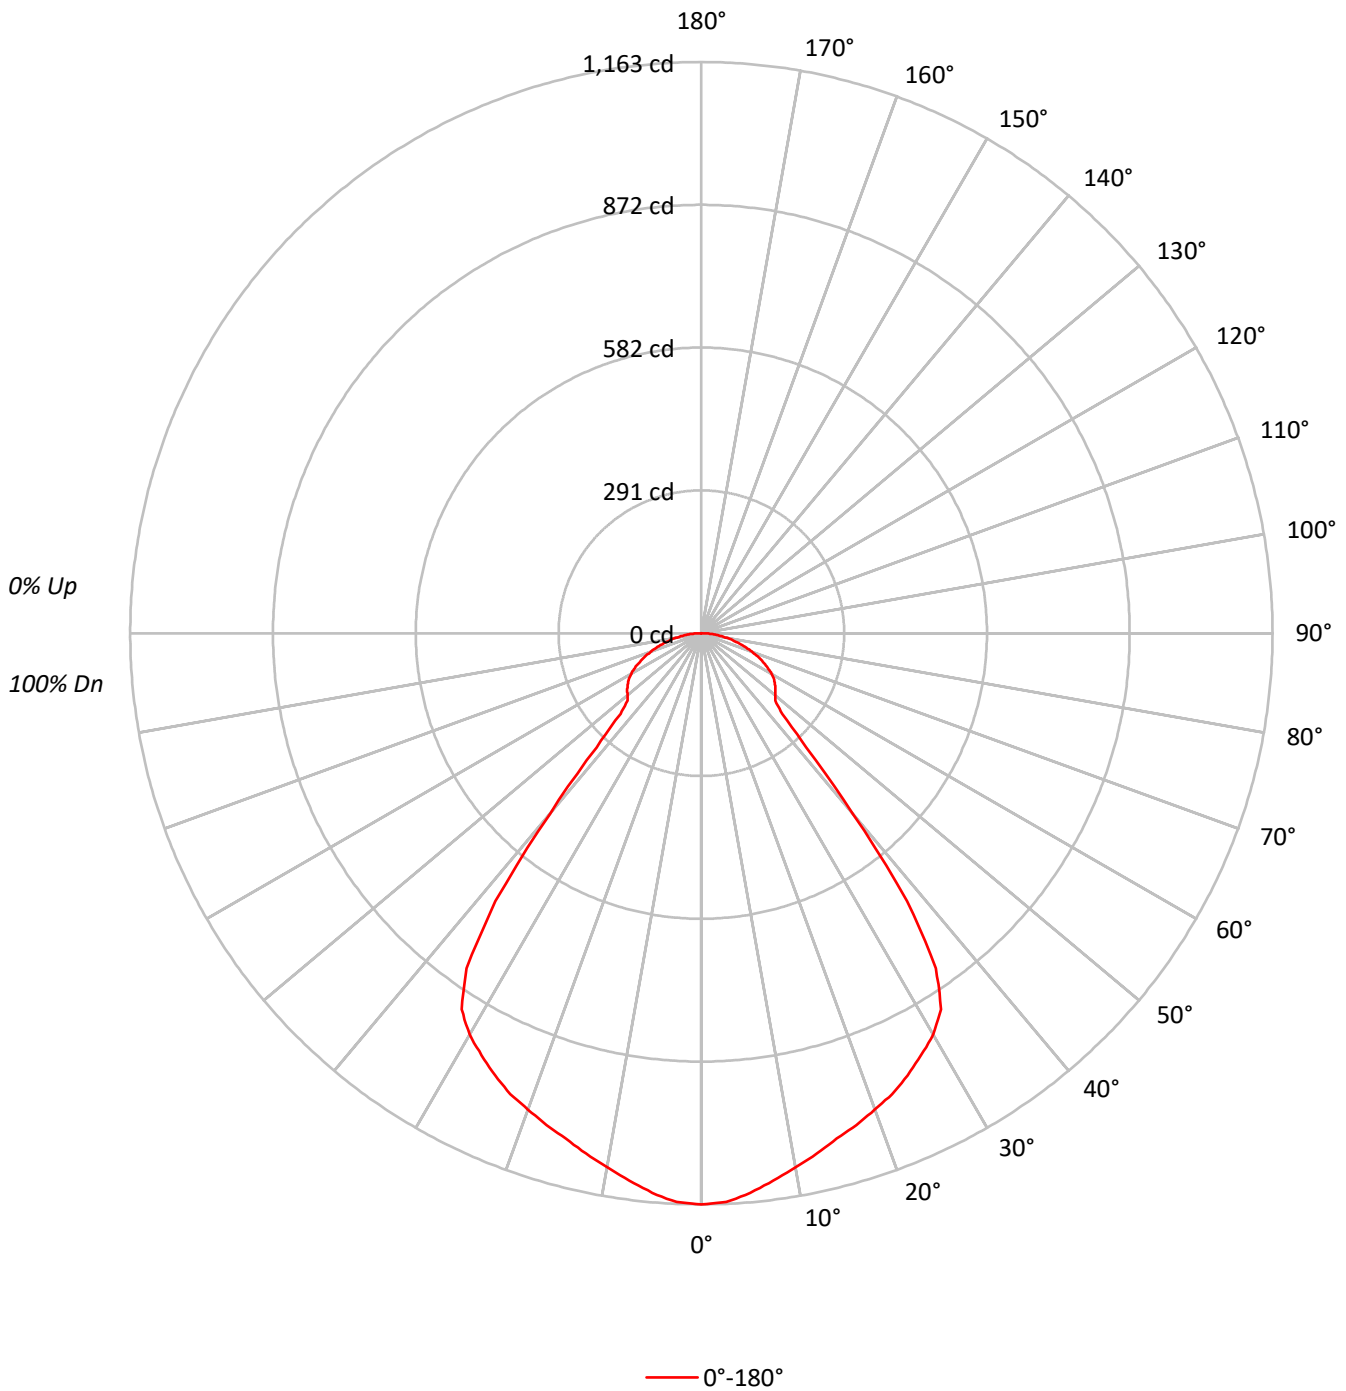



TEST NUMBER: P979763

CATALOG NUMBER: PRLX-241-935-23L-F-U-S-WHTE-X

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	111	107	103	100	108	104	101	98	100	98	95	96	94	92	93	91	90	88
2	103	96	90	85	100	94	89	84	90	86	82	87	84	81	84	81	79	77
3	95	86	80	74	93	85	79	73	82	77	72	79	75	71	77	73	70	68
4	89	78	71	65	87	77	70	65	75	69	64	73	67	63	71	66	62	61
5	83	72	64	58	81	71	63	58	69	62	57	67	61	57	65	60	56	54
6	77	66	58	52	76	65	58	52	63	57	52	62	56	51	60	55	51	49
7	72	61	53	48	71	60	53	47	58	52	47	57	51	47	56	51	47	45
8	68	56	49	43	67	55	48	43	54	48	43	53	47	43	52	47	43	41
9	64	52	45	40	63	52	45	40	51	44	40	50	44	39	49	43	39	38
10	60	49	42	37	59	48	41	37	47	41	37	46	41	36	46	40	36	35

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	8966
5°	8852
10°	8647
15°	8502
20°	8466
25°	8451
30°	8401
35°	7837
40°	4823
45°	2536
50°	2354
55°	2460
60°	2547
65°	2526
70°	2455
75°	2338
80°	2202
85°	2034

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 62.5°  
 Luminance: 2548 cd/sqm

TEST NUMBER: P979763

CATALOG NUMBER: PRLX-241-935-23L-F-U-S-WHTE-X

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	107.9	5.5
10°-20°	301.5	15.3
20°-30°	457.7	23.2
30°-40°	487.7	24.7
40°-50°	208.3	10.6
50°-60°	163.4	8.3
60°-70°	136.6	6.9
70°-80°	83.2	4.2
80°-90°	26.3	1.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	867.1	44.0
0°-40°	1354.8	68.7
0°-60°	1726.6	87.5
0°-90°	1972.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1972.7	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1163	
5°	1144	108
15°	1065	301
25°	994	458
35°	833	488
45°	233	208
55°	183	163
65°	138	137
75°	78	83
85°	23	26
90°	0	

TEST NUMBER: P979763

CATALOG NUMBER: PRLX-241-935-23L-F-U-S-WHTE-X

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	1163.1
2.5°	1159.4
5°	1143.9
7.5°	1123.9
10°	1104.6
12.5°	1085.3
15°	1065.3
17.5°	1049.8
20°	1032.0
22.5°	1015.7
25°	993.5
27.5°	969.0
30°	943.8
32.5°	908.3
35°	832.7
37.5°	688.3
40°	479.3
42.5°	316.3
45°	232.6
47.5°	203.7
50°	196.3
52.5°	190.4
55°	183.0
57.5°	175.6
60°	165.2
62.5°	152.6
65°	138.5
67.5°	123.7
70°	108.9
72.5°	93.3
75°	78.5
77.5°	64.5
80°	49.6
82.5°	36.3
85°	23.0
87.5°	12.6
90°	0.0



TEST NUMBER: P979763  
 CATALOG NUMBER: PRLX-241-935-23L-F-U-S-WHTE-X

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.63	14.97	13.99	15.28	15.59	13.63	14.97	13.99	15.28	15.59
	3H	15.63	16.83	16.01	17.16	17.53	15.63	16.83	16.01	17.16	17.53
	4H	16.39	17.51	16.79	17.86	18.24	16.39	17.51	16.79	17.86	18.24
	6H	16.97	18.01	17.39	18.38	18.77	16.97	18.01	17.39	18.38	18.77
	8H	17.17	18.16	17.60	18.55	18.95	17.17	18.16	17.60	18.55	18.95
	12H	17.31	18.25	17.74	18.64	19.07	17.31	18.25	17.74	18.64	19.07
4H	2H	14.30	15.42	14.70	15.77	16.15	14.30	15.42	14.70	15.77	16.15
	3H	16.50	17.43	16.91	17.84	18.24	16.50	17.43	16.91	17.84	18.24
	4H	17.38	18.22	17.81	18.64	19.08	17.38	18.22	17.81	18.64	19.08
	6H	18.10	18.83	18.56	19.27	19.74	18.10	18.83	18.56	19.27	19.74
	8H	18.35	19.03	18.81	19.48	19.95	18.35	19.03	18.81	19.48	19.95
	12H	18.53	19.14	19.02	19.62	20.09	18.53	19.14	19.02	19.62	20.09
8H	4H	17.70	18.38	18.17	18.83	19.30	17.70	18.38	18.17	18.83	19.30
	6H	18.56	19.12	19.06	19.61	20.09	18.56	19.12	19.06	19.61	20.09
	8H	18.89	19.40	19.41	19.91	20.40	18.89	19.40	19.41	19.91	20.40
	12H	19.17	19.61	19.69	20.11	20.68	19.17	19.61	19.69	20.11	20.68
12H	4H	17.73	18.33	18.21	18.82	19.29	17.73	18.33	18.21	18.82	19.29
	6H	18.62	19.12	19.14	19.63	20.13	18.62	19.12	19.14	19.63	20.13
	8H	19.02	19.46	19.54	19.96	20.53	19.02	19.46	19.54	19.96	20.53