

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2024 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P979852

Luminaire Tested: PRLX-241-940-LL4-F-U-S-BLAK-X

Issue Date: 4/3/2025

**Test Information**

Test Method: LM-79-2024  
Report Number: P979852  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2502-353-17)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 4/3/2025  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PrentaLux  
Catalog Number: PRLX-241-940-LL4-F-U-S-BLAK-X  
Description: 3D PRINTED LUMINAIRE, INTEGRAL LED LIGHT ENGINE, BLACK 241 SHADE WITH FROSTED LENS  
Light Source: 4000K CCT, 90 CRI LEDS  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 1477.3 lumens  
Efficiency: N/A  
Efficacy: 72.1 lumens/watt  
Spacing Criteria (0/90/45): 1.16 / 1.16 / 1.07  
Luminous Opening: Circular (Dia: 1.33' x H: 0')  
CIE Type: Direct

Input Watts (W): 20.5  
Input Voltage (V): 120  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



TEST NUMBER: P979852  
CATALOG NUMBER: PRLX-241-940-LL4-F-U-S-BLAK-X

### Luminous Intensity Polar Plot

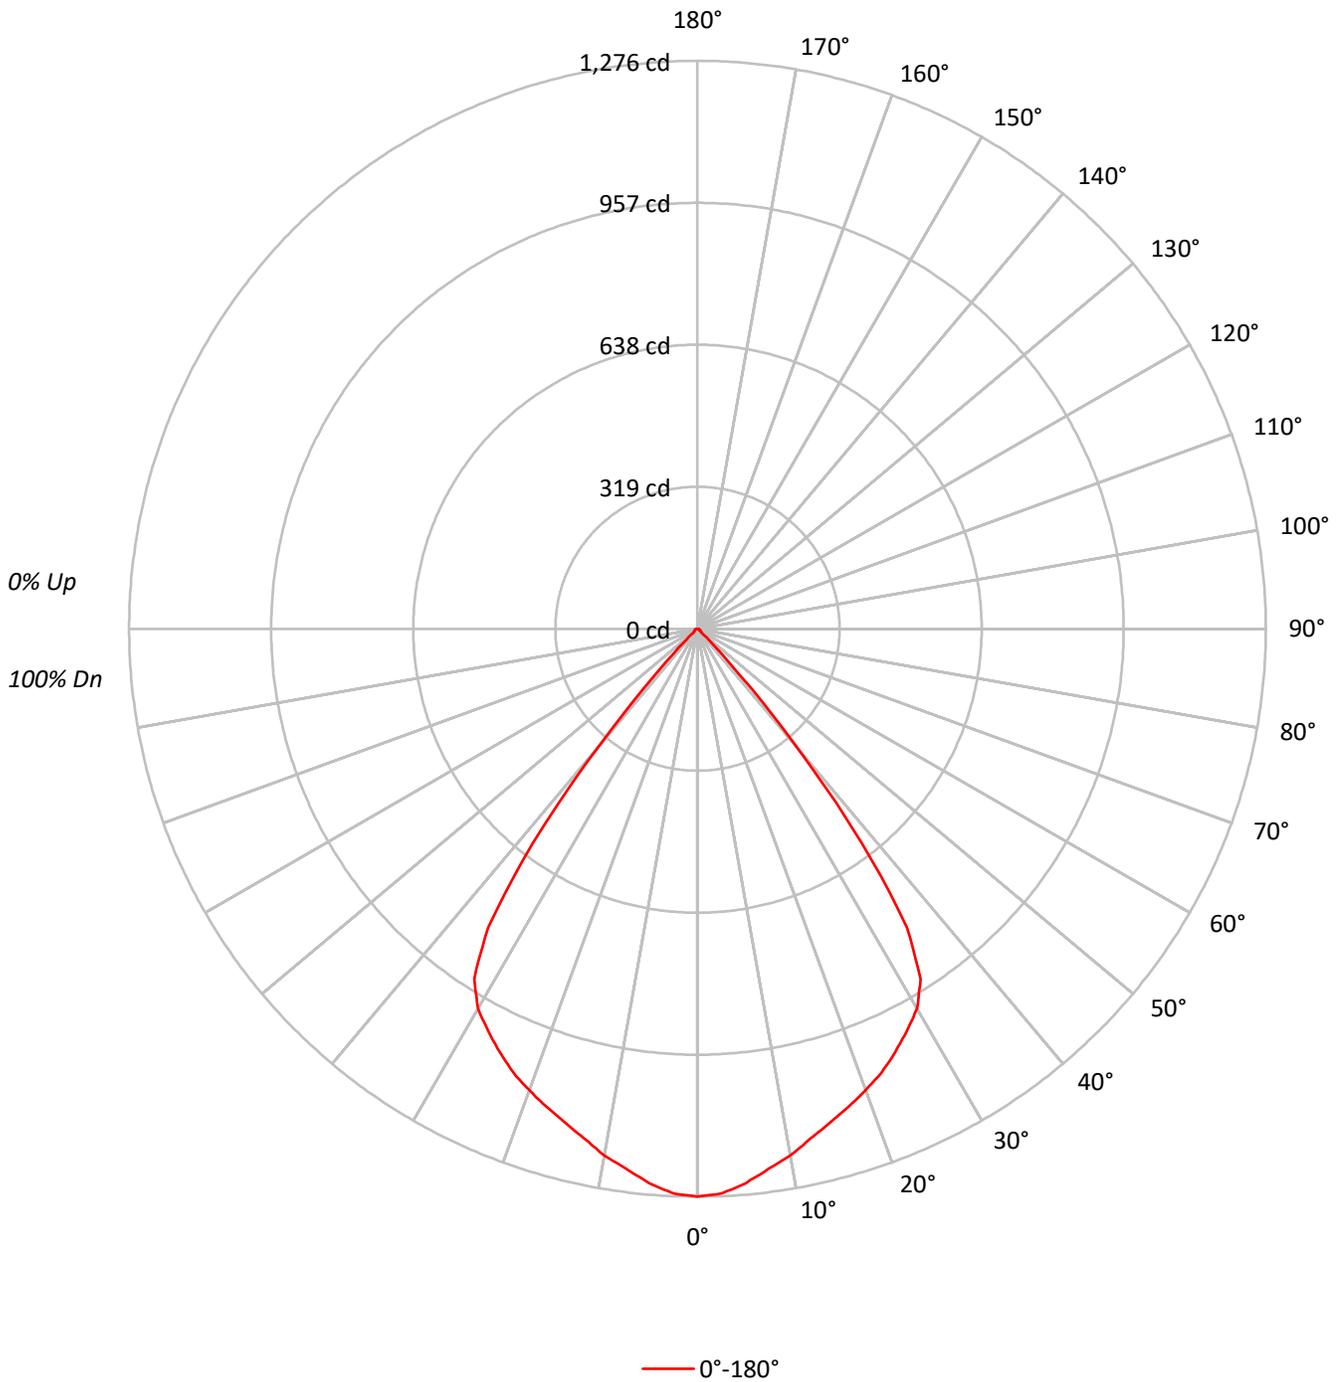



TEST NUMBER: P979852

CATALOG NUMBER: PRLX-241-940-LL4-F-U-S-BLAK-X

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20					20					20					20					20	
RC	80					70					50					30					10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				
1	113	110	108	105	111	108	106	104	104	102	101	100	99	98	97	96	95	93				
2	107	102	98	95	105	101	97	93	97	94	91	94	92	89	92	89	88	86				
3	102	95	90	86	100	93	89	85	91	87	83	88	85	82	86	83	81	79				
4	96	88	82	78	94	87	82	77	85	80	77	83	79	76	81	78	75	73				
5	91	82	76	71	89	81	75	71	79	74	70	78	73	70	76	72	69	68				
6	86	77	70	66	84	76	70	65	74	69	65	73	68	65	71	67	64	63				
7	81	71	65	61	80	71	65	61	69	64	60	68	63	60	67	63	60	58				
8	77	67	61	56	76	66	60	56	65	60	56	64	59	56	63	59	55	54				
9	73	63	56	52	72	62	56	52	61	56	52	60	55	52	59	55	52	50				
10	69	59	53	49	68	58	53	49	58	52	49	57	52	48	56	52	48	47				

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	9834
5°	9672
10°	9410
15°	9172
20°	9053
25°	8928
30°	8771
35°	7711
40°	3424
45°	430
50°	100
55°	112
60°	113
65°	113
70°	92
75°	92
80°	93
85°	88

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 430 cd/sqm



TEST NUMBER: P979852

CATALOG NUMBER: PRLX-241-940-LL4-F-U-S-BLAK-X

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	117.7	8.0
10°-20°	324.7	22.0
20°-30°	483.5	32.7
30°-40°	466.6	31.6
40°-50°	67.9	4.6
50°-60°	7.1	0.5
60°-70°	5.8	0.4
70°-80°	3.3	0.2
80°-90°	0.8	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	925.9	62.7
0°-40°	1392.5	94.3
0°-60°	1467.4	99.3
0°-90°	1477.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1477.3	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1276	
5°	1250	118
15°	1149	325
25°	1050	483
35°	819	467
45°	39	68
55°	8	7
65°	6	6
75°	3	3
85°	1	1
90°	0	



TEST NUMBER: P979852

CATALOG NUMBER: PRLX-241-940-LL4-F-U-S-BLAK-X

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	1275.7
2.5°	1269.5
5°	1249.8
7.5°	1223.9
10°	1202.1
12.5°	1173.0
15°	1149.2
17.5°	1126.4
20°	1103.5
22.5°	1079.7
25°	1049.6
27.5°	1018.5
30°	985.3
32.5°	932.4
35°	819.4
37.5°	606.7
40°	340.2
42.5°	141.1
45°	39.4
47.5°	12.4
50°	8.3
52.5°	8.3
55°	8.3
57.5°	7.3
60°	7.3
62.5°	6.2
65°	6.2
67.5°	5.2
70°	4.1
72.5°	4.1
75°	3.1
77.5°	2.1
80°	2.1
82.5°	1.0
85°	1.0
87.5°	0.0
90°	0.0



TEST NUMBER: P979852  
 CATALOG NUMBER: PRLX-241-940-LL4-F-U-S-BLAK-X

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
4H	2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
8H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
12H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00