

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P979901

Luminaire Tested: PRLX-242-927-12L-C-U-S-WHTE-X

Issue Date: 4/3/2025

**Test Information**


Test Method: LM-79-2019  
Report Number: P979901  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2502-353-21)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 4/3/2025  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PrentaLux  
Catalog Number: PRLX-242-927-12L-C-U-S-WHTE-X  
Description: 3D PRINTED LUMINAIRE, INTEGRAL LED LIGHT ENGINE, WHITE 242 SHADE WITH CLEAR LENS  
Light Source: 2700K CCT, 90 CRI LEDS  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1219.7 lumens  
Efficiency: N/A  
Efficacy: 162.6 lumens/watt  
Spacing Criteria (0/90/45): 1.27 / 1.27 / 1.4  
Luminous Opening: Circular (Dia: 1.75' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 7.5  
Input Voltage (V): 120  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P979901  
CATALOG NUMBER: PRLX-242-927-12L-C-U-S-WHTE-X

### Luminous Intensity Polar Plot

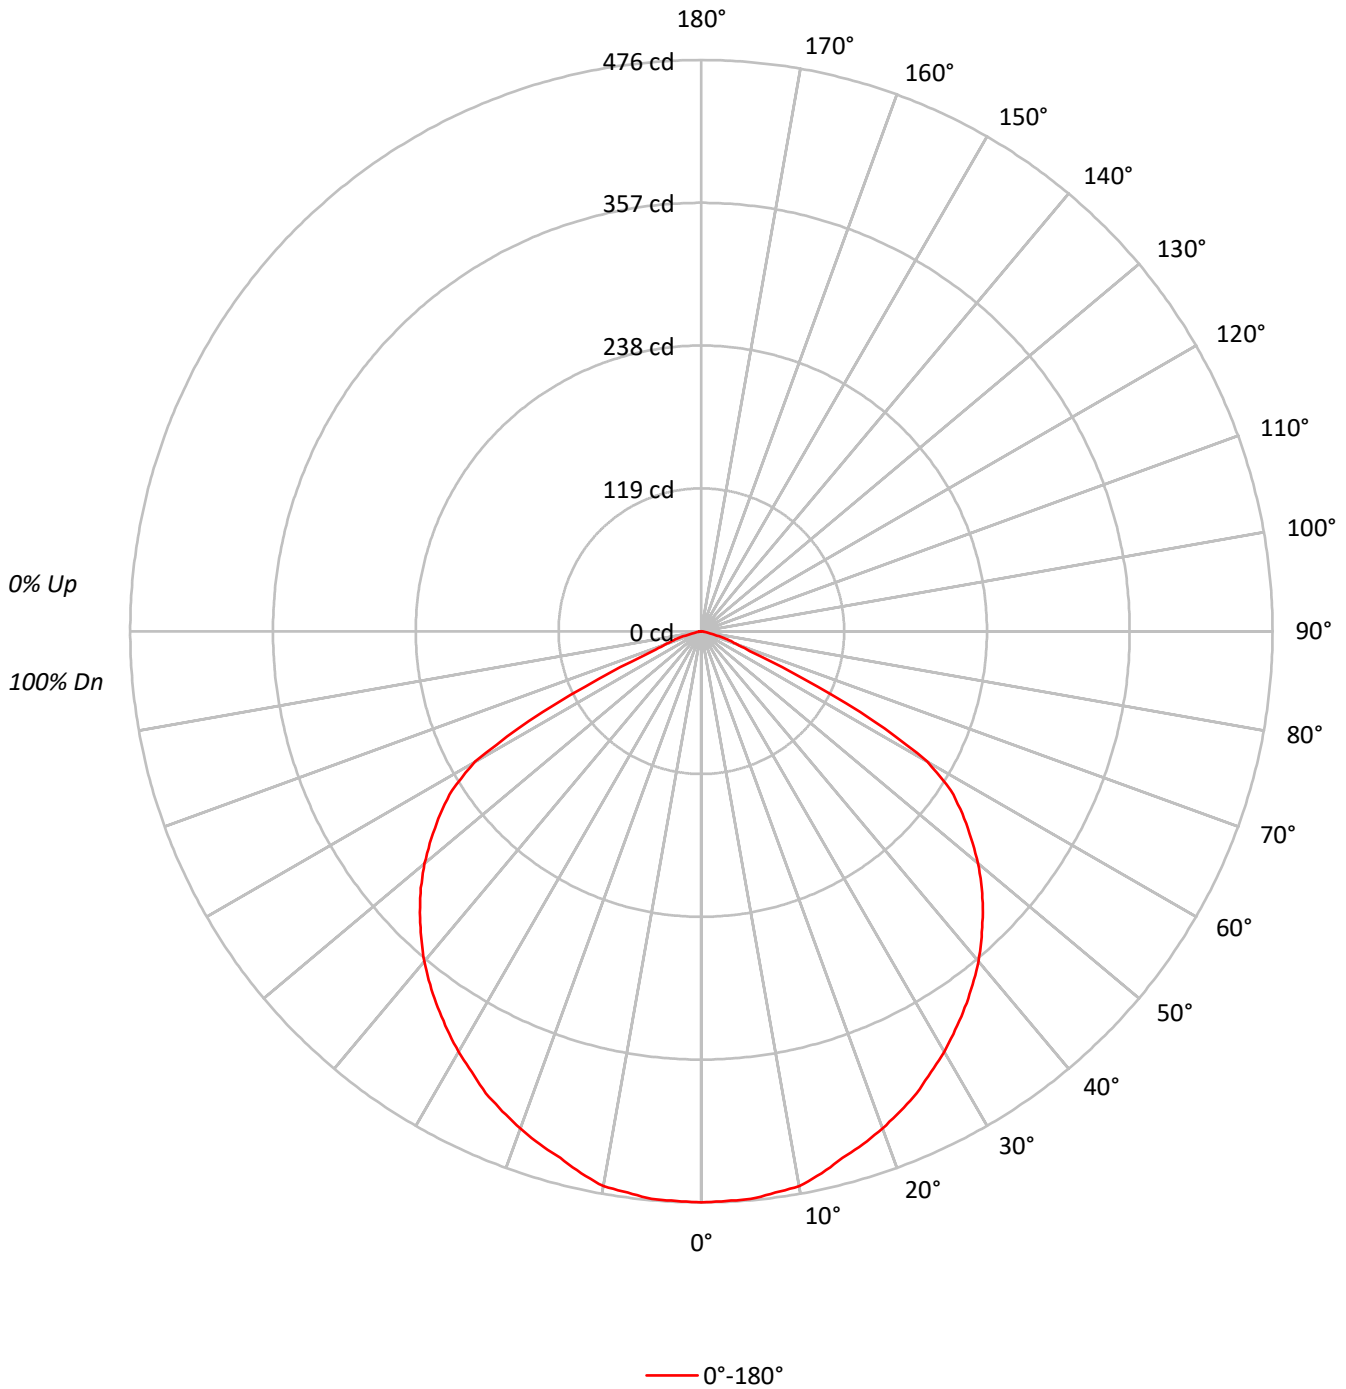



TEST NUMBER: P979901

CATALOG NUMBER: PRLX-242-927-12L-C-U-S-WHTE-X

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	111	107	103	100	108	104	101	98	100	98	95	96	94	92	93	91	90	88
2	102	95	89	84	99	93	87	83	89	85	81	86	82	79	83	80	77	75
3	93	84	76	71	91	82	75	70	79	74	69	77	72	68	74	70	66	64
4	86	75	67	60	83	73	66	60	71	64	59	69	63	58	67	62	58	56
5	79	67	58	52	77	66	58	52	64	57	51	62	56	51	60	55	50	48
6	73	60	52	46	71	59	51	45	57	50	45	56	49	45	54	49	44	42
7	68	55	46	40	66	54	46	40	52	45	40	51	44	40	49	44	39	37
8	63	50	42	36	61	49	41	36	48	41	36	47	40	35	45	40	35	33
9	59	46	38	32	57	45	37	32	44	37	32	43	36	32	42	36	32	30
10	55	42	34	29	54	42	34	29	41	34	29	40	33	29	39	33	29	27

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	2130
5°	2134
10°	2134
15°	2106
20°	2101
25°	2098
30°	2092
35°	2092
40°	2099
45°	2100
50°	2096
55°	2071
60°	1948
65°	996
70°	402
75°	188
80°	36
85°	56

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 2100 cd/sqm

TEST NUMBER: P979901

CATALOG NUMBER: PRLX-242-927-12L-C-U-S-WHTE-X

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	45.1	3.7
10°-20°	128.6	10.5
20°-30°	195.7	16.0
30°-40°	239.8	19.7
40°-50°	255.8	21.0
50°-60°	235.9	19.3
60°-70°	103.8	8.5
70°-80°	13.9	1.1
80°-90°	1.1	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
<hr/>		
0°-30°	369.4	30.3
0°-40°	609.1	49.9
0°-60°	1100.9	90.3
0°-90°	1219.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1219.7	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	476	
5°	475	45
15°	454	129
25°	425	196
35°	383	240
45°	332	256
55°	266	236
65°	94	104
75°	11	14
85°	1	1
90°	0	

TEST NUMBER: P979901

CATALOG NUMBER: PRLX-242-927-12L-C-U-S-WHTE-X

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	476.0
2.5°	475.3
5°	475.0
7.5°	471.8
10°	469.7
12.5°	462.6
15°	454.5
17.5°	448.2
20°	441.1
22.5°	433.0
25°	424.9
27.5°	414.3
30°	404.8
32.5°	393.9
35°	382.9
37.5°	371.3
40°	359.3
42.5°	345.6
45°	331.8
47.5°	317.0
50°	301.1
52.5°	283.5
55°	265.5
57.5°	246.5
60°	217.6
62.5°	161.8
65°	94.1
67.5°	43.7
70°	30.7
72.5°	22.9
75°	10.9
77.5°	3.2
80°	1.4
82.5°	1.4
85°	1.1
87.5°	0.7
90°	0.0



TEST NUMBER: P979901  
 CATALOG NUMBER: PRLX-242-927-12L-C-U-S-WHTE-X

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	15.47	17.02	15.83	17.33	17.64	15.47	17.02	15.83	17.33	17.64
	3H	15.51	16.89	15.89	17.22	17.58	15.51	16.89	15.89	17.22	17.58
	4H	15.48	16.76	15.88	17.11	17.49	15.48	16.76	15.88	17.11	17.49
	6H	15.42	16.60	15.83	16.97	17.36	15.42	16.60	15.83	16.97	17.36
	8H	15.38	16.51	15.81	16.90	17.30	15.38	16.51	15.81	16.90	17.30
	12H	15.35	16.43	15.78	16.81	17.24	15.35	16.43	15.78	16.81	17.24
4H	2H	15.56	16.85	15.96	17.19	17.57	15.56	16.85	15.96	17.19	17.57
	3H	15.65	16.70	16.06	17.10	17.50	15.65	16.70	16.06	17.10	17.50
	4H	15.61	16.55	16.05	16.96	17.40	15.61	16.55	16.05	16.96	17.40
	6H	15.56	16.36	16.02	16.81	17.27	15.56	16.36	16.02	16.81	17.27
	8H	15.51	16.27	15.98	16.71	17.18	15.51	16.27	15.98	16.71	17.18
	12H	15.48	16.15	15.96	16.63	17.10	15.48	16.15	15.96	16.63	17.10
8H	4H	15.53	16.28	15.99	16.72	17.19	15.53	16.28	15.99	16.72	17.19
	6H	15.45	16.06	15.95	16.56	17.03	15.45	16.06	15.95	16.56	17.03
	8H	15.40	15.95	15.91	16.46	16.95	15.40	15.95	15.91	16.46	16.95
	12H	15.36	15.85	15.87	16.35	16.91	15.36	15.85	15.87	16.35	16.91
12H	4H	15.49	16.16	15.98	16.64	17.11	15.49	16.16	15.98	16.64	17.11
	6H	15.39	15.95	15.91	16.46	16.95	15.39	15.95	15.91	16.46	16.95
	8H	15.36	15.85	15.87	16.34	16.91	15.36	15.85	15.87	16.34	16.91