

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P979990

Luminaire Tested: PRLX-242-930-18L-C-U-S-BLAK-X

Issue Date: 4/3/2025

Test Information

Test Method: LM-79-2019
Report Number: P979990
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2502-353-26)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 4/3/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-242-930-18L-C-U-S-BLAK-X
Description: 3D PRINTED LUMINAIRE, INTEGRAL LED LIGHT ENGINE, BLACK 242 SHADE WITH CLEAR LENS
Light Source: 3000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1826.6 lumens
Efficiency: N/A
Efficacy: 166.1 lumens/watt
Spacing Criteria (0/90/45): 1.26 / 1.26 / 1.39
Luminous Opening: Circular (Dia: 1.75' x H: 0')
CIE Type: Direct

Input Watts (W): 11
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P979990

CATALOG NUMBER: PRLX-242-930-18L-C-U-S-BLAK-X

Luminous Intensity Polar Plot

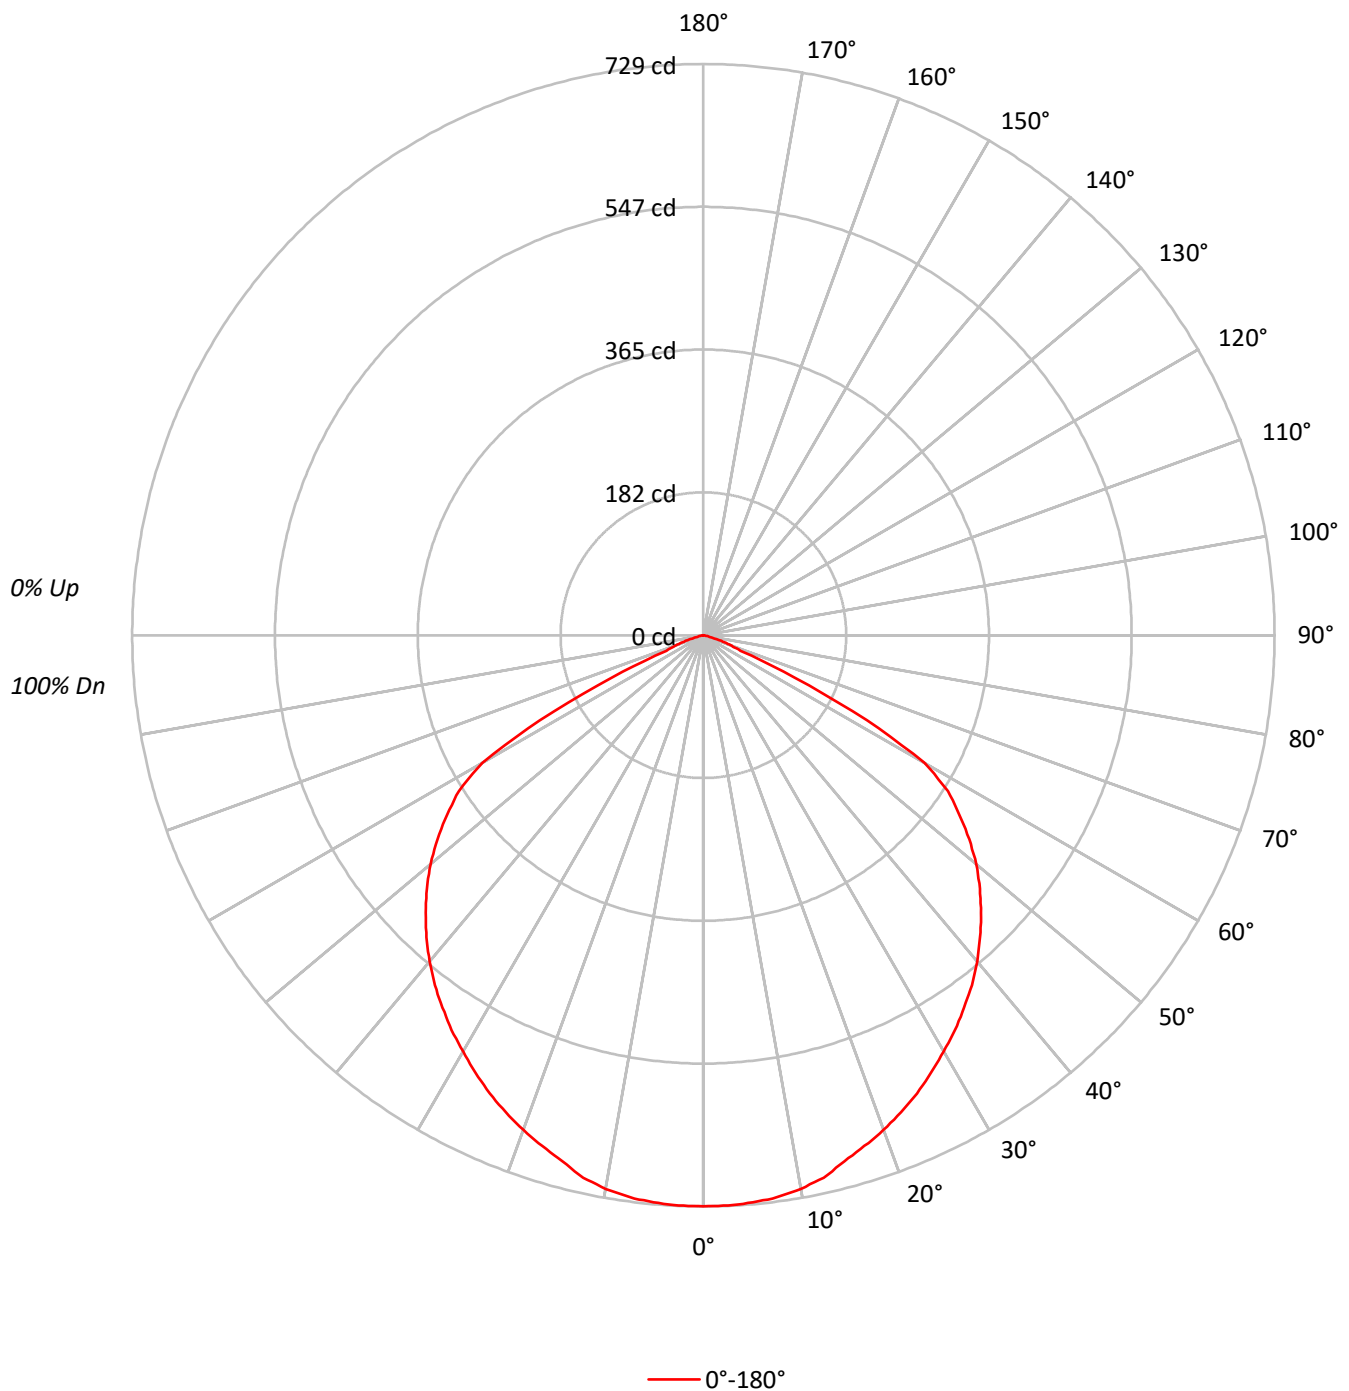

TEST NUMBER: P979990

CATALOG NUMBER: PRLX-242-930-18L-C-U-S-BLAK-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		0
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		100
1	111	107	103	100	108	105	102	99	101	98	96		97	95	93		88
2	102	95	89	84	100	93	88	83	90	85	81		86	83	79		76
3	94	84	77	71	91	83	76	71	80	74	69		77	72	68		65
4	86	75	67	61	84	74	66	61	71	65	60		69	63	59		56
5	79	67	59	53	77	66	58	52	64	57	52		62	56	51		49
6	73	61	52	46	71	60	52	46	58	51	46		56	50	45		43
7	68	55	47	41	66	54	46	41	53	46	40		51	45	40		38
8	63	50	42	36	62	49	42	36	48	41	36		47	41	36		34
9	59	46	38	33	58	45	38	33	44	37	32		43	37	32		30
10	55	42	35	30	54	42	35	30	41	34	29		40	34	29		27

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	3262
5°	3264
10°	3260
15°	3220
20°	3201
25°	3186
30°	3171
35°	3170
40°	3176
45°	3171
50°	3165
55°	3112
60°	2915
65°	1360
70°	458
75°	142
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3171 cd/sqm

TEST NUMBER: P979990

CATALOG NUMBER: PRLX-242-930-18L-C-U-S-BLAK-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	69.1	3.8
10°-20°	196.5	10.8
20°-30°	297.4	16.3
30°-40°	363.4	19.9
40°-50°	386.6	21.2
50°-60°	354.8	19.4
60°-70°	145.6	8.0
70°-80°	13.1	0.7
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	563.0	30.8
0°-40°	926.4	50.7
0°-60°	1667.9	91.3
0°-90°	1826.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1826.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	729	
5°	727	69
15°	695	197
25°	645	297
35°	580	363
45°	501	387
55°	399	355
65°	128	146
75°	8	13
85°	0	0
90°	0	

TEST NUMBER: P979990

CATALOG NUMBER: PRLX-242-930-18L-C-U-S-BLAK-X

CANDELA DISTRIBUTION (FULL):

0°	
0°	728.9
2.5°	728.4
5°	726.7
7.5°	723.5
10°	717.4
12.5°	709.2
15°	695.0
17.5°	683.6
20°	672.1
22.5°	659.0
25°	645.3
27.5°	629.5
30°	613.6
32.5°	597.8
35°	580.3
37.5°	562.8
40°	543.7
42.5°	522.9
45°	501.1
47.5°	478.7
50°	454.6
52.5°	427.8
55°	398.9
57.5°	369.9
60°	325.7
62.5°	235.0
65°	128.4
67.5°	51.4
70°	35.0
72.5°	24.0
75°	8.2
77.5°	0.5
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

TEST NUMBER: P979990

CATALOG NUMBER: PRLX-242-930-18L-C-U-S-BLAK-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	16.90	18.43	17.26	18.75	19.06	16.90	18.43	17.26	18.75	19.06
	3H	16.88	18.25	17.26	18.57	18.94	16.88	18.25	17.26	18.57	18.94
	4H	16.83	18.10	17.23	18.45	18.83	16.83	18.10	17.23	18.45	18.83
	6H	16.77	17.94	17.18	18.31	18.70	16.77	17.94	17.18	18.31	18.70
	8H	16.73	17.85	17.16	18.24	18.64	16.73	17.85	17.16	18.24	18.64
	12H	16.70	17.76	17.13	18.15	18.58	16.70	17.76	17.13	18.15	18.58
4H	2H	16.95	18.22	17.35	18.57	18.95	16.95	18.22	17.35	18.57	18.95
	3H	16.97	18.00	17.38	18.40	18.80	16.97	18.00	17.38	18.40	18.80
	4H	16.91	17.83	17.34	18.24	18.68	16.91	17.83	17.34	18.24	18.68
	6H	16.85	17.64	17.31	18.08	18.55	16.85	17.64	17.31	18.08	18.55
	8H	16.80	17.54	17.27	17.99	18.45	16.80	17.54	17.27	17.99	18.45
	12H	16.77	17.42	17.25	17.90	18.38	16.77	17.42	17.25	17.90	18.38
8H	4H	16.81	17.55	17.27	17.99	18.46	16.81	17.55	17.27	17.99	18.46
	6H	16.72	17.33	17.22	17.82	18.30	16.72	17.33	17.22	17.82	18.30
	8H	16.67	17.21	17.18	17.73	18.22	16.67	17.21	17.18	17.73	18.22
	12H	16.63	17.12	17.14	17.61	18.18	16.63	17.12	17.14	17.61	18.18
12H	4H	16.77	17.43	17.26	17.91	18.38	16.77	17.43	17.26	17.91	18.38
	6H	16.67	17.21	17.18	17.73	18.22	16.67	17.21	17.18	17.73	18.22
	8H	16.63	17.12	17.14	17.61	18.18	16.63	17.12	17.14	17.61	18.18

END OF REPORT

FIELD PERFORMANCE MAY DIFFER FROM LABORATORY PERFORMANCE

7 of 7