

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P980122

Luminaire Tested: PRLX-242-935-62L-F-U-S-BLAK-X

Issue Date: 4/3/2025

Test Information

Test Method: LM-79-2019
Report Number: P980122
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2502-353-27)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 4/3/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-242-935-62L-F-U-S-BLAK-X
Description: 3D PRINTED LUMINAIRE, INTEGRAL LED LIGHT ENGINE, BLACK 242 SHADE WITH FROSTED LENS
Light Source: 3500K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6084.8 lumens
Efficiency: N/A
Efficacy: 126.8 lumens/watt
Spacing Criteria (0/90/45): 1.21 / 1.21 / 1.33
Luminous Opening: Circular (Dia: 1.75' x H: 0')
CIE Type: Direct

Input Watts (W): 48
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P980122

CATALOG NUMBER: PRLX-242-935-62L-F-U-S-BLAK-X

Luminous Intensity Polar Plot

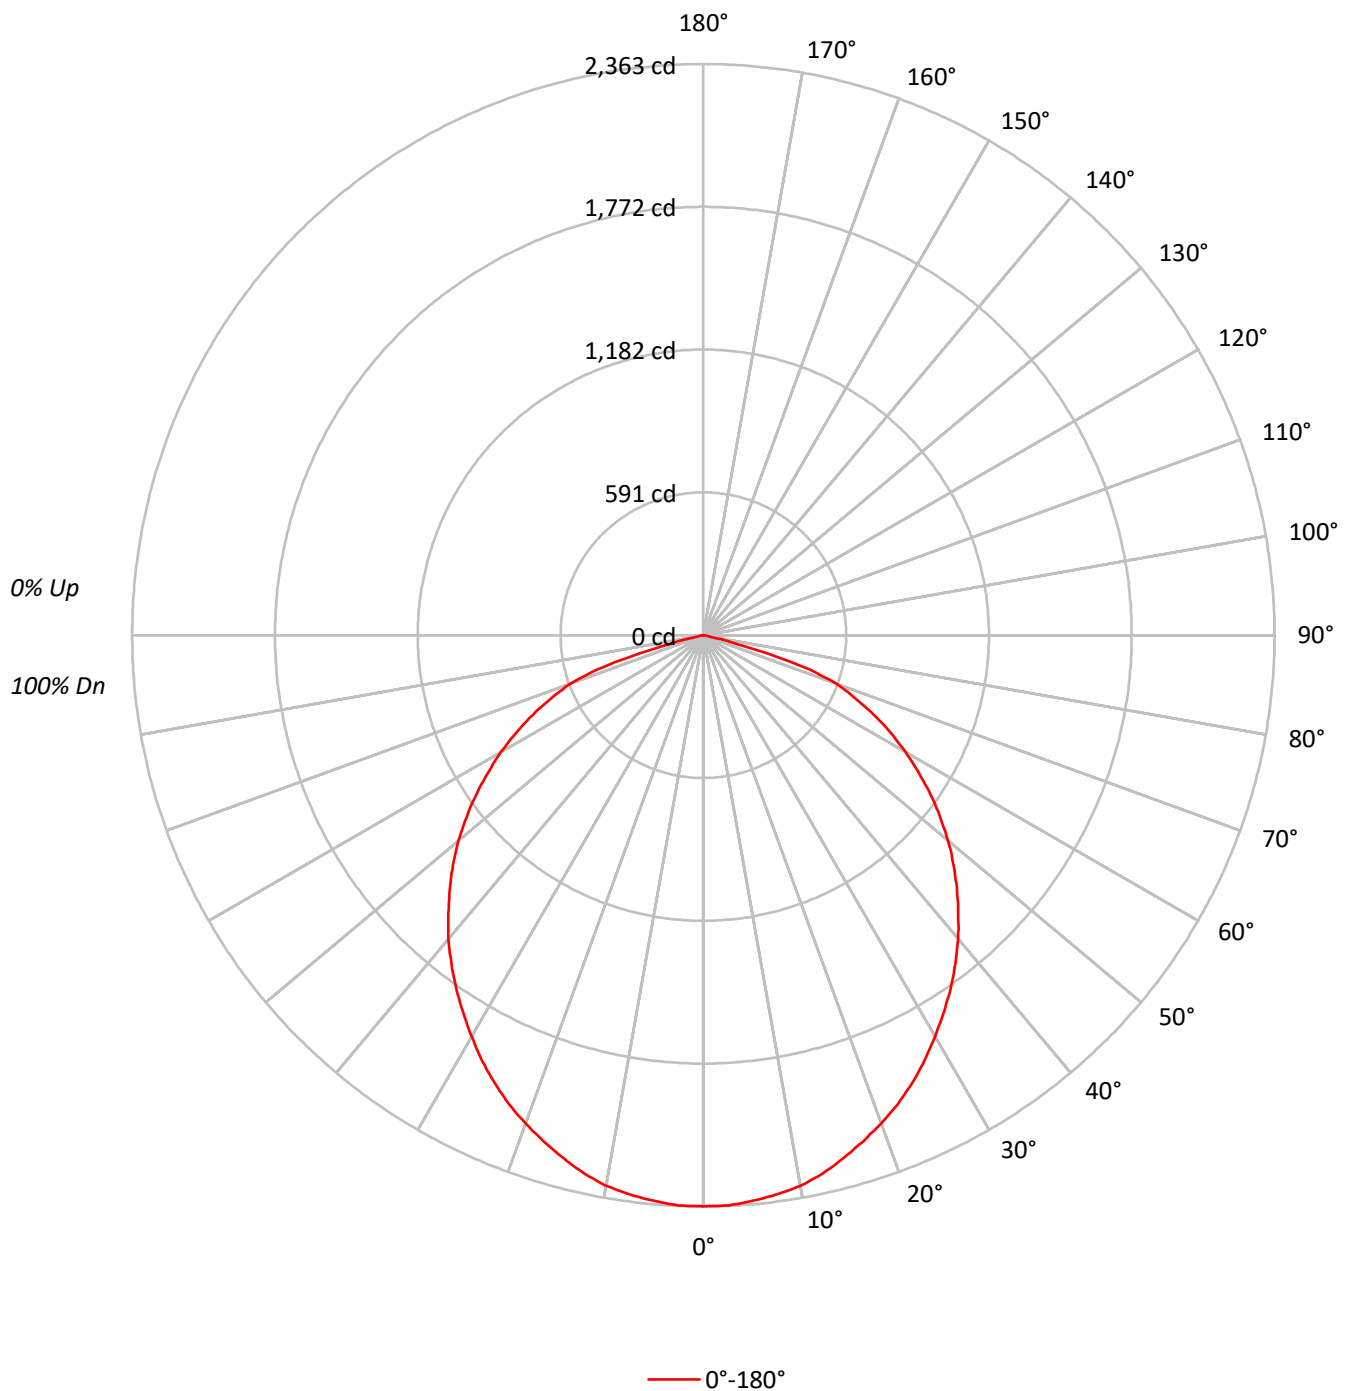

TEST NUMBER: P980122

CATALOG NUMBER: PRLX-242-935-62L-F-U-S-BLAK-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		0
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		100
1	110	106	102	98	107	103	100	97	99	96	94		95	93	91		86
2	100	93	86	81	98	91	85	80	87	83	78		84	80	77		73
3	92	82	74	68	89	80	73	67	77	71	66		75	69	65		62
4	84	73	64	58	82	71	63	57	69	62	57		67	61	56		53
5	77	65	56	50	75	64	56	50	62	55	49		60	53	48		46
6	72	59	50	44	70	58	49	43	56	48	43		54	48	43		40
7	66	53	44	38	65	52	44	38	51	43	38		49	43	38		36
8	62	48	40	34	60	48	40	34	46	39	34		45	39	34		32
9	58	44	36	31	56	44	36	31	43	36	31		42	35	31		29
10	54	41	33	28	53	41	33	28	40	33	28		39	32	28		26

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	10575
5°	10552
10°	10512
15°	10376
20°	10239
25°	10095
30°	9906
35°	9745
40°	9582
45°	9386
50°	9202
55°	8946
60°	8641
65°	8242
70°	7632
75°	2995
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 9386 cd/sqm

TEST NUMBER: P980122

CATALOG NUMBER: PRLX-242-935-62L-F-U-S-BLAK-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	223.1	3.7
10°-20°	631.7	10.4
20°-30°	941.2	15.5
30°-40°	1115.4	18.3
40°-50°	1144.4	18.8
50°-60°	1024.1	16.8
60°-70°	768.2	12.6
70°-80°	236.6	3.9
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1796.0	29.5
0°-40°	2911.4	47.8
0°-60°	5079.9	83.5
0°-90°	6084.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6084.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2363	
5°	2349	223
15°	2240	632
25°	2044	941
35°	1784	1115
45°	1483	1144
55°	1147	1024
65°	778	768
75°	173	237
85°	0	0
90°	0	

TEST NUMBER: P980122

CATALOG NUMBER: PRLX-242-935-62L-F-U-S-BLAK-X

CANDELA DISTRIBUTION (FULL):

0°	
0°	2363.0
2.5°	2361.0
5°	2349.0
7.5°	2333.1
10°	2313.2
12.5°	2281.3
15°	2239.5
17.5°	2195.7
20°	2150.0
22.5°	2100.2
25°	2044.5
27.5°	1982.7
30°	1917.0
32.5°	1849.4
35°	1783.7
37.5°	1712.0
40°	1640.3
42.5°	1560.7
45°	1483.1
47.5°	1403.4
50°	1321.8
52.5°	1234.2
55°	1146.6
57.5°	1055.1
60°	965.5
62.5°	871.9
65°	778.4
67.5°	680.8
70°	583.3
72.5°	432.0
75°	173.2
77.5°	8.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

TEST NUMBER: P980122

CATALOG NUMBER: PRLX-242-935-62L-F-U-S-BLAK-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	19.95	21.54	20.31	21.85	22.17	19.95	21.54	20.31	21.85	22.17
	3H	21.70	23.13	22.08	23.45	23.81	21.70	23.13	22.08	23.45	23.81
	4H	21.90	23.24	22.29	23.58	23.96	21.90	23.24	22.29	23.58	23.96
	6H	21.84	23.07	22.25	23.44	23.83	21.84	23.07	22.25	23.44	23.83
	8H	21.80	22.98	22.23	23.37	23.77	21.80	22.98	22.23	23.37	23.77
	12H	21.77	22.90	22.20	23.28	23.71	21.77	22.90	22.20	23.28	23.71
4H	2H	20.58	21.92	20.98	22.27	22.65	20.58	21.92	20.98	22.27	22.65
	3H	22.50	23.61	22.91	24.01	24.41	22.50	23.61	22.91	24.01	24.41
	4H	22.68	23.68	23.11	24.09	24.53	22.68	23.68	23.11	24.09	24.53
	6H	22.63	23.49	23.09	23.93	24.39	22.63	23.49	23.09	23.93	24.39
	8H	22.59	23.39	23.05	23.84	24.30	22.59	23.39	23.05	23.84	24.30
	12H	22.57	23.28	23.05	23.76	24.23	22.57	23.28	23.05	23.76	24.23
8H	4H	22.72	23.52	23.18	23.96	24.43	22.72	23.52	23.18	23.96	24.43
	6H	22.65	23.30	23.15	23.79	24.27	22.65	23.30	23.15	23.79	24.27
	8H	22.61	23.19	23.12	23.70	24.19	22.61	23.19	23.12	23.70	24.19
	12H	22.58	23.09	23.09	23.58	24.15	22.58	23.09	23.09	23.58	24.15
12H	4H	22.69	23.41	23.17	23.88	24.35	22.69	23.41	23.17	23.88	24.35
	6H	22.60	23.19	23.12	23.70	24.19	22.60	23.19	23.12	23.70	24.19
	8H	22.58	23.09	23.09	23.58	24.15	22.58	23.09	23.09	23.58	24.15

END OF REPORT