

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2024 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P980252

Luminaire Tested: PRLX-243-927-LL4-F-U-S-BLAK-X

Issue Date: 4/3/2025

**Test Information**

Test Method: LM-79-2024  
Report Number: P980252  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2502-353-37)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 4/3/2025  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PrentaLux  
Catalog Number: PRLX-243-927-LL4-F-U-S-BLAK-X  
Description: 3D PRINTED LUMINAIRE, INTEGRAL LED LIGHT ENGINE, BLACK 243 SHADE WITH FROSTED LENS  
Light Source: 2700K CCT, 90 CRI LEDS  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 2012.7 lumens  
Efficiency: N/A  
Efficacy: 98.2 lumens/watt  
Spacing Criteria (0/90/45): 1.17 / 1.17 / 1.31  
Luminous Opening: Circular (Dia: 1.67' x H: 0')  
CIE Type: Direct

Input Watts (W): 20.5  
Input Voltage (V): 120  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



TEST NUMBER: P980252  
CATALOG NUMBER: PRLX-243-927-LL4-F-U-S-BLAK-X

### Luminous Intensity Polar Plot

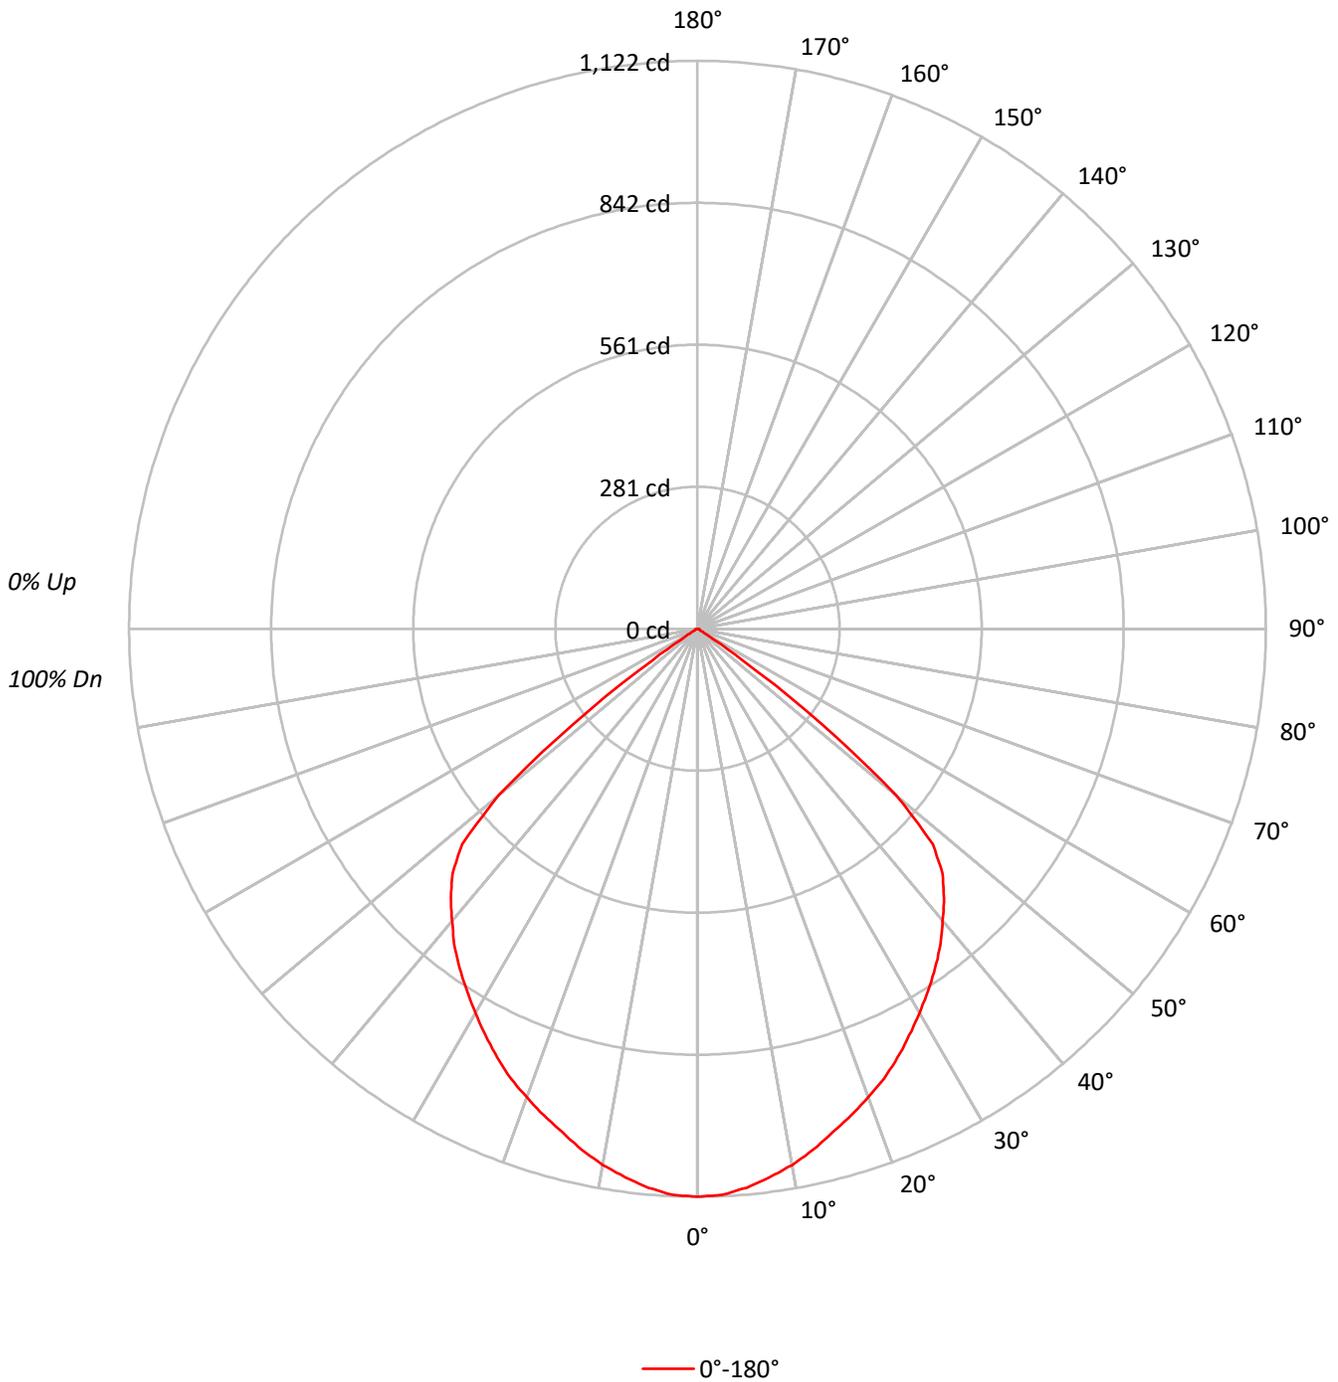



TEST NUMBER: P980252

CATALOG NUMBER: PRLX-243-927-LL4-F-U-S-BLAK-X

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	112	109	106	103	110	107	104	102	103	100	98	99	97	95	95	94	93	91
2	105	99	94	90	103	97	93	89	94	90	87	91	88	85	88	85	83	81
3	98	90	84	79	96	88	83	78	86	81	77	83	79	76	81	77	74	73
4	91	82	75	70	89	80	74	69	78	73	68	76	71	67	74	70	67	65
5	85	74	67	62	83	73	67	62	71	66	61	70	64	60	68	63	60	58
6	79	68	61	55	77	67	60	55	66	59	55	64	58	54	63	58	54	52
7	74	62	55	50	72	62	55	50	60	54	49	59	53	49	58	53	49	47
8	69	57	50	45	68	57	50	45	56	49	45	54	49	44	53	48	44	43
9	65	53	46	41	64	52	46	41	51	45	41	50	45	40	49	44	40	39
10	61	49	42	37	60	49	42	37	48	41	37	47	41	37	46	41	37	35

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	5536
5°	5490
10°	5388
15°	5261
20°	5173
25°	5089
30°	4993
35°	4927
40°	4851
45°	4772
50°	3925
55°	926
60°	54
65°	54
70°	66
75°	71
80°	51
85°	51

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 4772 cd/sqm

TEST NUMBER: P980252

CATALOG NUMBER: PRLX-243-927-LL4-F-U-S-BLAK-X

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	104.7	5.2
10°-20°	290.8	14.5
20°-30°	430.6	21.4
30°-40°	511.8	25.4
40°-50°	514.0	25.5
50°-60°	151.4	7.5
60°-70°	4.7	0.2
70°-80°	3.5	0.2
80°-90°	1.2	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	826.1	41.0
0°-40°	1337.9	66.5
0°-60°	2003.3	99.5
0°-90°	2012.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2012.7	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1122	
5°	1108	105
15°	1030	291
25°	935	431
35°	818	512
45°	684	514
55°	108	151
65°	5	5
75°	4	4
85°	1	1
90°	0	



TEST NUMBER: P980252

CATALOG NUMBER: PRLX-243-927-LL4-F-U-S-BLAK-X

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	1122.1
2.5°	1119.4
5°	1108.4
7.5°	1092.9
10°	1075.5
12.5°	1054.5
15°	1029.9
17.5°	1008.0
20°	985.2
22.5°	962.3
25°	934.9
27.5°	905.7
30°	876.5
32.5°	847.3
35°	818.1
37.5°	787.9
40°	753.2
42.5°	720.4
45°	683.9
47.5°	630.0
50°	511.3
52.5°	308.6
55°	107.7
57.5°	21.0
60°	5.5
62.5°	4.6
65°	4.6
67.5°	4.6
70°	4.6
72.5°	3.7
75°	3.7
77.5°	2.7
80°	1.8
82.5°	1.8
85°	0.9
87.5°	0.9
90°	0.0



TEST NUMBER: P980252  
 CATALOG NUMBER: PRLX-243-927-LL4-F-U-S-BLAK-X

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
4H	2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
8H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
12H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00