

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2024 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P980360

Luminaire Tested: PRLX-243-930-LL7-C-U-S-BLAK-X

Issue Date: 4/3/2025

Test Information

Test Method: LM-79-2024
Report Number: P980360
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2502-353-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 4/3/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-243-930-LL7-C-U-S-BLAK-X
Description: 3D PRINTED LUMINAIRE, INTEGRAL LED LIGHT ENGINE, BLACK 243 SHADE WITH CLEAR LENS
Light Source: 3000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4726.3 lumens
Efficiency: N/A
Efficacy: 98.5 lumens/watt
Spacing Criteria (0/90/45): 1.18 / 1.18 / 1.34
Luminous Opening: Circular (Dia: 1.67' x H: 0')
CIE Type: Direct

Input Watts (W): 48
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P980360
CATALOG NUMBER: PRLX-243-930-LL7-C-U-S-BLAK-X

Luminous Intensity Polar Plot

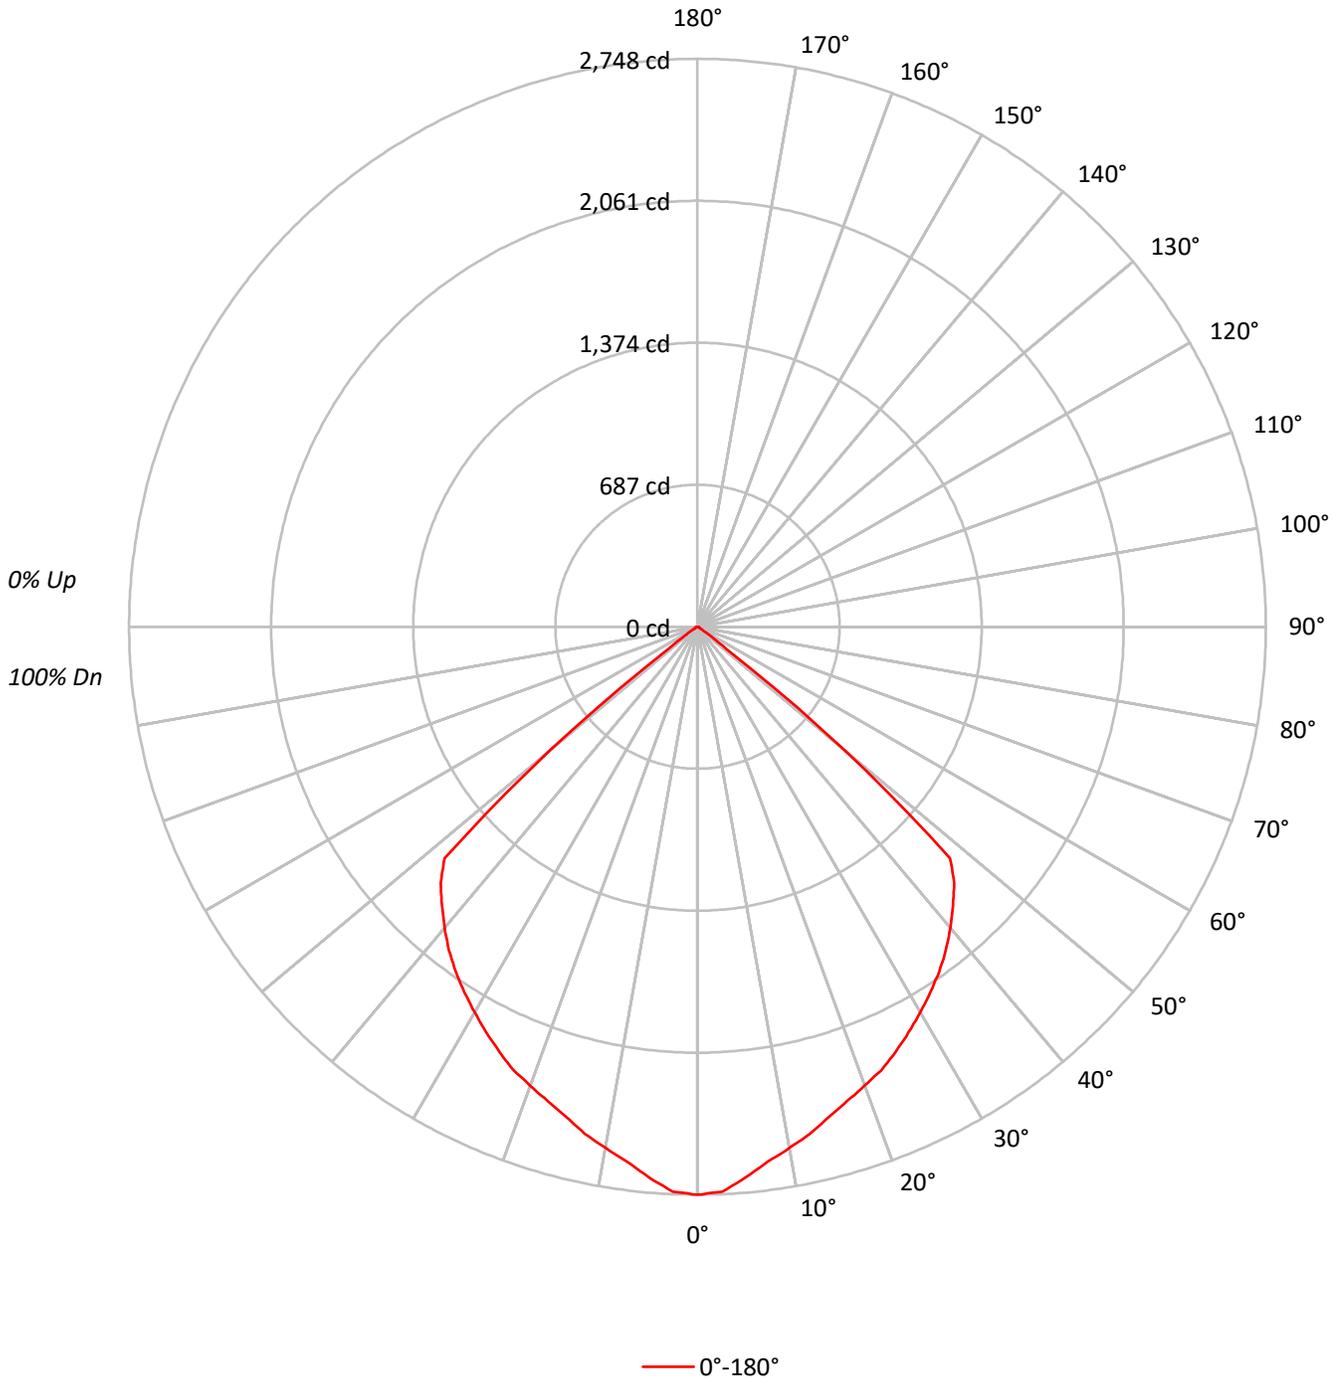



TEST NUMBER: P980360

CATALOG NUMBER: PRLX-243-930-LL7-C-U-S-BLAK-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	112	109	106	104	110	107	104	102	103	101	99	99	97	96	96	94	93	91
2	105	99	95	91	103	98	93	89	94	91	88	91	88	86	88	86	84	82
3	98	91	85	80	96	89	84	79	86	82	78	84	80	77	82	78	75	74
4	92	83	76	71	90	81	75	70	79	74	69	77	72	69	75	71	68	66
5	86	75	68	63	84	74	68	63	73	67	62	71	66	62	69	65	61	59
6	80	69	62	57	78	68	61	56	67	61	56	65	60	56	64	59	55	53
7	75	63	56	51	73	63	56	51	61	55	51	60	54	50	59	54	50	48
8	70	58	51	46	69	58	51	46	57	50	46	55	50	46	54	49	45	44
9	66	54	47	42	64	53	47	42	52	46	42	51	46	42	50	45	41	40
10	62	50	43	38	61	50	43	38	49	43	38	48	42	38	47	42	38	36

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	13557
5°	13246
10°	12829
15°	12539
20°	12403
25°	12346
30°	12273
35°	12267
40°	12249
45°	12248
50°	7099
55°	630
60°	95
65°	112
70°	138
75°	147
80°	111
85°	108

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 12248 cd/sqm

TEST NUMBER: P980360

CATALOG NUMBER: PRLX-243-930-LL7-C-U-S-BLAK-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	251.6	5.3
10°-20°	694.1	14.7
20°-30°	1045.5	22.1
30°-40°	1274.4	27.0
40°-50°	1280.8	27.1
50°-60°	159.9	3.4
60°-70°	9.5	0.2
70°-80°	7.9	0.2
80°-90°	2.6	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1991.2	42.1
0°-40°	3265.6	69.1
0°-60°	4706.3	99.6
0°-90°	4726.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4726.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2748	
5°	2674	252
15°	2455	694
25°	2268	1046
35°	2037	1274
45°	1755	1281
55°	73	160
65°	10	10
75°	8	8
85°	2	3
90°	0	

TEST NUMBER: P980360

CATALOG NUMBER: PRLX-243-930-LL7-C-U-S-BLAK-X

CANDELA DISTRIBUTION (FULL):

0°	
0°	2747.7
2.5°	2736.1
5°	2674.5
7.5°	2610.9
10°	2560.8
12.5°	2512.6
15°	2454.8
17.5°	2406.6
20°	2362.3
22.5°	2321.9
25°	2267.9
27.5°	2212.0
30°	2154.2
32.5°	2096.4
35°	2036.7
37.5°	1973.1
40°	1901.8
42.5°	1828.6
45°	1755.4
47.5°	1657.1
50°	924.9
52.5°	175.3
55°	73.2
57.5°	23.1
60°	9.6
62.5°	9.6
65°	9.6
67.5°	9.6
70°	9.6
72.5°	9.6
75°	7.7
77.5°	5.8
80°	3.9
82.5°	3.9
85°	1.9
87.5°	1.9
90°	0.0



TEST NUMBER: P980360
 CATALOG NUMBER: PRLX-243-930-LL7-C-U-S-BLAK-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
4H	2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
8H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
12H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00