

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P980410

Luminaire Tested: PRLX-243-935-31L-C-U-S-BLAK-X

Issue Date: 4/3/2025

Test Information

Test Method: LM-79-2019
Report Number: P980410
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2502-353-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 4/3/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-243-935-31L-C-U-S-BLAK-X
Description: 3D PRINTED LUMINAIRE, INTEGRAL LED LIGHT ENGINE, BLACK 243 SHADE WITH CLEAR LENS
Light Source: 3500K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 2452.9 lumens
Efficiency: N/A
Efficacy: 120.2 lumens/watt
Spacing Criteria (0/90/45): 1.18 / 1.18 / 1.34
Luminous Opening: Circular (Dia: 1.67' x H: 0')
CIE Type: Direct

Input Watts (W): 20.4
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P980410

CATALOG NUMBER: PRLX-243-935-31L-C-U-S-BLAK-X

Luminous Intensity Polar Plot

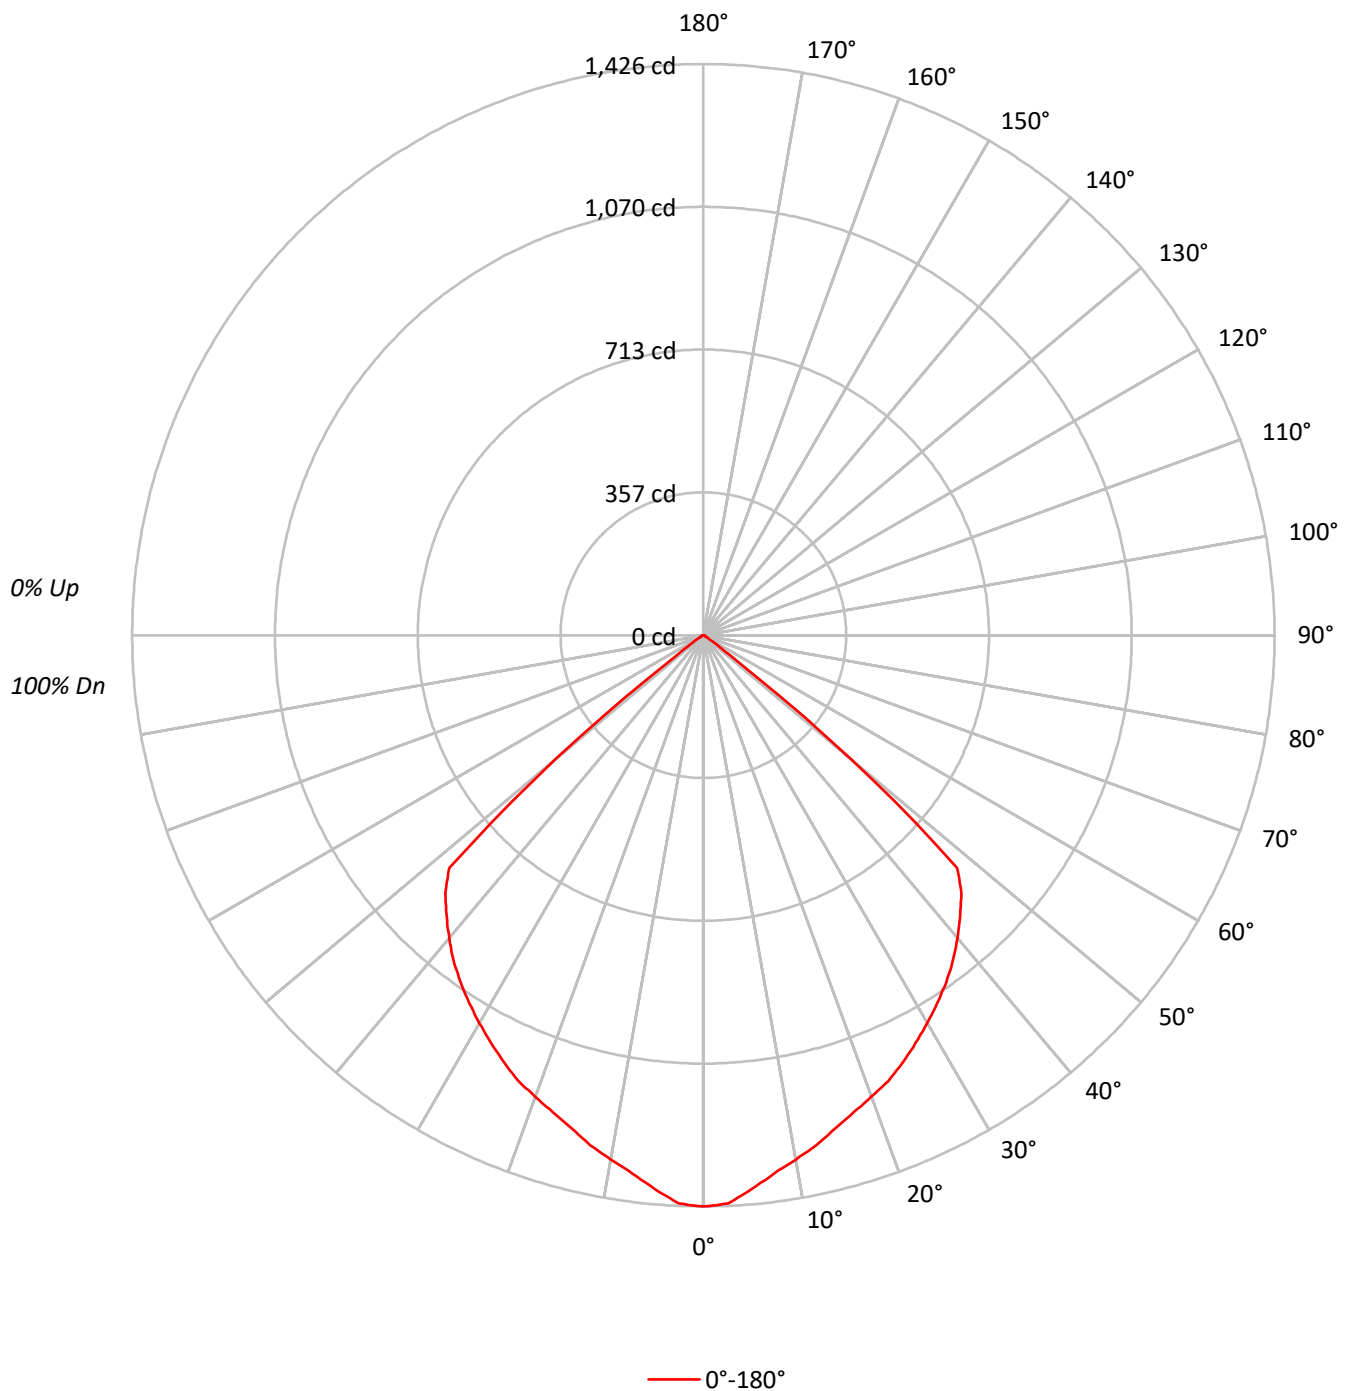

TEST NUMBER: P980410

CATALOG NUMBER: PRLX-243-935-31L-C-U-S-BLAK-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	112	109	106	104	110	107	104	102	103	101	99		99	97	96		96
2	105	99	95	91	103	98	93	89	94	91	88		91	88	86		88
3	98	91	85	80	96	89	84	79	86	82	78		84	80	77		82
4	92	83	76	71	90	81	75	70	79	74	69		77	72	69		75
5	86	75	68	63	84	74	68	63	73	67	62		71	66	62		69
6	80	69	62	57	78	68	61	56	67	61	56		65	60	56		64
7	75	63	56	51	73	63	56	51	61	55	51		60	54	50		59
8	70	58	51	46	69	58	51	46	57	50	46		55	50	46		54
9	66	54	47	42	64	53	47	42	52	46	42		51	46	42		50
10	62	50	43	38	61	50	43	38	49	43	38		48	42	38		47

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	7036
5°	6874
10°	6658
15°	6507
20°	6437
25°	6407
30°	6369
35°	6366
40°	6357
45°	6356
50°	3684
55°	327
60°	49
65°	58
70°	72
75°	76
80°	57
85°	57

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 6356 cd/sqm

TEST NUMBER: P980410

CATALOG NUMBER: PRLX-243-935-31L-C-U-S-BLAK-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	130.6	5.3
10°-20°	360.2	14.7
20°-30°	542.6	22.1
30°-40°	661.4	27.0
40°-50°	664.7	27.1
50°-60°	83.0	3.4
60°-70°	5.0	0.2
70°-80°	4.1	0.2
80°-90°	1.4	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1033.4	42.1
0°-40°	1694.8	69.1
0°-60°	2442.5	99.6
0°-90°	2452.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2452.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1426	
5°	1388	131
15°	1274	360
25°	1177	543
35°	1057	661
45°	911	665
55°	38	83
65°	5	5
75°	4	4
85°	1	1
90°	0	

TEST NUMBER: P980410

CATALOG NUMBER: PRLX-243-935-31L-C-U-S-BLAK-X

CANDELA DISTRIBUTION (FULL):

0°	
0°	1426
2.5°	1420
5°	1388
7.5°	1355
10°	1329
12.5°	1304
15°	1274
17.5°	1249
20°	1226
22.5°	1205
25°	1177
27.5°	1148
30°	1118
32.5°	1088
35°	1057
37.5°	1024
40°	987
42.5°	949
45°	911
47.5°	860
50°	480
52.5°	91
55°	38
57.5°	12
60°	5
62.5°	5
65°	5
67.5°	5
70°	5
72.5°	5
75°	4
77.5°	3
80°	2
82.5°	2
85°	1
87.5°	1
90°	0

TEST NUMBER: P980410

CATALOG NUMBER: PRLX-243-935-31L-C-U-S-BLAK-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
4H	2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
8H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
12H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

END OF REPORT