

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2024 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P980402

Luminaire Tested: PRLX-243-935-LL3-F-U-S-BLAK-X

Issue Date: 4/3/2025

**Test Information**

Test Method: LM-79-2024  
Report Number: P980402  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2502-353-37)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 4/3/2025  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PrentaLux  
Catalog Number: PRLX-243-935-LL3-F-U-S-BLAK-X  
Description: 3D PRINTED LUMINAIRE, INTEGRAL LED LIGHT ENGINE, BLACK 243 SHADE WITH FROSTED LENS  
Light Source: 3500K CCT, 90 CRI LEDS  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 1633.1 lumens  
Efficiency: N/A  
Efficacy: 108.9 lumens/watt  
Spacing Criteria (0/90/45): 1.17 / 1.17 / 1.31  
Luminous Opening: Circular (Dia: 1.67' x H: 0')  
CIE Type: Direct

Input Watts (W): 15  
Input Voltage (V): 120  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



TEST NUMBER: P980402  
CATALOG NUMBER: PRLX-243-935-LL3-F-U-S-BLAK-X

### Luminous Intensity Polar Plot

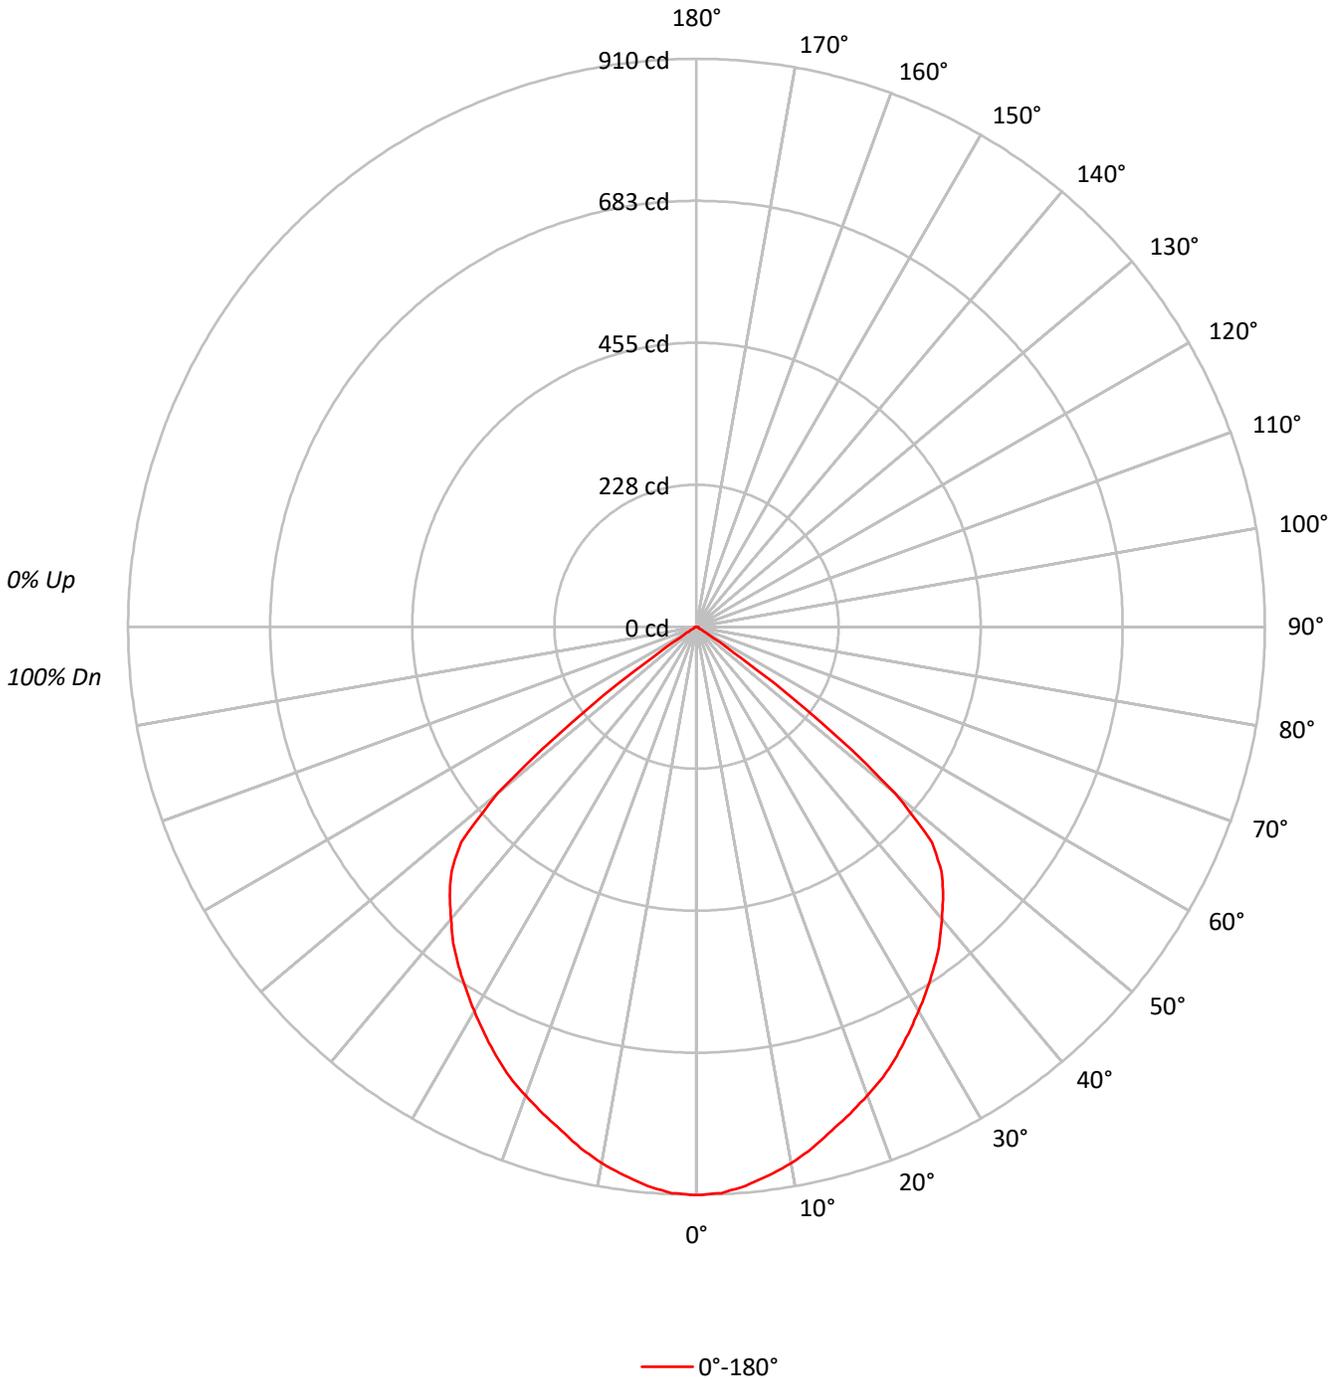



TEST NUMBER: P980402

CATALOG NUMBER: PRLX-243-935-LL3-F-U-S-BLAK-X

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	112	109	106	103	110	107	104	102	103	100	98	99	97	95	95	94	93	91
2	105	99	94	90	103	97	93	89	94	90	87	91	88	85	88	85	83	81
3	98	90	84	79	96	88	83	78	86	81	77	83	79	76	81	77	74	73
4	91	82	75	70	89	80	74	69	78	73	68	76	71	67	74	70	67	65
5	85	74	67	62	83	73	67	62	71	66	61	70	64	60	68	63	60	58
6	79	68	61	55	77	67	60	55	66	59	55	64	58	54	63	58	54	52
7	74	62	55	50	72	62	55	50	60	54	49	59	53	49	58	53	49	47
8	69	57	50	45	68	57	50	45	56	49	45	54	49	44	53	48	44	43
9	65	53	46	41	64	52	46	41	51	45	41	50	45	40	49	44	40	39
10	61	49	42	37	60	49	42	37	48	41	37	47	41	37	46	41	37	35

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	4492
5°	4454
10°	4372
15°	4269
20°	4197
25°	4130
30°	4052
35°	3998
40°	3937
45°	3872
50°	3185
55°	752
60°	43
65°	43
70°	53
75°	57
80°	43
85°	40

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 3872 cd/sqm

TEST NUMBER: P980402

CATALOG NUMBER: PRLX-243-935-LL3-F-U-S-BLAK-X

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	85.0	5.2
10°-20°	236.0	14.5
20°-30°	349.4	21.4
30°-40°	415.3	25.4
40°-50°	417.1	25.5
50°-60°	122.9	7.5
60°-70°	3.8	0.2
70°-80°	2.8	0.2
80°-90°	1.0	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	670.4	41.0
0°-40°	1085.6	66.5
0°-60°	1625.5	99.5
0°-90°	1633.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1633.1	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	910	
5°	899	85
15°	836	236
25°	759	349
35°	664	415
45°	555	417
55°	87	123
65°	4	4
75°	3	3
85°	1	1
90°	0	

TEST NUMBER: P980402

CATALOG NUMBER: PRLX-243-935-LL3-F-U-S-BLAK-X

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	910.5
2.5°	908.3
5°	899.4
7.5°	886.8
10°	872.7
12.5°	855.7
15°	835.7
17.5°	817.9
20°	799.4
22.5°	780.9
25°	758.6
27.5°	734.9
30°	711.2
32.5°	687.5
35°	663.8
37.5°	639.4
40°	611.2
42.5°	584.5
45°	554.9
47.5°	511.2
50°	414.9
52.5°	250.4
55°	87.4
57.5°	17.0
60°	4.4
62.5°	3.7
65°	3.7
67.5°	3.7
70°	3.7
72.5°	3.0
75°	3.0
77.5°	2.2
80°	1.5
82.5°	1.5
85°	0.7
87.5°	0.7
90°	0.0



TEST NUMBER: P980402  
 CATALOG NUMBER: PRLX-243-935-LL3-F-U-S-BLAK-X

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
4H	2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
8H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
12H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00