

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2024 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P980532

Luminaire Tested: PRLX-243-940-LL8-F-U-S-BLAK-X

Issue Date: 4/3/2025

Test Information

Test Method: LM-79-2024
Report Number: P980532
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2502-353-37)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 4/3/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-243-940-LL8-F-U-S-BLAK-X
Description: 3D PRINTED LUMINAIRE, INTEGRAL LED LIGHT ENGINE, BLACK 243 SHADE WITH FROSTED LENS
Light Source: 4000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5398.7 lumens
Efficiency: N/A
Efficacy: 87.8 lumens/watt
Spacing Criteria (0/90/45): 1.17 / 1.17 / 1.31
Luminous Opening: Circular (Dia: 1.67' x H: 0')
CIE Type: Direct


Input Watts (W): 61.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P980532

CATALOG NUMBER: PRLX-243-940-LL8-F-U-S-BLAK-X

Luminous Intensity Polar Plot

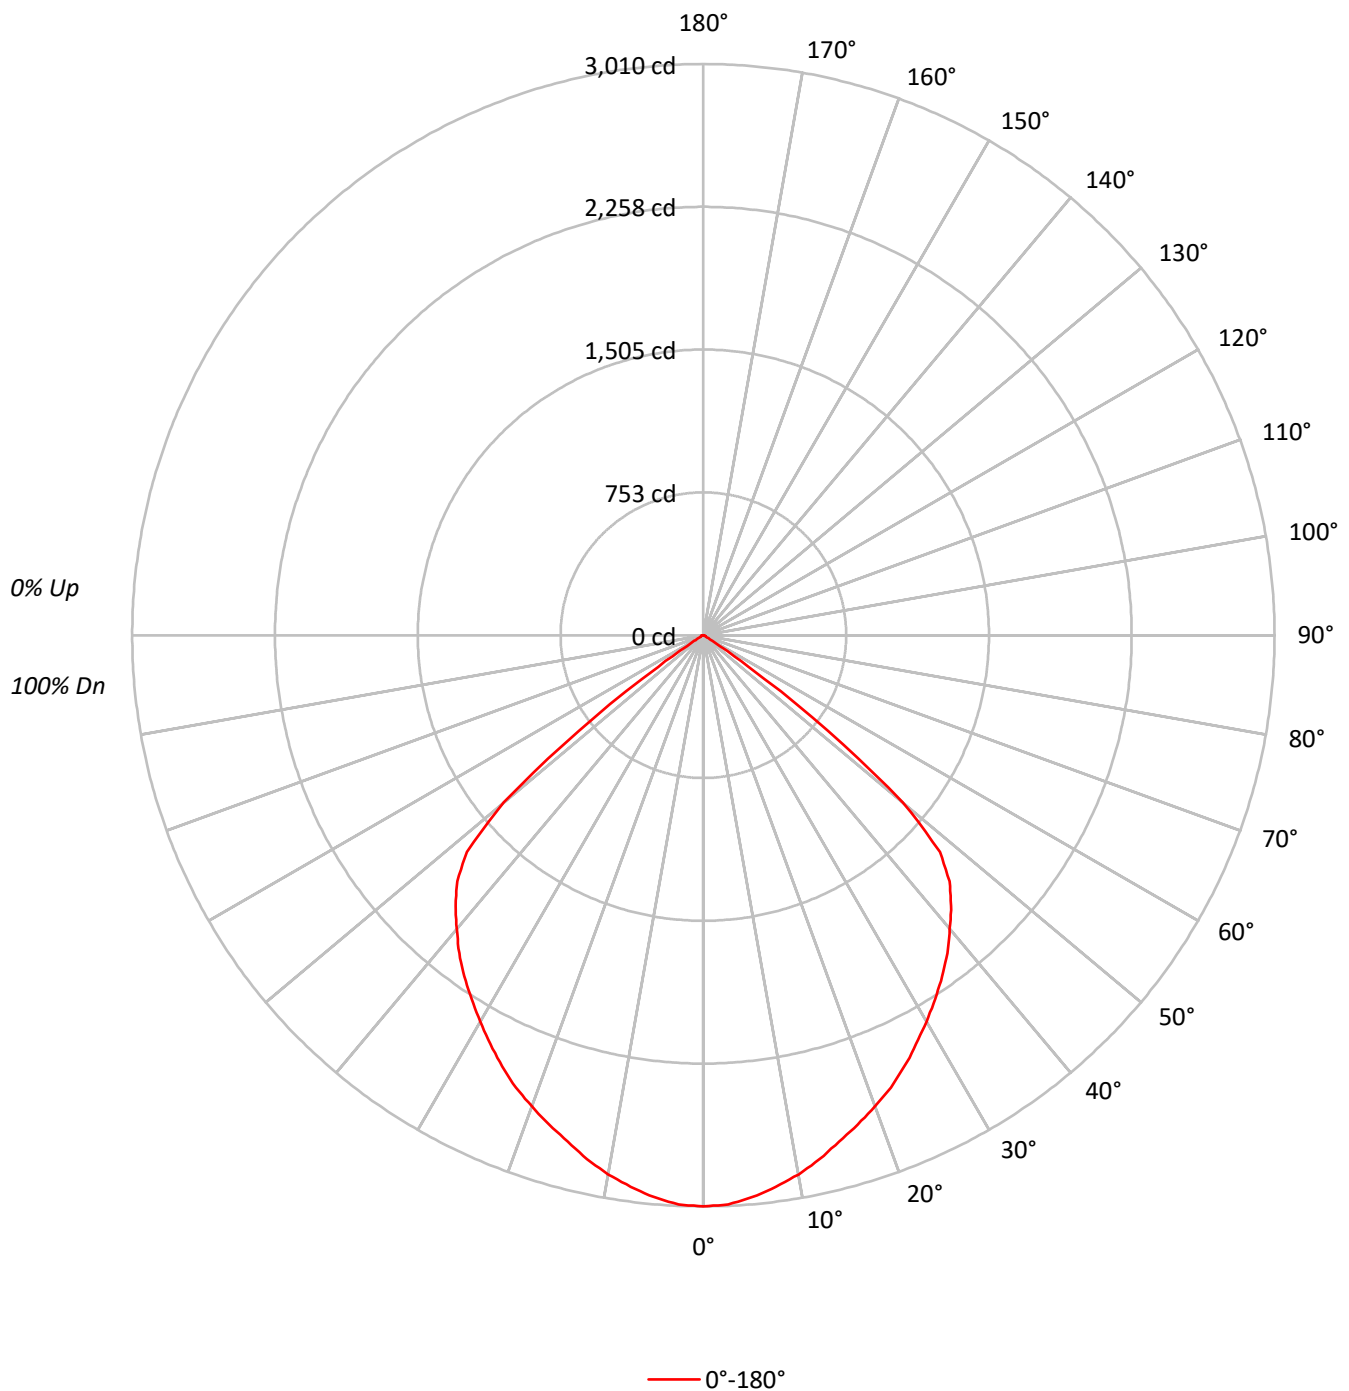

TEST NUMBER: P980532

CATALOG NUMBER: PRLX-243-940-LL8-F-U-S-BLAK-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	112	109	106	103	110	107	104	102	103	100	98		99	97	95		95
2	105	99	94	90	103	97	93	89	94	90	87		91	88	85		88
3	98	90	84	79	96	88	83	78	86	81	77		83	79	76		81
4	91	82	75	70	89	80	74	69	78	73	68		76	71	67		74
5	85	74	67	62	83	73	67	62	71	66	61		70	64	60		68
6	79	68	61	55	77	67	60	55	66	59	55		64	58	54		63
7	74	62	55	50	72	62	55	50	60	54	49		59	53	49		58
8	69	57	50	45	68	57	50	45	56	49	45		54	49	44		53
9	65	53	46	41	64	52	46	41	51	45	41		50	45	40		49
10	61	49	42	37	60	49	42	37	48	41	37		47	41	37		46

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	14850
5°	14725
10°	14454
15°	14110
20°	13874
25°	13652
30°	13394
35°	13216
40°	13013
45°	12799
50°	10527
55°	2486
60°	145
65°	142
70°	176
75°	187
80°	139
85°	136

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 12799 cd/sqm

TEST NUMBER: P980532

CATALOG NUMBER: PRLX-243-940-LL8-F-U-S-BLAK-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	280.9	5.2
10°-20°	780.1	14.5
20°-30°	1154.9	21.4
30°-40°	1372.8	25.4
40°-50°	1378.6	25.5
50°-60°	406.2	7.5
60°-70°	12.4	0.2
70°-80°	9.4	0.2
80°-90°	3.3	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2216.0	41.0
0°-40°	3588.8	66.5
0°-60°	5373.6	99.5
0°-90°	5398.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5398.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3010	
5°	2973	281
15°	2762	780
25°	2508	1155
35°	2194	1373
45°	1834	1379
55°	289	406
65°	12	12
75°	10	9
85°	2	3
90°	0	

TEST NUMBER: P980532

CATALOG NUMBER: PRLX-243-940-LL8-F-U-S-BLAK-X

CANDELA DISTRIBUTION (FULL):

0°	
0°	3009.9
2.5°	3002.5
5°	2973.1
7.5°	2931.5
10°	2885.0
12.5°	2828.6
15°	2762.5
17.5°	2703.7
20°	2642.5
22.5°	2581.3
25°	2507.8
27.5°	2429.5
30°	2351.1
32.5°	2272.7
35°	2194.3
37.5°	2113.5
40°	2020.5
42.5°	1932.3
45°	1834.3
47.5°	1689.8
50°	1371.5
52.5°	827.8
55°	289.0
57.5°	56.3
60°	14.7
62.5°	12.2
65°	12.2
67.5°	12.2
70°	12.2
72.5°	9.8
75°	9.8
77.5°	7.3
80°	4.9
82.5°	4.9
85°	2.4
87.5°	2.4
90°	0.0

TEST NUMBER: P980532

CATALOG NUMBER: PRLX-243-940-LL8-F-U-S-BLAK-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.34	1.65	0.70	1.96	2.28	0.34	1.65	0.70	1.96	2.28
	3H	0.54	1.69	0.92	2.02	2.38	0.54	1.69	0.92	2.02	2.38
	4H	0.70	1.76	1.10	2.11	2.50	0.70	1.76	1.10	2.11	2.50
	6H	0.80	1.78	1.22	2.15	2.54	0.80	1.78	1.22	2.15	2.54
	8H	0.85	1.77	1.28	2.16	2.57	0.85	1.77	1.28	2.16	2.57
	12H	0.88	1.76	1.31	2.14	2.57	0.88	1.76	1.31	2.14	2.57
4H	2H	0.22	1.28	0.62	1.63	2.01	0.22	1.28	0.62	1.63	2.01
	3H	0.56	1.42	0.98	1.82	2.23	0.56	1.42	0.98	1.82	2.23
	4H	0.84	1.59	1.27	2.01	2.46	0.84	1.59	1.27	2.01	2.46
	6H	1.03	1.68	1.50	2.13	2.60	1.03	1.68	1.50	2.13	2.60
	8H	1.12	1.73	1.59	2.18	2.65	1.12	1.73	1.59	2.18	2.65
	12H	1.18	1.72	1.67	2.21	2.68	1.18	1.72	1.67	2.21	2.68
8H	4H	0.87	1.47	1.34	1.92	2.39	0.87	1.47	1.34	1.92	2.39
	6H	1.11	1.62	1.62	2.11	2.60	1.11	1.62	1.62	2.11	2.60
	8H	1.27	1.73	1.80	2.24	2.74	1.27	1.73	1.80	2.24	2.74
	12H	1.39	1.80	1.90	2.29	2.86	1.39	1.80	1.90	2.29	2.86
12H	4H	0.84	1.37	1.32	1.86	2.33	0.84	1.37	1.32	1.86	2.33
	6H	1.10	1.56	1.63	2.07	2.57	1.10	1.56	1.63	2.07	2.57
	8H	1.31	1.72	1.82	2.21	2.78	1.31	1.72	1.82	2.21	2.78