

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P1245165

Luminaire Tested: PRLX-NIM-M-930-07L-U-NR

Issue Date: 1/30/2026

**Test Information**


Test Method: LM-79-2019  
Report Number: P1245165  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2412-299-15)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/30/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PrentaLux  
Catalog Number: PRLX-NIM-M-930-07L-U-NR  
Description: 3D PRINTED PENDANT LED LUMINAIRE, MEDIUM LIGHT ENGINE, NATURAL RIBS SHADE TEXTL  
LIGHT LEVEL 5  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 720.8 lumens  
Efficiency: N/A  
Efficacy: 24.9 lumens/watt  
Spacing Criteria (0/90/45): 0.2 / 0.2 / 0.18  
Luminous Opening: Rectangular w/ Sides (W: 0.46' x L: 0.46' x H: 1.92')  
CIE Type: General Diffuse  
  
Input Watts (W): 28.9  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 28.75 FT

TEST NUMBER: P1245165  
CATALOG NUMBER: PRLX-NIM-M-930-07L-U-NR

### Luminous Intensity Polar Plot

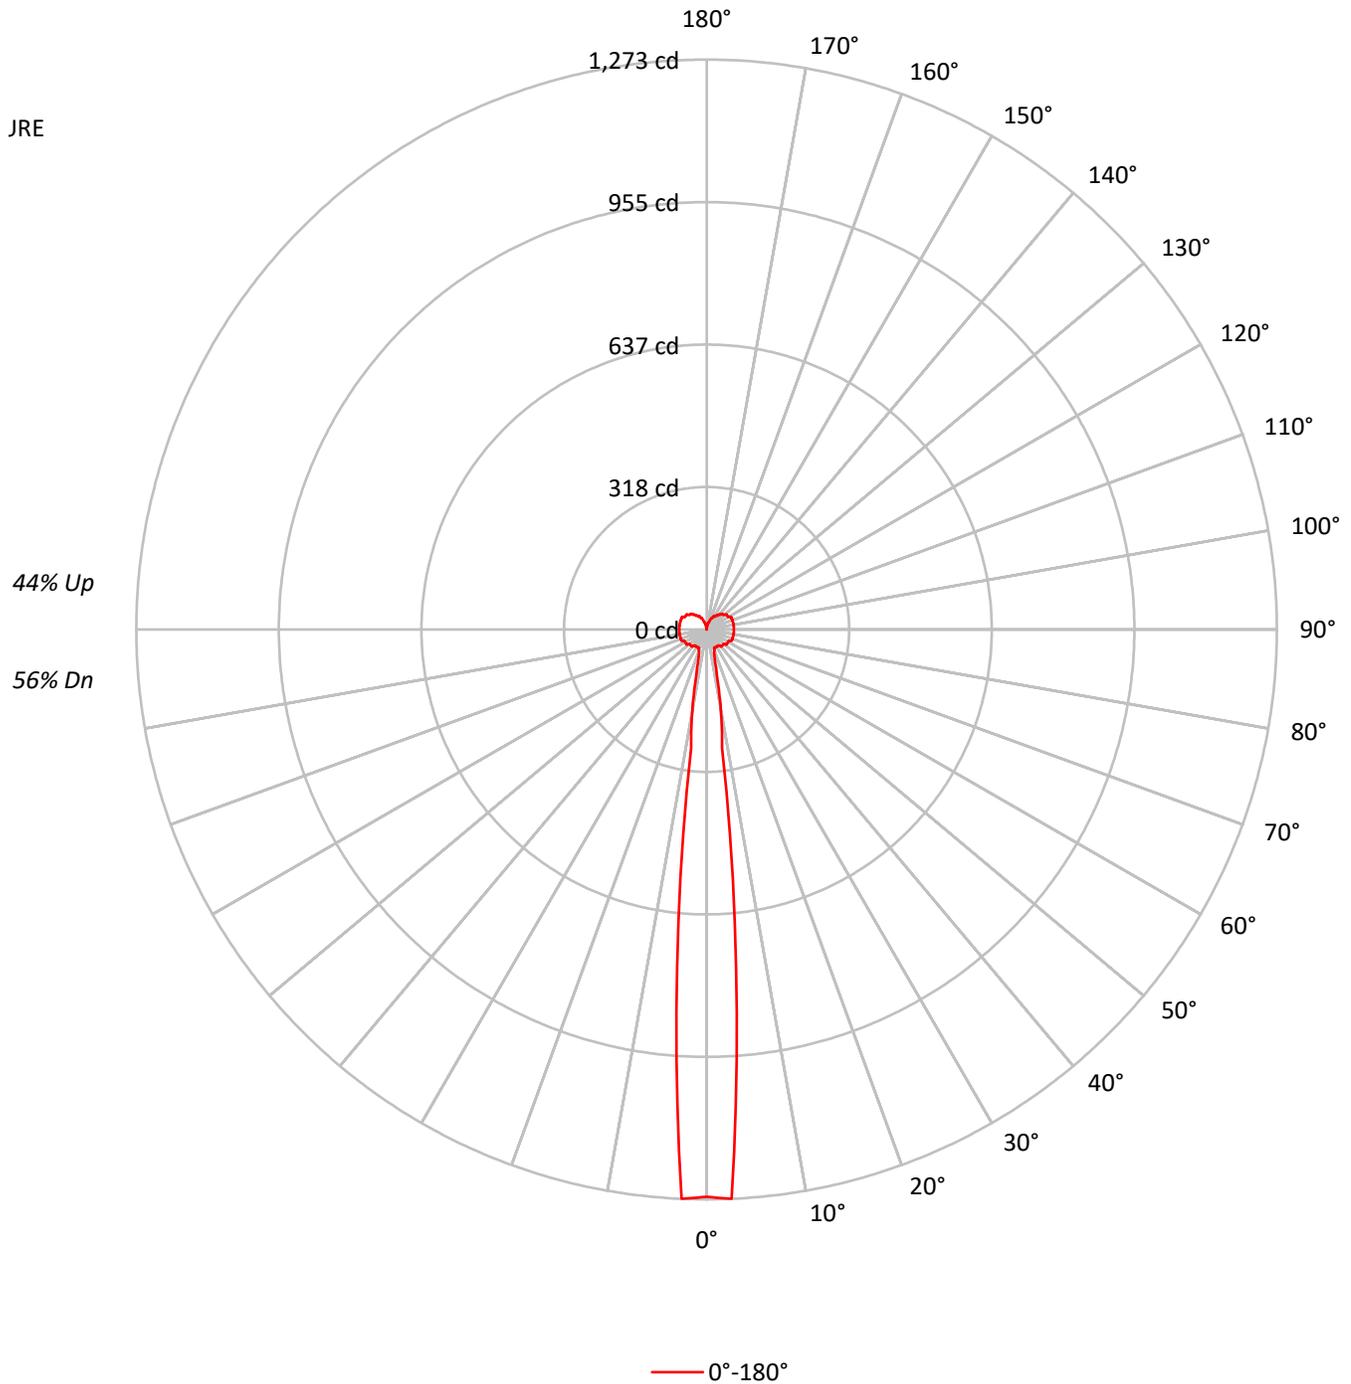



TEST NUMBER: P1245165

CATALOG NUMBER: PRLX-NIM-M-930-07L-U-NR

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	108	108	108	108	101	101	101	101	86	86	86	73	73	73	61	61	61	56
1	95	89	83	78	88	82	77	73	70	66	63	58	55	53	48	46	44	38
2	85	76	68	62	78	70	63	58	60	54	50	50	46	42	40	37	35	30
3	77	66	58	51	71	61	54	47	52	46	41	43	39	35	35	32	29	25
4	71	59	50	43	65	54	46	40	46	40	35	39	34	30	32	28	25	21
5	65	52	43	37	60	49	41	35	42	35	30	35	30	26	29	25	22	18
6	60	47	39	32	56	44	36	30	38	32	27	32	27	23	27	23	20	17
7	56	43	35	29	52	40	33	27	35	29	24	30	25	21	25	21	18	15
8	53	40	32	26	49	37	30	25	32	26	22	28	23	19	23	19	17	14
9	49	37	29	24	46	34	27	22	30	24	20	26	21	18	22	18	15	13
10	47	34	27	22	43	32	25	21	28	22	19	24	20	17	21	17	15	13

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	64941
5°	28469
10°	5493
15°	1809
20°	1081
25°	853
30°	771
35°	709
40°	742
45°	699
50°	666
55°	712
60°	691
65°	743
70°	733
75°	728
80°	729
85°	736

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 90°  
 Luminance: 749 cd/sqm



TEST NUMBER: P1245165

CATALOG NUMBER: PRLX-NIM-M-930-07L-U-NR

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	50.4	7.0
10°-20°	23.1	3.2
20°-30°	20.9	2.9
30°-40°	28.4	3.9
40°-50°	38.7	5.4
50°-60°	49.3	6.8
60°-70°	58.7	8.1
70°-80°	64.6	9.0
80°-90°	66.7	9.2
90°-100°	66.7	9.2
100°-110°	64.6	9.0
110°-120°	60.0	8.3
120°-130°	49.3	6.8
130°-140°	37.2	5.2
140°-150°	23.7	3.3
150°-160°	13.6	1.9
160°-170°	4.5	0.6
170°-180°	0.4	0.1
0°-30°	94.4	13.1
0°-40°	122.8	17.0
0°-60°	210.8	29.2
0°-90°	400.8	55.6
90°-120°	191.3	26.5
90°-150°	301.5	41.8
90°-180°	320.0	44.4
0°-180°	720.8	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1267	
5°	756	50
15°	72	23
25°	44	21
35°	44	28
45°	50	39
55°	56	49
65°	61	59
75°	61	65
85°	61	50
90°	61	33
95°	61	50
105°	61	65
115°	61	60
125°	56	49
135°	50	37
145°	39	24
155°	28	14
165°	17	4
175°	0	0
180°	0	

TEST NUMBER: P1245165

CATALOG NUMBER: PRLX-NIM-M-930-07L-U-NR

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	1267.2
2.5°	1272.8
5°	755.9
7.5°	266.8
10°	183.4
12.5°	105.6
15°	72.3
17.5°	55.6
20°	50.0
22.5°	44.5
25°	44.5
27.5°	44.5
30°	44.5
32.5°	44.5
35°	44.5
37.5°	44.5
40°	50.0
42.5°	50.0
45°	50.0
47.5°	50.0
50°	50.0
52.5°	55.6
55°	55.6
57.5°	55.6
60°	55.6
62.5°	55.6
65°	61.1
67.5°	61.1
70°	61.1
72.5°	61.1
75°	61.1
77.5°	61.1
80°	61.1
82.5°	61.1
85°	61.1
87.5°	61.1
90°	61.1
92.5°	61.1
95°	61.1
97.5°	61.1
100°	61.1
102.5°	61.1
105°	61.1
107.5°	61.1
110°	61.1

TEST NUMBER: P1245165

CATALOG NUMBER: PRLX-NIM-M-930-07L-U-NR

**CANDELA DISTRIBUTION (continued):**

	0°
112.5°	61.1
115°	61.1
117.5°	61.1
120°	55.6
122.5°	55.6
125°	55.6
127.5°	55.6
130°	50.0
132.5°	50.0
135°	50.0
137.5°	44.5
140°	44.5
142.5°	38.9
145°	38.9
147.5°	33.3
150°	33.3
152.5°	33.3
155°	27.8
157.5°	27.8
160°	22.2
162.5°	16.7
165°	16.7
167.5°	11.1
170°	11.1
172.5°	5.6
175°	0.0
177.5°	0.0
180°	0.0



TEST NUMBER: P1245165

CATALOG NUMBER: PRLX-NIM-M-930-07L-U-NR

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room Dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.2	7.2	7.1	8.2	9.3	6.2	7.2	7.1	8.2	9.3
	3H	9.3	10.3	10.2	11.2	12.4	9.3	10.3	10.2	11.2	12.4
	4H	10.8	11.7	11.7	12.6	13.8	10.8	11.7	11.7	12.6	13.8
	6H	12.2	13.0	13.1	14.0	15.2	12.2	13.0	13.1	14.0	15.2
	8H	12.8	13.6	13.8	14.6	15.8	12.8	13.6	13.8	14.6	15.8
	12H	13.5	14.3	14.4	15.2	16.5	13.5	14.3	14.4	15.2	16.5
4H	2H	7.1	8.0	8.0	8.9	10.1	7.1	8.0	8.0	8.9	10.1
	3H	10.3	11.1	11.2	12.1	13.3	10.3	11.1	11.2	12.1	13.3
	4H	11.9	12.6	12.8	13.6	14.8	11.9	12.6	12.8	13.6	14.8
	6H	13.4	14.1	14.4	15.1	16.3	13.4	14.1	14.4	15.1	16.3
	8H	14.2	14.8	15.1	15.8	17.0	14.2	14.8	15.1	15.8	17.0
	12H	14.9	15.5	15.9	16.5	17.8	14.9	15.5	15.9	16.5	17.8
8H	4H	12.4	13.0	13.3	14.0	15.2	12.4	13.0	13.3	14.0	15.2
	6H	14.1	14.7	15.1	15.7	16.9	14.1	14.7	15.1	15.7	16.9
	8H	15.0	15.5	16.0	16.5	17.8	15.0	15.5	16.0	16.5	17.8
	12H	16.0	16.4	17.0	17.4	18.7	16.0	16.4	17.0	17.4	18.7
12H	4H	12.5	13.1	13.5	14.0	15.3	12.5	13.1	13.5	14.0	15.3
	6H	14.3	14.8	15.3	15.8	17.1	14.3	14.8	15.3	15.8	17.1
	8H	15.3	15.7	16.3	16.7	18.0	15.3	15.7	16.3	16.7	18.0

(END OF REPORT)