

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P1245175

Luminaire Tested: PRLX-NIM-M-935-04L-U-LF

Issue Date: 1/30/2026

Test Information

Test Method: LM-79-2019
Report Number: P1245175
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2412-299-15)
Test Lab: INNOVATION CENTER
Issue Date: 1/30/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-NIM-M-935-04L-U-LF
Description: 3D PRINTED PENDANT LED LUMINAIRE, MEDIUM LIGHT ENGINE, LAYERED FINE SHADE TEXTU
LIGHT LEVEL 3
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 482.2 lumens
Efficiency: N/A
Efficacy: 29.8 lumens/watt
Spacing Criteria (0/90/45): 0.2 / 0.2 / 0.18
Luminous Opening: Rectangular w/ Sides (W: 0.46' x L: 0.46' x H: 1.92')
CIE Type: General Diffuse

Input Watts (W): 16.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 28.75 FT

TEST NUMBER: P1245175

CATALOG NUMBER: PRLX-NIM-M-935-04L-U-LF

Luminous Intensity Polar Plot

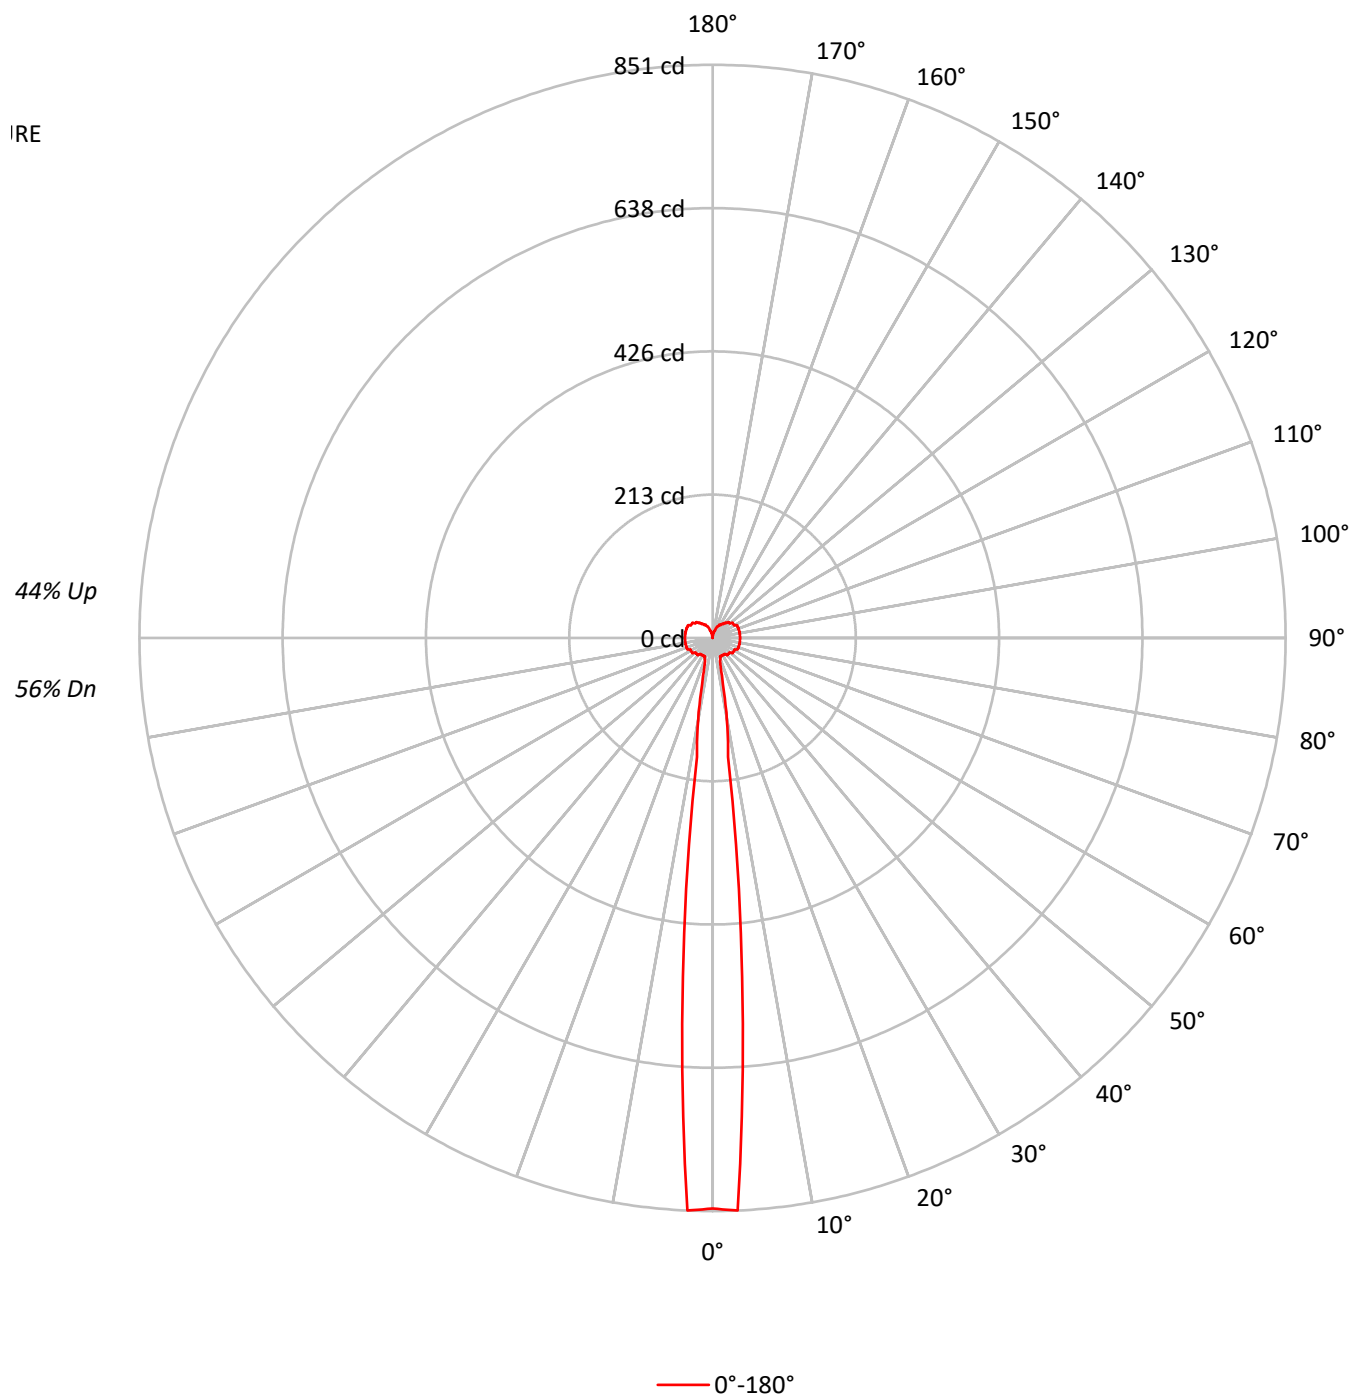

TEST NUMBER: P1245175

CATALOG NUMBER: PRLX-NIM-M-935-04L-U-LF

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20						20
RC	80					70					50					30						10
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		50	30	10	
RCR																						
0	108	108	108	108		101	101	101	101		86	86	86		73	73	73		61	61	61	
1	95	89	83	78		88	82	77	73		70	66	63		58	55	53		48	46	44	
2	85	76	68	62		78	70	63	58		60	54	50		50	46	42		40	37	35	
3	77	66	58	51		71	61	54	47		52	46	41		43	39	35		35	32	29	
4	71	59	50	43		65	54	46	40		46	40	35		39	34	30		32	28	25	
5	65	52	43	37		60	49	41	35		42	35	30		35	30	26		29	25	22	
6	60	47	39	32		56	44	36	30		38	31	27		32	27	23		27	23	20	
7	56	43	35	29		52	40	33	27		35	29	24		30	25	21		25	21	18	
8	53	40	32	26		49	37	30	25		32	26	22		28	23	19		23	19	16	
9	49	37	29	24		46	34	27	22		30	24	20		26	21	18		22	18	15	
10	47	34	27	22		43	32	25	21		28	22	19		24	20	17		21	17	15	

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	43417
5°	19031
10°	3672
15°	1208
20°	722
25°	569
30°	515
35°	473
40°	496
45°	467
50°	445
55°	477
60°	463
65°	498
70°	491
75°	488
80°	488
85°	493

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 90°
Luminance: 501 cd/sqm

TEST NUMBER: P1245175

CATALOG NUMBER: PRLX-NIM-M-935-04L-U-LF

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	33.7	7.0
10°-20°	15.4	3.2
20°-30°	13.9	2.9
30°-40°	19.0	3.9
40°-50°	25.9	5.4
50°-60°	33.0	6.8
60°-70°	39.3	8.1
70°-80°	43.3	9.0
80°-90°	44.6	9.3
90°-100°	44.6	9.3
100°-110°	43.3	9.0
110°-120°	40.2	8.3
120°-130°	33.0	6.8
130°-140°	24.8	5.2
140°-150°	15.8	3.3
150°-160°	9.1	1.9
160°-170°	3.0	0.6
170°-180°	0.3	0.1
0°-30°	63.1	13.1
0°-40°	82.0	17.0
0°-60°	140.9	29.2
0°-90°	268.0	55.6
90°-120°	128.0	26.6
90°-150°	201.7	41.8
90°-180°	214.0	44.4
0°-180°	482.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	847	
5°	505	34
15°	48	15
25°	30	14
35°	30	19
45°	33	26
55°	37	33
65°	41	39
75°	41	43
85°	41	33
90°	41	22
95°	41	33
105°	41	43
115°	41	40
125°	37	33
135°	33	25
145°	26	16
155°	19	9
165°	11	3
175°	0	0
180°	0	

TEST NUMBER: P1245175

CATALOG NUMBER: PRLX-NIM-M-935-04L-U-LF

CANDELA DISTRIBUTION (FULL):

0°	
0°	847.2
2.5°	850.9
5°	505.3
7.5°	178.3
10°	122.6
12.5°	70.6
15°	48.3
17.5°	37.2
20°	33.4
22.5°	29.7
25°	29.7
27.5°	29.7
30°	29.7
32.5°	29.7
35°	29.7
37.5°	29.7
40°	33.4
42.5°	33.4
45°	33.4
47.5°	33.4
50°	33.4
52.5°	37.2
55°	37.2
57.5°	37.2
60°	37.2
62.5°	37.2
65°	40.9
67.5°	40.9
70°	40.9
72.5°	40.9
75°	40.9
77.5°	40.9
80°	40.9
82.5°	40.9
85°	40.9
87.5°	40.9
90°	40.9
92.5°	40.9
95°	40.9
97.5°	40.9
100°	40.9
102.5°	40.9
105°	40.9
107.5°	40.9
110°	40.9

TEST NUMBER: P1245175

CATALOG NUMBER: PRLX-NIM-M-935-04L-U-LF

CANDELA DISTRIBUTION (continued):

	0°
112.5°	40.9
115°	40.9
117.5°	40.9
120°	37.2
122.5°	37.2
125°	37.2
127.5°	37.2
130°	33.4
132.5°	33.4
135°	33.4
137.5°	29.7
140°	29.7
142.5°	26.0
145°	26.0
147.5°	22.3
150°	22.3
152.5°	22.3
155°	18.6
157.5°	18.6
160°	14.9
162.5°	11.1
165°	11.1
167.5°	7.4
170°	7.4
172.5°	3.7
175°	0.0
177.5°	0.0
180°	0.0

TEST NUMBER: P1245175

CATALOG NUMBER: PRLX-NIM-M-935-04L-U-LF

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room Dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	4.8	5.8	5.7	6.8	7.9	4.8	5.8	5.7	6.8	7.9
	3H	8.0	8.9	8.8	9.8	11.0	8.0	8.9	8.8	9.8	11.0
	4H	9.4	10.3	10.3	11.2	12.4	9.4	10.3	10.3	11.2	12.4
	6H	10.8	11.6	11.7	12.6	13.8	10.8	11.6	11.7	12.6	13.8
	8H	11.4	12.3	12.4	13.2	14.4	11.4	12.3	12.4	13.2	14.4
	12H	12.1	12.9	13.0	13.8	15.1	12.1	12.9	13.0	13.8	15.1
4H	2H	5.7	6.6	6.6	7.5	8.7	5.7	6.6	6.6	7.5	8.7
	3H	8.9	9.7	9.8	10.7	11.9	8.9	9.7	9.8	10.7	11.9
	4H	10.5	11.2	11.4	12.2	13.4	10.5	11.2	11.4	12.2	13.4
	6H	12.0	12.7	13.0	13.7	14.9	12.0	12.7	13.0	13.7	14.9
	8H	12.8	13.4	13.7	14.4	15.7	12.8	13.4	13.7	14.4	15.7
	12H	13.5	14.1	14.5	15.1	16.4	13.5	14.1	14.5	15.1	16.4
8H	4H	11.0	11.6	11.9	12.6	13.9	11.0	11.6	11.9	12.6	13.9
	6H	12.7	13.3	13.7	14.3	15.6	12.7	13.3	13.7	14.3	15.6
	8H	13.7	14.1	14.6	15.1	16.4	13.7	14.1	14.6	15.1	16.4
	12H	14.6	15.0	15.6	16.0	17.3	14.6	15.0	15.6	16.0	17.3
12H	4H	11.1	11.7	12.1	12.7	13.9	11.1	11.7	12.1	12.7	13.9
	6H	12.9	13.4	13.9	14.4	15.7	12.9	13.4	13.9	14.4	15.7
	8H	13.9	14.3	14.9	15.3	16.7	13.9	14.3	14.9	15.3	16.7

(END OF REPORT)