

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P1245479

Luminaire Tested: PRLX-UNA-S-935-07L-U-NL

Issue Date: 1/30/2026

Test Information

Test Method: LM-79-2019
Report Number: P1245479
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2412-299-14)
Test Lab: INNOVATION CENTER
Issue Date: 1/30/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-UNA-S-935-07L-U-NL
Description: 3D PRINTED PENDANT LED LUMINAIRE, SMALL LIGHT ENGINE, NATURAL LINES SHADE TEXTURE, LIGHT LEVEL 3
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 654.0 lumens
Efficiency: N/A
Efficacy: 40.4 lumens/watt
Spacing Criteria (0/90/45): 0.33 / 0.33 / 0.34
Luminous Opening: Rectangular w/ Sides (W: 0.47' x L: 0.47' x H: 1.12')
CIE Type: Semi-Direct

Input Watts (W): 16.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 28.75 FT

TEST NUMBER: P1245479

CATALOG NUMBER: PRLX-UNA-S-935-07L-U-NL

Luminous Intensity Polar Plot

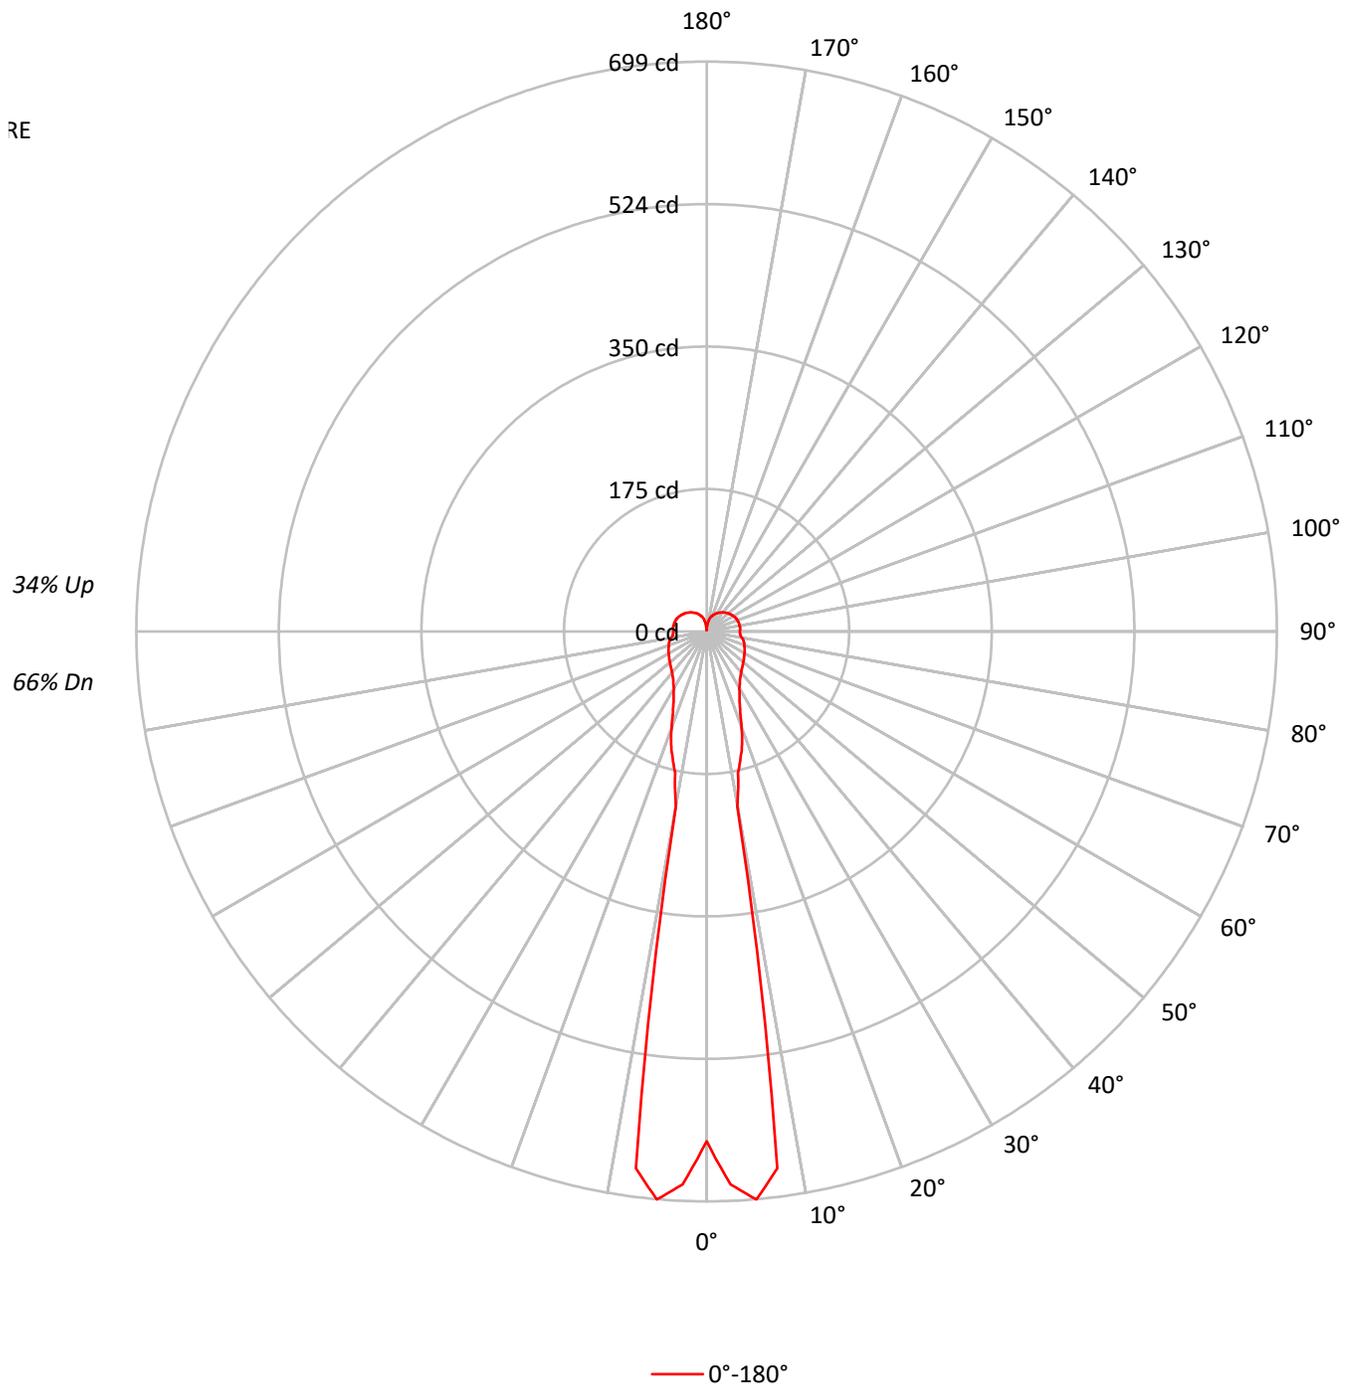



TEST NUMBER: P1245479

CATALOG NUMBER: PRLX-UNA-S-935-07L-U-NL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|----|----|----|----|----|----|----|----|
| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | |
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | 0 |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 |
| RCR | | | | | | | | | | | | | | | | | | |
| 0 | 111 | 111 | 111 | 111 | 105 | 105 | 105 | 105 | 92 | 92 | 92 | 81 | 81 | 81 | 71 | 71 | 71 | 66 |
| 1 | 99 | 94 | 89 | 84 | 93 | 88 | 84 | 80 | 78 | 74 | 71 | 68 | 65 | 63 | 59 | 57 | 55 | 51 |
| 2 | 90 | 81 | 74 | 68 | 84 | 77 | 70 | 65 | 68 | 63 | 58 | 59 | 55 | 52 | 52 | 49 | 46 | 42 |
| 3 | 82 | 72 | 64 | 57 | 77 | 68 | 60 | 55 | 60 | 54 | 49 | 53 | 48 | 44 | 46 | 43 | 40 | 36 |
| 4 | 76 | 64 | 56 | 49 | 71 | 61 | 53 | 47 | 54 | 48 | 43 | 48 | 43 | 39 | 42 | 38 | 35 | 32 |
| 5 | 70 | 58 | 49 | 43 | 66 | 55 | 47 | 41 | 49 | 43 | 38 | 44 | 38 | 34 | 38 | 34 | 31 | 28 |
| 6 | 65 | 53 | 44 | 38 | 61 | 50 | 42 | 37 | 45 | 39 | 34 | 40 | 35 | 31 | 36 | 32 | 28 | 26 |
| 7 | 61 | 48 | 40 | 35 | 57 | 46 | 39 | 33 | 42 | 35 | 31 | 37 | 32 | 28 | 33 | 29 | 26 | 24 |
| 8 | 57 | 45 | 37 | 31 | 54 | 43 | 35 | 30 | 39 | 33 | 28 | 35 | 30 | 26 | 31 | 27 | 24 | 22 |
| 9 | 54 | 42 | 34 | 29 | 51 | 40 | 33 | 28 | 36 | 30 | 26 | 33 | 28 | 24 | 30 | 26 | 23 | 21 |
| 10 | 51 | 39 | 32 | 27 | 48 | 37 | 30 | 26 | 34 | 28 | 24 | 31 | 26 | 23 | 28 | 24 | 21 | 19 |

AVERAGE LUMINANCE (cd/sqm):

| | |
|-----|-------|
| | 0° |
| 0° | 30627 |
| 5° | 28420 |
| 10° | 7613 |
| 15° | 4966 |
| 20° | 3492 |
| 25° | 2438 |
| 30° | 1902 |
| 35° | 1591 |
| 40° | 1396 |
| 45° | 1261 |
| 50° | 1157 |
| 55° | 1076 |
| 60° | 1018 |
| 65° | 969 |
| 70° | 928 |
| 75° | 893 |
| 80° | 844 |
| 85° | 820 |

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 1261 cd/sqm

TEST NUMBER: P1245479

CATALOG NUMBER: PRLX-UNA-S-935-07L-U-NL

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 55.0 | 8.4 |
| 10°-20° | 45.3 | 6.9 |
| 20°-30° | 44.9 | 6.9 |
| 30°-40° | 45.1 | 6.9 |
| 40°-50° | 47.9 | 7.3 |
| 50°-60° | 50.2 | 7.7 |
| 60°-70° | 51.0 | 7.8 |
| 70°-80° | 49.7 | 7.6 |
| 80°-90° | 45.5 | 7.0 |
| 90°-100° | 45.0 | 6.9 |
| 100°-110° | 43.1 | 6.6 |
| 110°-120° | 39.0 | 6.0 |
| 120°-130° | 32.6 | 5.0 |
| 130°-140° | 25.3 | 3.9 |
| 140°-150° | 17.8 | 2.7 |
| 150°-160° | 10.9 | 1.7 |
| 160°-170° | 5.0 | 0.8 |
| 170°-180° | 0.8 | 0.1 |
| 0°-30° | 145.2 | 22.2 |
| 0°-40° | 190.3 | 29.1 |
| 0°-60° | 288.5 | 44.1 |
| 0°-90° | 434.6 | 66.5 |
| 90°-120° | 127.0 | 19.4 |
| 90°-150° | 202.7 | 31.0 |
| 90°-180° | 219.0 | 33.5 |
| 0°-180° | 654.0 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|------|-----|------|
| 0° | 625 | |
| 5° | 699 | 55 |
| 15° | 161 | 45 |
| 25° | 96 | 45 |
| 35° | 71 | 45 |
| 45° | 62 | 48 |
| 55° | 56 | 50 |
| 65° | 51 | 51 |
| 75° | 47 | 50 |
| 85° | 42 | 34 |
| 90° | 41 | 22 |
| 95° | 42 | 34 |
| 105° | 41 | 43 |
| 115° | 39 | 39 |
| 125° | 36 | 33 |
| 135° | 33 | 25 |
| 145° | 28 | 18 |
| 155° | 23 | 11 |
| 165° | 18 | 5 |
| 175° | 7 | 1 |
| 180° | 2 | |

TEST NUMBER: P1245479

CATALOG NUMBER: PRLX-UNA-S-935-07L-U-NL

CANDELA DISTRIBUTION (FULL):

| 0° | |
|--------|-------|
| 0° | 625.2 |
| 2.5° | 678.8 |
| 5° | 699.3 |
| 7.5° | 663.9 |
| 10° | 217.8 |
| 12.5° | 178.0 |
| 15° | 160.9 |
| 17.5° | 144.8 |
| 20° | 125.5 |
| 22.5° | 107.8 |
| 25° | 95.6 |
| 27.5° | 87.3 |
| 30° | 80.2 |
| 32.5° | 75.7 |
| 35° | 71.3 |
| 37.5° | 68.5 |
| 40° | 65.8 |
| 42.5° | 63.6 |
| 45° | 61.9 |
| 47.5° | 60.3 |
| 50° | 58.6 |
| 52.5° | 57.5 |
| 55° | 55.8 |
| 57.5° | 54.7 |
| 60° | 53.6 |
| 62.5° | 52.5 |
| 65° | 51.4 |
| 67.5° | 50.3 |
| 70° | 49.2 |
| 72.5° | 48.6 |
| 75° | 47.0 |
| 77.5° | 45.9 |
| 80° | 43.7 |
| 82.5° | 42.0 |
| 85° | 41.5 |
| 87.5° | 40.9 |
| 90° | 40.9 |
| 92.5° | 40.9 |
| 95° | 41.5 |
| 97.5° | 41.5 |
| 100° | 40.9 |
| 102.5° | 40.9 |
| 105° | 40.9 |
| 107.5° | 40.4 |
| 110° | 40.4 |

TEST NUMBER: P1245479

CATALOG NUMBER: PRLX-UNA-S-935-07L-U-NL

CANDELA DISTRIBUTION (continued):

| | 0° |
|--------|------|
| 112.5° | 39.8 |
| 115° | 39.2 |
| 117.5° | 38.7 |
| 120° | 38.1 |
| 122.5° | 37.0 |
| 125° | 36.5 |
| 127.5° | 35.4 |
| 130° | 34.8 |
| 132.5° | 33.7 |
| 135° | 32.6 |
| 137.5° | 31.5 |
| 140° | 30.4 |
| 142.5° | 29.3 |
| 145° | 28.2 |
| 147.5° | 27.1 |
| 150° | 26.0 |
| 152.5° | 24.9 |
| 155° | 23.2 |
| 157.5° | 22.1 |
| 160° | 20.5 |
| 162.5° | 19.3 |
| 165° | 17.7 |
| 167.5° | 15.5 |
| 170° | 12.7 |
| 172.5° | 9.9 |
| 175° | 6.6 |
| 177.5° | 3.3 |
| 180° | 1.7 |



TEST NUMBER: P1245479

CATALOG NUMBER: PRLX-UNA-S-935-07L-U-NL

CIE UGR TABLE:

| Reflectances: | | | | | | | | | | | |
|-----------------|------|------------------|------|------|------|------|----------------|------|------|------|------|
| Ceiling | | 0.7 | 0.7 | 0.5 | 0.5 | 0.3 | 0.7 | 0.7 | 0.5 | 0.5 | 0.3 |
| Wall | | 0.5 | 0.3 | 0.5 | 0.3 | 0.3 | 0.5 | 0.3 | 0.5 | 0.3 | 0.3 |
| Reference plane | | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 |
| Room Dimensions | | Viewed crosswise | | | | | Viewed endwise | | | | |
| X=2H | Y=2H | 8.3 | 9.4 | 9.1 | 10.2 | 11.2 | 8.3 | 9.4 | 9.1 | 10.2 | 11.2 |
| | 3H | 10.7 | 11.7 | 11.5 | 12.5 | 13.6 | 10.7 | 11.7 | 11.5 | 12.5 | 13.6 |
| | 4H | 11.9 | 12.8 | 12.7 | 13.7 | 14.7 | 11.9 | 12.8 | 12.7 | 13.7 | 14.7 |
| | 6H | 13.0 | 13.9 | 13.8 | 14.7 | 15.8 | 13.0 | 13.9 | 13.8 | 14.7 | 15.8 |
| | 8H | 13.5 | 14.4 | 14.4 | 15.2 | 16.3 | 13.5 | 14.4 | 14.4 | 15.2 | 16.3 |
| | 12H | 14.0 | 14.8 | 14.9 | 15.7 | 16.8 | 14.0 | 14.8 | 14.9 | 15.7 | 16.8 |
| 4H | 2H | 8.9 | 9.8 | 9.7 | 10.7 | 11.7 | 8.9 | 9.8 | 9.7 | 10.7 | 11.7 |
| | 3H | 11.6 | 12.4 | 12.4 | 13.3 | 14.3 | 11.6 | 12.4 | 12.4 | 13.3 | 14.3 |
| | 4H | 12.9 | 13.6 | 13.7 | 14.5 | 15.6 | 12.9 | 13.6 | 13.7 | 14.5 | 15.6 |
| | 6H | 14.2 | 14.8 | 15.0 | 15.7 | 16.8 | 14.2 | 14.8 | 15.0 | 15.7 | 16.8 |
| | 8H | 14.8 | 15.4 | 15.6 | 16.3 | 17.4 | 14.8 | 15.4 | 15.6 | 16.3 | 17.4 |
| | 12H | 15.4 | 15.9 | 16.3 | 16.8 | 18.0 | 15.4 | 15.9 | 16.3 | 16.8 | 18.0 |
| 8H | 4H | 13.3 | 13.9 | 14.2 | 14.8 | 15.9 | 13.3 | 13.9 | 14.2 | 14.8 | 15.9 |
| | 6H | 14.8 | 15.3 | 15.7 | 16.2 | 17.4 | 14.8 | 15.3 | 15.7 | 16.2 | 17.4 |
| | 8H | 15.5 | 16.0 | 16.4 | 16.9 | 18.0 | 15.5 | 16.0 | 16.4 | 16.9 | 18.0 |
| | 12H | 16.3 | 16.7 | 17.2 | 17.6 | 18.8 | 16.3 | 16.7 | 17.2 | 17.6 | 18.8 |
| 12H | 4H | 13.4 | 14.0 | 14.3 | 14.9 | 16.0 | 13.4 | 14.0 | 14.3 | 14.9 | 16.0 |
| | 6H | 14.9 | 15.4 | 15.8 | 16.3 | 17.5 | 14.9 | 15.4 | 15.8 | 16.3 | 17.5 |
| | 8H | 15.7 | 16.2 | 16.6 | 17.1 | 18.2 | 15.7 | 16.2 | 16.6 | 17.1 | 18.2 |

(END OF REPORT)