

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P1057403

Luminaire Tested: PRLX-CYL2W-DR-X-927-15L-NF-U-S-X-X-BLAK

Issue Date: 8/6/2025

Test Information

Test Method: LM-79-2019
Report Number: P1057403
REPORT IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2504-407-3)
Test Lab: INNOVATION CENTER
Issue Date: 8/6/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-CYL2W-DR-X-927-15L-NF-U-S-X-X-BLAK
Description: PrentaLux 2-INCH CYLINDER
DOWNLIGHT 1500 LUMENS, NARROW FLOOD OPTIC (27-DEGREES)
Light Source: 2700K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1547.4 lumens
Efficiency: N/A
Efficacy: 119.0 lumens/watt
Spacing Criteria (0/90/45): 0.45 / 0.45 / 0.48
Luminous Opening: Circular (Dia: 0.15' x H: 0')
CIE Type: Direct

Input Watts (W): 13
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1057403

CATALOG NUMBER: PRLX-CYL2W-DR-X-927-15L-NF-U-S-X-X-BLAK

Luminous Intensity Polar Plot

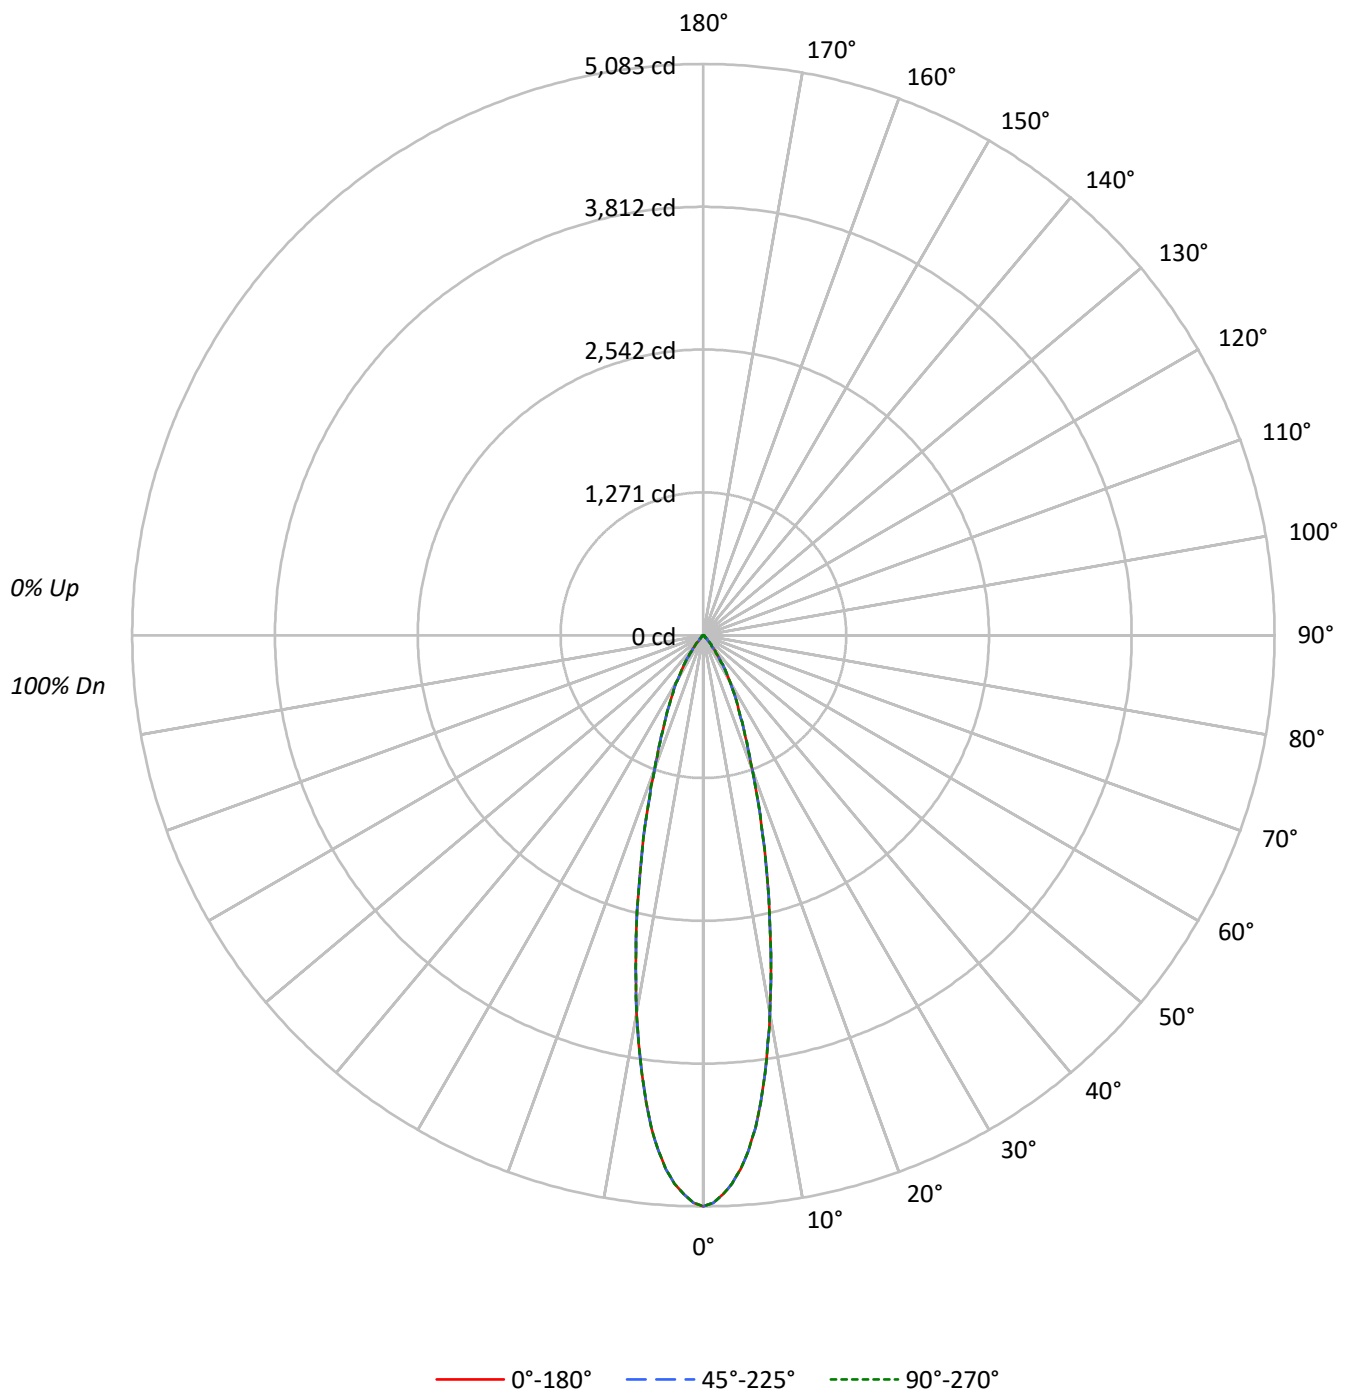

TEST NUMBER: P1057403

CATALOG NUMBER: PRLX-CYL2W-DR-X-927-15L-NF-U-S-X-X-BLAK

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	115	112	110	108	112	110	108	106	106	105	103		102	101	100		99
2	110	106	103	100	108	104	101	99	101	99	97		98	96	95		96
3	106	101	97	93	104	99	96	93	97	94	91		95	92	90		92
4	102	96	91	88	100	95	91	87	93	89	86		91	88	85		89
5	98	92	87	83	97	91	86	83	89	85	82		87	84	82		86
6	95	88	83	79	93	87	82	79	85	82	79		84	81	78		83
7	91	84	79	76	90	83	79	76	82	78	75		81	78	75		80
8	88	81	76	73	87	80	76	72	79	75	72		78	75	72		77
9	85	78	73	70	84	77	73	70	76	72	69		76	72	69		75
10	83	75	70	67	82	74	70	67	74	70	67		73	69	67		72

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3275714	3275714	3275714
5°	2978370	2978370	2978370
10°	2233988	2233988	2233988
15°	1450856	1450856	1450856
20°	869085	869085	869085
25°	541669	541669	541669
30°	343854	343854	343854
35°	179602	179602	179602
40°	71841	71841	71841
45°	24242	24242	24242
50°	12632	12632	12632
55°	7865	7865	7865
60°	7217	7217	7217
65°	4270	4270	4270
70°	2638	2638	2638
75°	3486	3486	3486
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 24242 cd/sqm

TEST NUMBER: P1057403

CATALOG NUMBER: PRLX-CYL2W-DR-X-927-15L-NF-U-S-X-X-BLAK

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	400.3	25.9
10°-20°	600.7	38.8
20°-30°	359.1	23.2
30°-40°	149.7	9.7
40°-50°	26.4	1.7
50°-60°	7.0	0.5
60°-70°	3.3	0.2
70°-80°	0.9	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1360.1	87.9
0°-40°	1509.8	97.6
0°-60°	1543.2	99.7
0°-90°	1547.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1547.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	5083	5083	5083	5083	5083	
5°	4604	4604	4604	4604	4604	400
15°	2175	2175	2175	2175	2175	601
25°	762	762	762	762	762	359
35°	228	228	228	228	228	150
45°	27	27	27	27	27	26
55°	7	7	7	7	7	7
65°	3	3	3	3	3	3
75°	1	1	1	1	1	1
85°	0	0	0	0	0	0
90°	0	0	0	0	0	

TEST NUMBER: P1057403

CATALOG NUMBER: PRLX-CYL2W-DR-X-927-15L-NF-U-S-X-BLAK

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	5083.2	5083.2	5083.2	5083.2	5083.2
1°	5050.9	5050.9	5050.9	5050.9	5050.9
2°	4979.5	4979.5	4979.5	4979.5	4979.5
3°	4885.7	4885.7	4885.7	4885.7	4885.7
4°	4763.9	4763.9	4763.9	4763.9	4763.9
5°	4604.2	4604.2	4604.2	4604.2	4604.2
6°	4413.8	4413.8	4413.8	4413.8	4413.8
7°	4187.0	4187.0	4187.0	4187.0	4187.0
8°	3939.1	3939.1	3939.1	3939.1	3939.1
9°	3677.2	3677.2	3677.2	3677.2	3677.2
10°	3414.0	3414.0	3414.0	3414.0	3414.0
11°	3146.5	3146.5	3146.5	3146.5	3146.5
12°	2891.7	2891.7	2891.7	2891.7	2891.7
13°	2641.0	2641.0	2641.0	2641.0	2641.0
14°	2401.5	2401.5	2401.5	2401.5	2401.5
15°	2174.7	2174.7	2174.7	2174.7	2174.7
16°	1971.9	1971.9	1971.9	1971.9	1971.9
17°	1769.2	1769.2	1769.2	1769.2	1769.2
18°	1587.7	1587.7	1587.7	1587.7	1587.7
19°	1427.5	1427.5	1427.5	1427.5	1427.5
20°	1267.3	1267.3	1267.3	1267.3	1267.3
21°	1148.5	1148.5	1148.5	1148.5	1148.5
22°	1029.8	1029.8	1029.8	1029.8	1029.8
23°	928.7	928.7	928.7	928.7	928.7
24°	845.2	845.2	845.2	845.2	845.2
25°	761.8	761.8	761.8	761.8	761.8
26°	697.4	697.4	697.4	697.4	697.4
27°	632.9	632.9	632.9	632.9	632.9
28°	573.0	573.0	573.0	573.0	573.0
29°	517.6	517.6	517.6	517.6	517.6
30°	462.1	462.1	462.1	462.1	462.1
31°	412.3	412.3	412.3	412.3	412.3
32°	362.4	362.4	362.4	362.4	362.4
33°	315.6	315.6	315.6	315.6	315.6
34°	271.9	271.9	271.9	271.9	271.9
35°	228.3	228.3	228.3	228.3	228.3
36°	194.6	194.6	194.6	194.6	194.6
37°	161.0	161.0	161.0	161.0	161.0
38°	132.5	132.5	132.5	132.5	132.5
39°	108.9	108.9	108.9	108.9	108.9
40°	85.4	85.4	85.4	85.4	85.4
41°	70.3	70.3	70.3	70.3	70.3
42°	55.2	55.2	55.2	55.2	55.2
43°	43.4	43.4	43.4	43.4	43.4
44°	35.0	35.0	35.0	35.0	35.0

TEST NUMBER: P1057403

CATALOG NUMBER: PRLX-CYL2W-DR-X-927-15L-NF-U-S-X-X-BLAK

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
45°	26.6	26.6	26.6	26.6	26.6
46°	22.7	22.7	22.7	22.7	22.7
47°	18.8	18.8	18.8	18.8	18.8
48°	16.0	16.0	16.0	16.0	16.0
49°	14.3	14.3	14.3	14.3	14.3
50°	12.6	12.6	12.6	12.6	12.6
51°	11.5	11.5	11.5	11.5	11.5
52°	10.4	10.4	10.4	10.4	10.4
53°	9.2	9.2	9.2	9.2	9.2
54°	8.1	8.1	8.1	8.1	8.1
55°	7.0	7.0	7.0	7.0	7.0
56°	6.4	6.4	6.4	6.4	6.4
57°	5.9	5.9	5.9	5.9	5.9
58°	5.6	5.6	5.6	5.6	5.6
59°	5.6	5.6	5.6	5.6	5.6
60°	5.6	5.6	5.6	5.6	5.6
61°	5.0	5.0	5.0	5.0	5.0
62°	4.5	4.5	4.5	4.5	4.5
63°	3.9	3.9	3.9	3.9	3.9
64°	3.4	3.4	3.4	3.4	3.4
65°	2.8	2.8	2.8	2.8	2.8
66°	2.8	2.8	2.8	2.8	2.8
67°	2.8	2.8	2.8	2.8	2.8
68°	2.5	2.5	2.5	2.5	2.5
69°	2.0	2.0	2.0	2.0	2.0
70°	1.4	1.4	1.4	1.4	1.4
71°	1.4	1.4	1.4	1.4	1.4
72°	1.4	1.4	1.4	1.4	1.4
73°	1.4	1.4	1.4	1.4	1.4
74°	1.4	1.4	1.4	1.4	1.4
75°	1.4	1.4	1.4	1.4	1.4
76°	0.8	0.8	0.8	0.8	0.8
77°	0.3	0.3	0.3	0.3	0.3
78°	0.0	0.0	0.0	0.0	0.0
79°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
81°	0.0	0.0	0.0	0.0	0.0
82°	0.0	0.0	0.0	0.0	0.0
83°	0.0	0.0	0.0	0.0	0.0
84°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
86°	0.0	0.0	0.0	0.0	0.0
87°	0.0	0.0	0.0	0.0	0.0
88°	0.0	0.0	0.0	0.0	0.0
89°	0.0	0.0	0.0	0.0	0.0



TEST NUMBER: P1057403
CATALOG NUMBER: PRLX-CYL2W-DR-X-927-15L-NF-U-S-X-X-BLAK

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
90°	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P1057403

CATALOG NUMBER: PRLX-CYL2W-DR-X-927-15L-NF-U-S-X-X-BLAK

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.59	7.50	6.96	7.81	8.13	6.59	7.50	6.96	7.81	8.13
	3H	7.26	8.06	7.64	8.39	8.76	7.26	8.06	7.64	8.39	8.76
	4H	7.50	8.24	7.91	8.59	8.98	7.50	8.24	7.91	8.59	8.98
	6H	7.39	8.06	7.81	8.44	8.83	7.39	8.06	7.81	8.44	8.83
	8H	7.33	7.96	7.76	8.35	8.76	7.33	7.96	7.76	8.35	8.76
	12H	7.26	7.86	7.70	8.25	8.68	7.26	7.86	7.70	8.25	8.68
4H	2H	6.68	7.42	7.09	7.77	8.16	6.68	7.42	7.09	7.77	8.16
	3H	7.42	8.02	7.84	8.43	8.84	7.42	8.02	7.84	8.43	8.84
	4H	7.76	8.29	8.20	8.72	9.17	7.76	8.29	8.20	8.72	9.17
	6H	7.64	8.10	8.11	8.55	9.03	7.64	8.10	8.11	8.55	9.03
	8H	7.56	7.99	8.04	8.44	8.92	7.56	7.99	8.04	8.44	8.92
	12H	7.50	7.86	7.99	8.35	8.83	7.50	7.86	7.99	8.35	8.83
8H	4H	7.68	8.10	8.16	8.55	9.03	7.68	8.10	8.16	8.55	9.03
	6H	7.55	7.88	8.06	8.39	8.87	7.55	7.88	8.06	8.39	8.87
	8H	7.47	7.77	8.01	8.29	8.79	7.47	7.77	8.01	8.29	8.79
	12H	7.42	7.67	7.94	8.17	8.75	7.42	7.67	7.94	8.17	8.75
12H	4H	7.61	7.97	8.10	8.46	8.94	7.61	7.97	8.10	8.46	8.94
	6H	7.47	7.77	8.01	8.29	8.79	7.47	7.77	8.01	8.29	8.79
	8H	7.42	7.67	7.94	8.17	8.75	7.42	7.67	7.94	8.17	8.75

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

PrentaLux 3D Printing

Report Number: SP1-2504-407-1

Test Date: 07/16/2025

Luminaire Tested: PRLX-CYL2-X-927-10L-FL-U-S-X-X-BLAK

Data in this report applies to families of products including PRLX-CYL2-X-927-10L-FL-U-S-X-X-BLAK


Test Information

Test Method: LM-79-2019
 Report Number: SP1-2504-407-1
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 07/30/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: PentaLux 3D Printing
 Catalog Number: **PRLX-CYL2-X-927-10L-FL-U-S-X-X-BLAK**
 Description: PentaLux 2-INCH CYLINDER, BLACK TRIM, FLOOD OPTIC, 1000 LUMENS, 2700K

Spectral Parameters

CCT (K): 2742
 CIE u' : 0.2602
 CIE v' : 0.5287
 Duv: 0.0015
 CIE x: 0.4591
 CIE y: 0.4146
 CIE z: 0.1264
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 583
 Purity: 62.24215
 R_f: 91.5
 R_g: 100.2

CRI (Ra): 93.2
 R1: 94.5
 R2: 95.6
 R3: 95.5
 R4: 95.6
 R5: 93.8
 R6: 96.5
 R7: 92.3
 R8: 81.6
 R9: 55.9
 R10: 87.9
 R11: 97.0
 R12: 84.0
 R13: 94.5
 R14: 96.0
 R15: 88.9

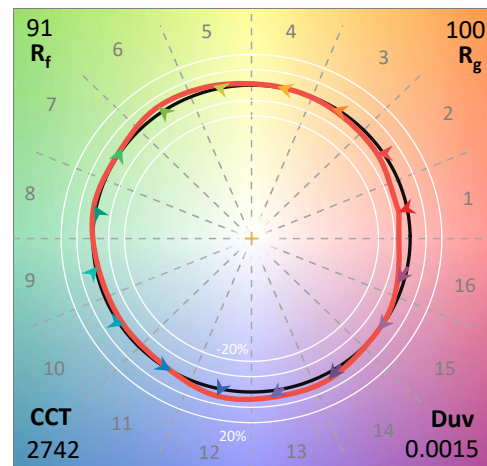

Test Conditions


Stabilization Time: 41M
 Operation Time: 1H 41M
 Sphere Temperature (°C): 24.0

REPORT NUMBER: SP1-2504-407-1


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2504-407-1

CIE 1931 Chromaticity Diagram

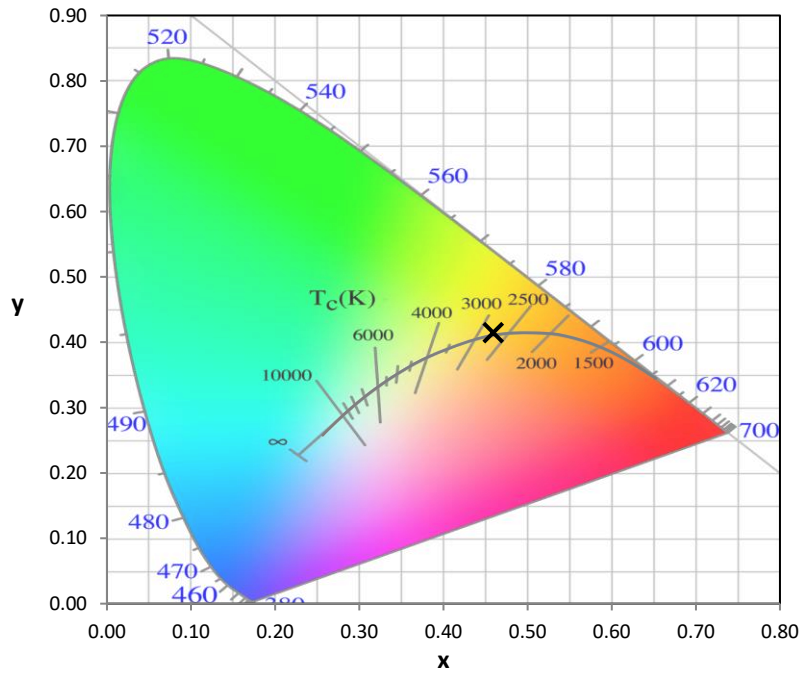


CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

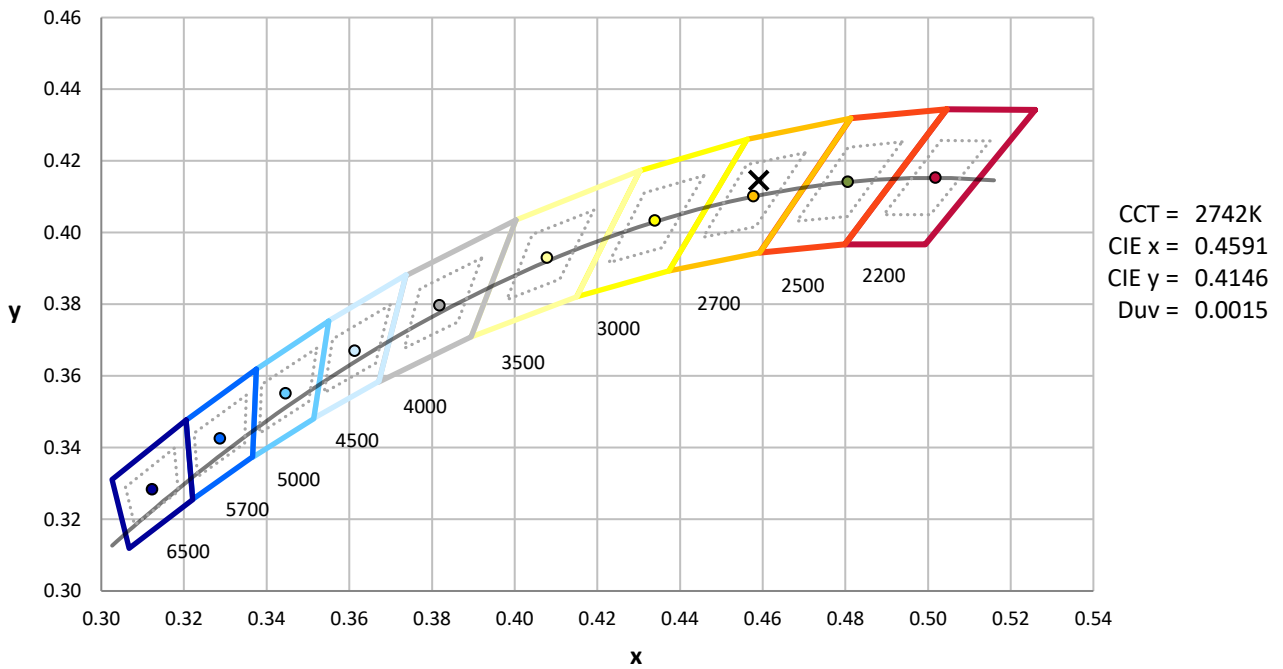

Point lies inside the ANSI 2700K 4-step quadrangle

REPORT NUMBER: SP1-2504-407-1

Photopic Flux vs. Wavelength

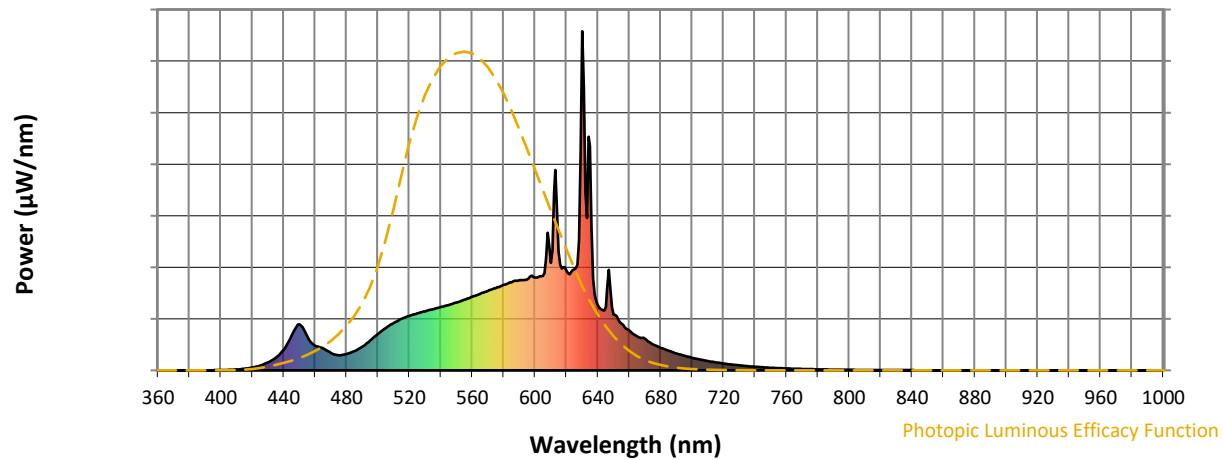


Photopic Lumens: NR

λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	70	NR	620	293	NR	750	8	NR	880	0	NR
365	0	NR	495	88	NR	625	299	NR	755	7	NR	885	0	NR
370	0	NR	500	108	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	125	NR	635	661	NR	765	5	NR	895	0	NR
380	0	NR	510	140	NR	640	192	NR	770	4	NR	900	0	NR
385	0	NR	515	152	NR	645	187	NR	775	4	NR	905	0	NR
390	0	NR	520	160	NR	650	164	NR	780	3	NR	910	0	NR
395	0	NR	525	168	NR	655	138	NR	785	3	NR	915	0	NR
400	1	NR	530	174	NR	660	118	NR	790	2	NR	920	0	NR
405	2	NR	535	180	NR	665	100	NR	795	2	NR	925	0	NR
410	3	NR	540	187	NR	670	94	NR	800	2	NR	930	0	NR
415	5	NR	545	193	NR	675	77	NR	805	1	NR	935	0	NR
420	9	NR	550	200	NR	680	67	NR	810	1	NR	940	0	NR
425	14	NR	555	208	NR	685	58	NR	815	1	NR	945	0	NR
430	23	NR	560	217	NR	690	50	NR	820	1	NR	950	0	NR
435	38	NR	565	226	NR	695	43	NR	825	1	NR	955	0	NR
440	61	NR	570	234	NR	700	37	NR	830	1	NR	960	0	NR
445	103	NR	575	243	NR	705	32	NR	835	1	NR	965	0	NR
450	135	NR	580	252	NR	710	28	NR	840	1	NR	970	0	NR
455	100	NR	585	260	NR	715	23	NR	845	0	NR	975	0	NR
460	72	NR	590	266	NR	720	20	NR	850	0	NR	980	0	NR
465	65	NR	595	268	NR	725	17	NR	855	0	NR	985	0	NR
470	51	NR	600	274	NR	730	15	NR	860	0	NR	990	0	NR
475	45	NR	605	278	NR	735	13	NR	865	0	NR	995	0	NR
480	48	NR	610	317	NR	740	11	NR	870	0	NR	1000	0	NR
485	57	NR	615	350	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP1-2504-407-1

Scotopic Flux vs. Wavelength

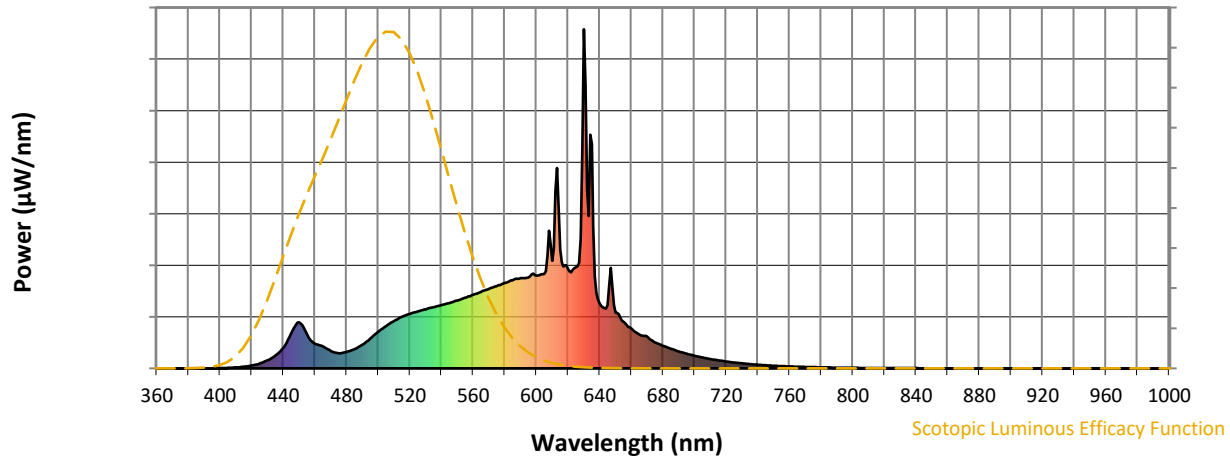


Scotopic Lumens: NR

S/P: 1.28

λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	70	NR	620	293	NR	750	8	NR	880	0	NR
365	0	NR	495	88	NR	625	299	NR	755	7	NR	885	0	NR
370	0	NR	500	108	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	125	NR	635	661	NR	765	5	NR	895	0	NR
380	0	NR	510	140	NR	640	192	NR	770	4	NR	900	0	NR
385	0	NR	515	152	NR	645	187	NR	775	4	NR	905	0	NR
390	0	NR	520	160	NR	650	164	NR	780	3	NR	910	0	NR
395	0	NR	525	168	NR	655	138	NR	785	3	NR	915	0	NR
400	1	NR	530	174	NR	660	118	NR	790	2	NR	920	0	NR
405	2	NR	535	180	NR	665	100	NR	795	2	NR	925	0	NR
410	3	NR	540	187	NR	670	94	NR	800	2	NR	930	0	NR
415	5	NR	545	193	NR	675	77	NR	805	1	NR	935	0	NR
420	9	NR	550	200	NR	680	67	NR	810	1	NR	940	0	NR
425	14	NR	555	208	NR	685	58	NR	815	1	NR	945	0	NR
430	23	NR	560	217	NR	690	50	NR	820	1	NR	950	0	NR
435	38	NR	565	226	NR	695	43	NR	825	1	NR	955	0	NR
440	61	NR	570	234	NR	700	37	NR	830	1	NR	960	0	NR
445	103	NR	575	243	NR	705	32	NR	835	1	NR	965	0	NR
450	135	NR	580	252	NR	710	28	NR	840	1	NR	970	0	NR
455	100	NR	585	260	NR	715	23	NR	845	0	NR	975	0	NR
460	72	NR	590	266	NR	720	20	NR	850	0	NR	980	0	NR
465	65	NR	595	268	NR	725	17	NR	855	0	NR	985	0	NR
470	51	NR	600	274	NR	730	15	NR	860	0	NR	990	0	NR
475	45	NR	605	278	NR	735	13	NR	865	0	NR	995	0	NR
480	48	NR	610	317	NR	740	11	NR	870	0	NR	1000	0	NR
485	57	NR	615	350	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP1-2504-407-1

Melanopic Flux vs. Wavelength

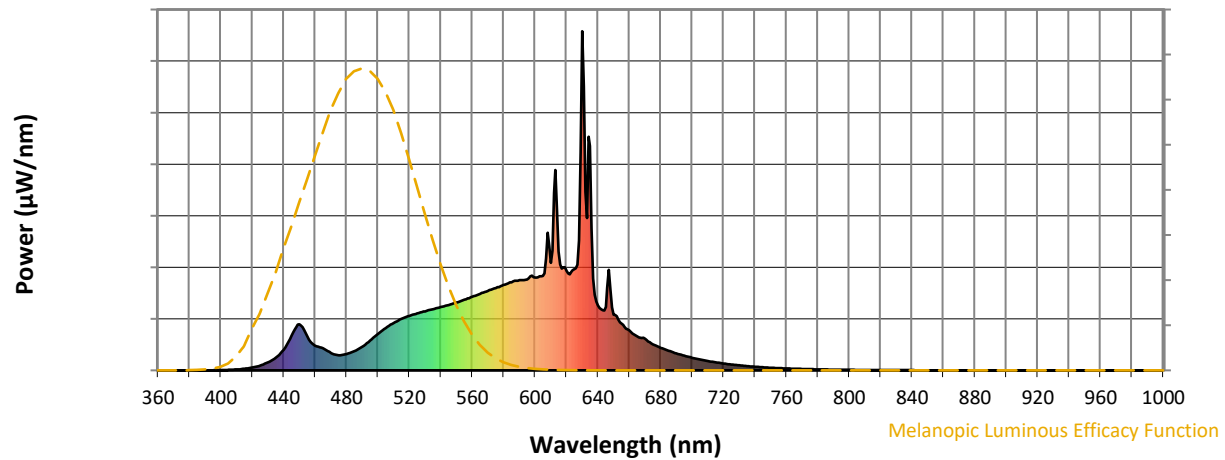

Melanopic Lumens: NR

M/P: 2.38


λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	70	NR	620	293	NR	750	8	NR	880	0	NR
365	0	NR	495	88	NR	625	299	NR	755	7	NR	885	0	NR
370	0	NR	500	108	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	125	NR	635	661	NR	765	5	NR	895	0	NR
380	0	NR	510	140	NR	640	192	NR	770	4	NR	900	0	NR
385	0	NR	515	152	NR	645	187	NR	775	4	NR	905	0	NR
390	0	NR	520	160	NR	650	164	NR	780	3	NR	910	0	NR
395	0	NR	525	168	NR	655	138	NR	785	3	NR	915	0	NR
400	1	NR	530	174	NR	660	118	NR	790	2	NR	920	0	NR
405	2	NR	535	180	NR	665	100	NR	795	2	NR	925	0	NR
410	3	NR	540	187	NR	670	94	NR	800	2	NR	930	0	NR
415	5	NR	545	193	NR	675	77	NR	805	1	NR	935	0	NR
420	9	NR	550	200	NR	680	67	NR	810	1	NR	940	0	NR
425	14	NR	555	208	NR	685	58	NR	815	1	NR	945	0	NR
430	23	NR	560	217	NR	690	50	NR	820	1	NR	950	0	NR
435	38	NR	565	226	NR	695	43	NR	825	1	NR	955	0	NR
440	61	NR	570	234	NR	700	37	NR	830	1	NR	960	0	NR
445	103	NR	575	243	NR	705	32	NR	835	1	NR	965	0	NR
450	135	NR	580	252	NR	710	28	NR	840	1	NR	970	0	NR
455	100	NR	585	260	NR	715	23	NR	845	0	NR	975	0	NR
460	72	NR	590	266	NR	720	20	NR	850	0	NR	980	0	NR
465	65	NR	595	268	NR	725	17	NR	855	0	NR	985	0	NR
470	51	NR	600	274	NR	730	15	NR	860	0	NR	990	0	NR
475	45	NR	605	278	NR	735	13	NR	865	0	NR	995	0	NR
480	48	NR	610	317	NR	740	11	NR	870	0	NR	1000	0	NR
485	57	NR	615	350	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP1-2504-407-1





TM-30-18

Summary

$R_f = 91.5$
 $R_g = 100.2$
 $CIE\ R_a = 93.2$
 $R_9 = 55.9$

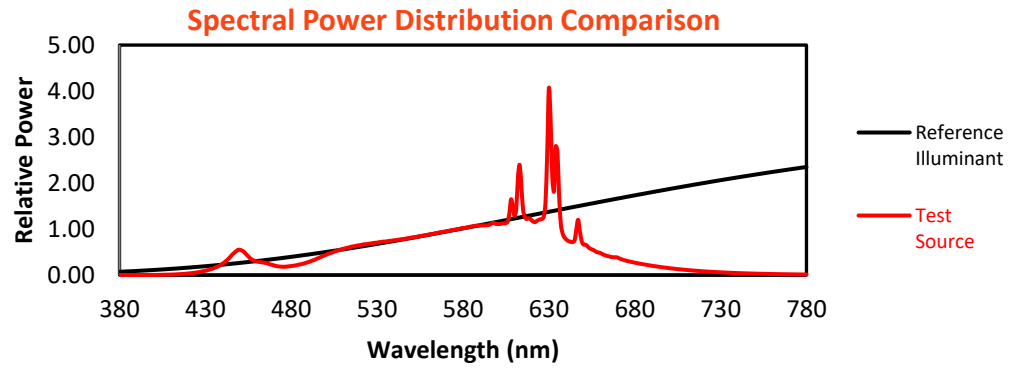





Color Vector Graphics

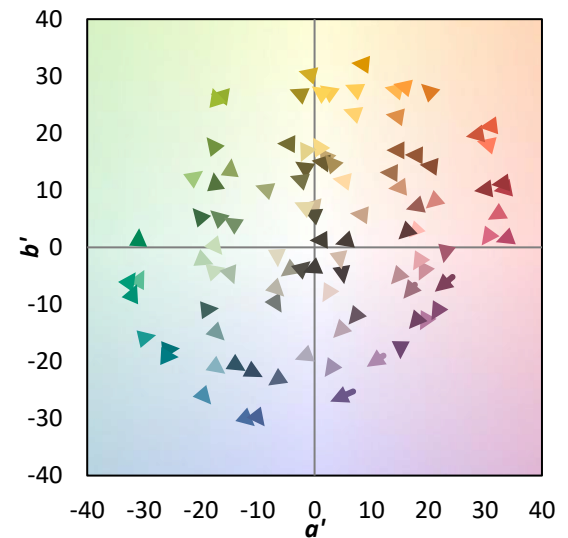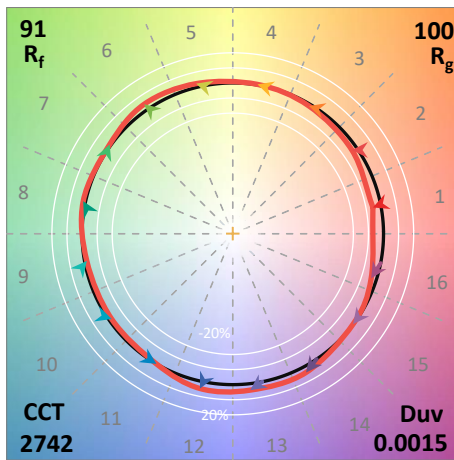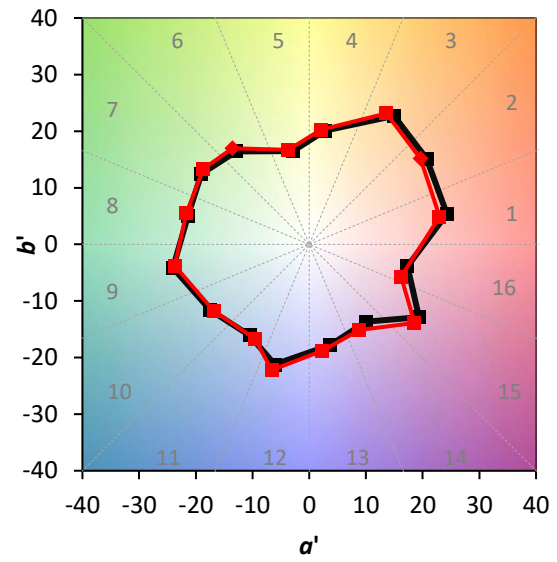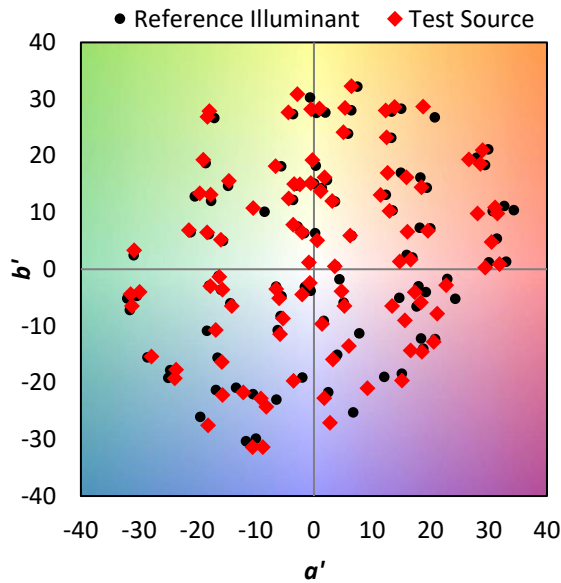



Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 86	CES26 = 92	CES51 = 97	CES76 = 89
CES02 = 64	CES27 = 96	CES52 = 97	CES77 = 85
CES03 = 32	CES28 = 96	CES53 = 94	CES78 = 87
CES04 = 70	CES29 = 91	CES54 = 99	CES79 = 88
CES05 = 51	CES30 = 96	CES55 = 99	CES80 = 91
CES06 = 51	CES31 = 92	CES56 = 94	CES81 = 69
CES07 = 44	CES32 = 85	CES57 = 93	CES82 = 96
CES08 = 43	CES33 = 92	CES58 = 94	CES83 = 93
CES09 = 29	CES34 = 94	CES59 = 98	CES84 = 96
CES10 = 77	CES35 = 97	CES60 = 97	CES85 = 80
CES11 = 59	CES36 = 91	CES61 = 97	CES86 = 76
CES12 = 66	CES37 = 93	CES62 = 96	CES87 = 92
CES13 = 44	CES38 = 100	CES63 = 93	CES88 = 96
CES14 = 74	CES39 = 97	CES64 = 95	CES89 = 81
CES15 = 72	CES40 = 94	CES65 = 90	CES90 = 97
CES16 = 48	CES41 = 94	CES66 = 93	CES91 = 86
CES17 = 50	CES42 = 92	CES67 = 92	CES92 = 78
CES18 = 57	CES43 = 92	CES68 = 93	CES93 = 87
CES19 = 72	CES44 = 99	CES69 = 95	CES94 = 71
CES20 = 68	CES45 = 95	CES70 = 90	CES95 = 86
CES21 = 87	CES46 = 94	CES71 = 90	CES96 = 92
CES22 = 79	CES47 = 86	CES72 = 96	CES97 = 93
CES23 = 92	CES48 = 93	CES73 = 86	CES98 = 92
CES24 = 91	CES49 = 93	CES74 = 89	CES99 = 91
CES25 = 72	CES50 = 97	CES75 = 90	

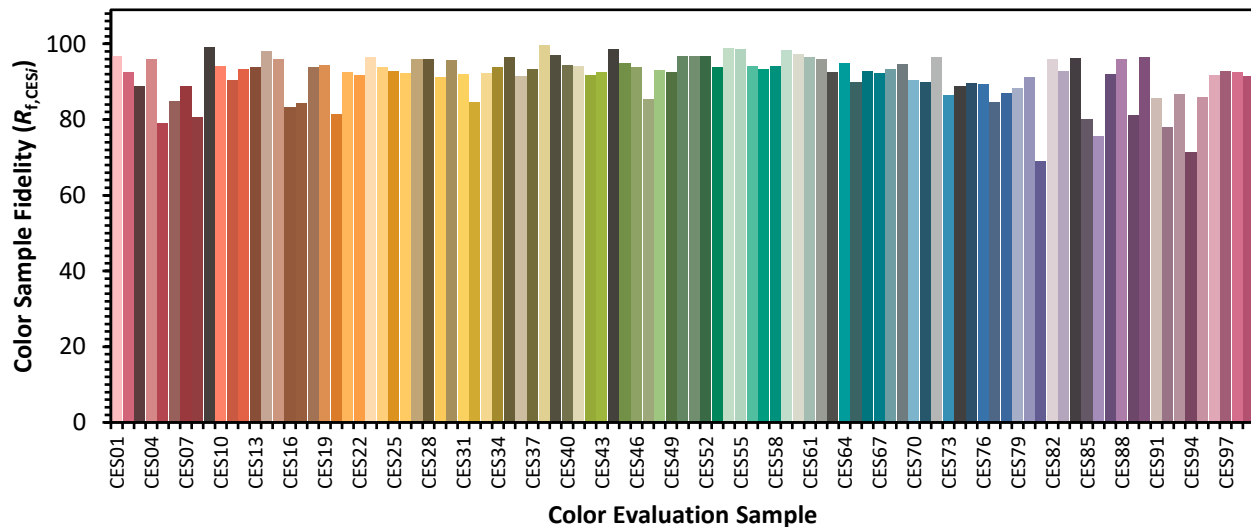

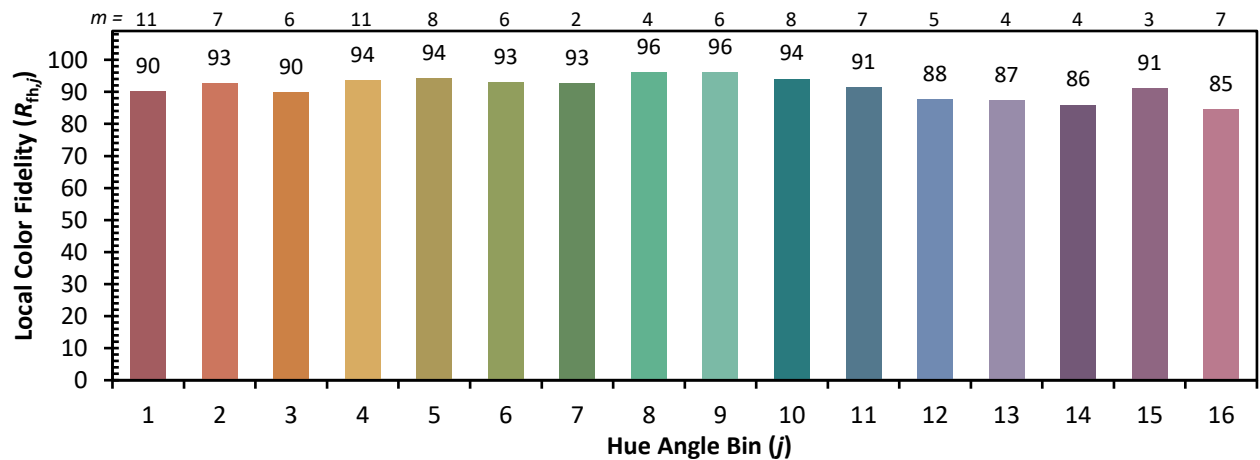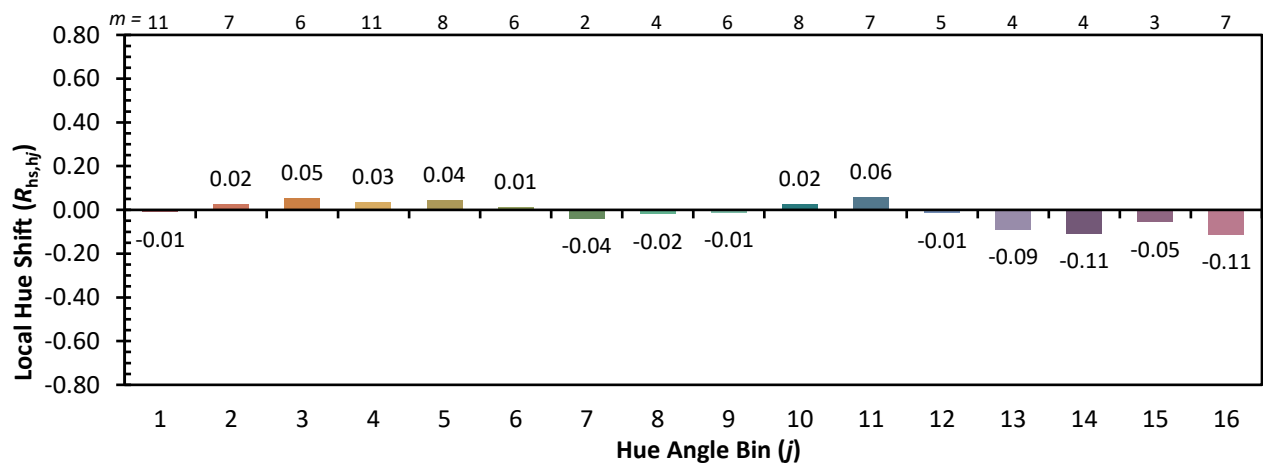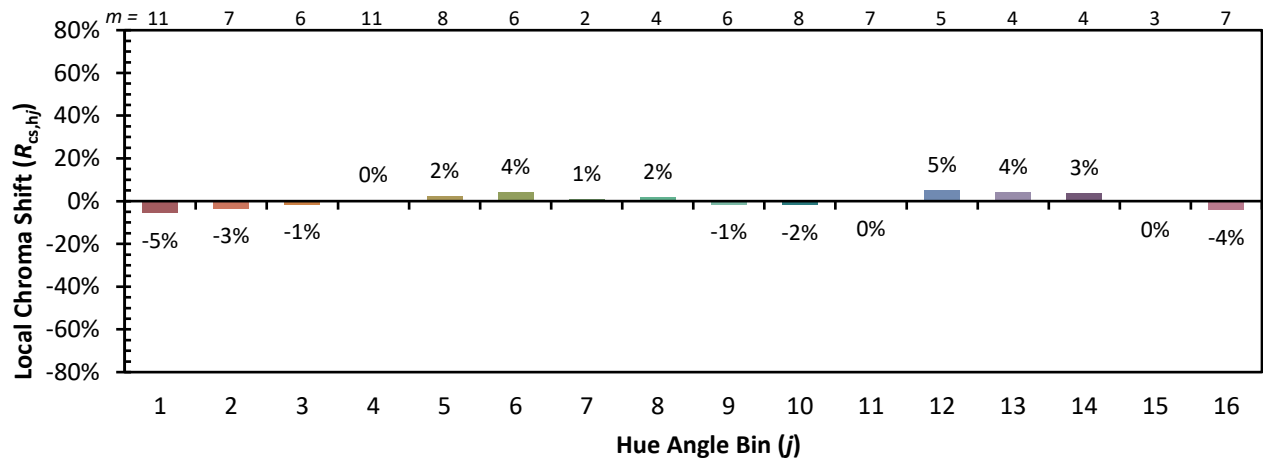Color Rendition by Hue-Angle Bin


Measure Comparisons

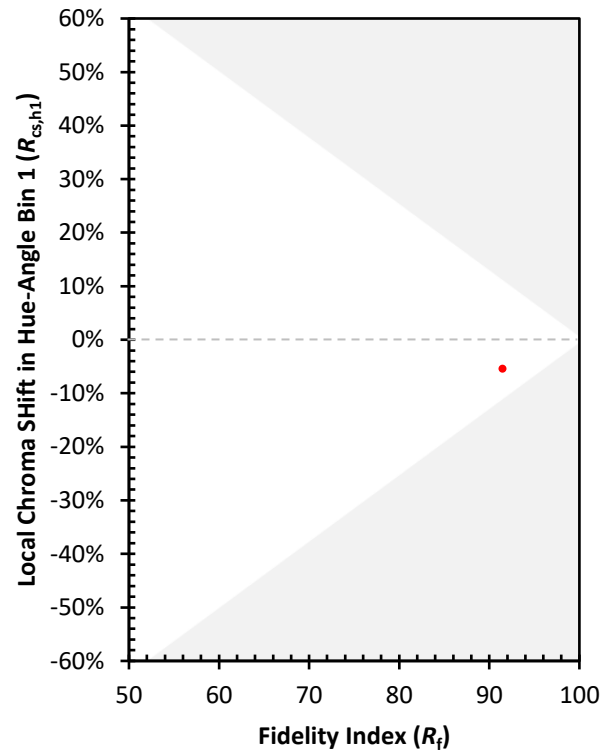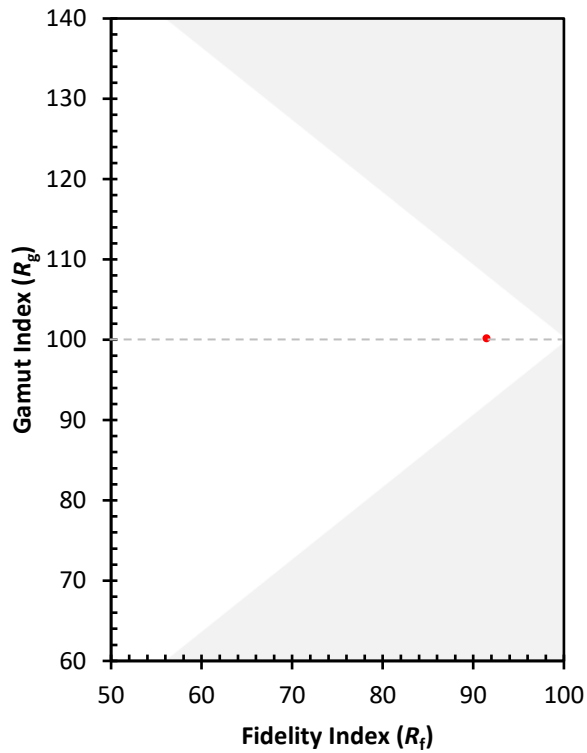

(END OF REPORT)