

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P981009

Luminaire Tested: PRLX-CYL3-10-930-10L-FL-U-S-X-X-WHTE

Issue Date: 4/11/2025

Test Information

Test Method: LM-79-2019
Report Number: P981009
TEST IS SCALED FROM (FO44194.PSO)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 4/11/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-CYL3-10-930-10L-FL-U-S-X-X-WHTE
Description: PrentaLux 3-INCH CYLINDER, FLOOD OPTIC
1000 LUMENS
Light Source: 3000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 914.9 lumens
Efficiency: N/A
Efficacy: 96.3 lumens/watt
Spacing Criteria (0/90/45): 0.56 / 0.56 / 0.62
Luminous Opening: Circular (Dia: 0.25' x H: 0')
CIE Type: Direct

Input Watts (W): 9.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P981009

CATALOG NUMBER: PRLX-CYL3-10-930-10L-FL-U-S-X-X-WHTE

Luminous Intensity Polar Plot

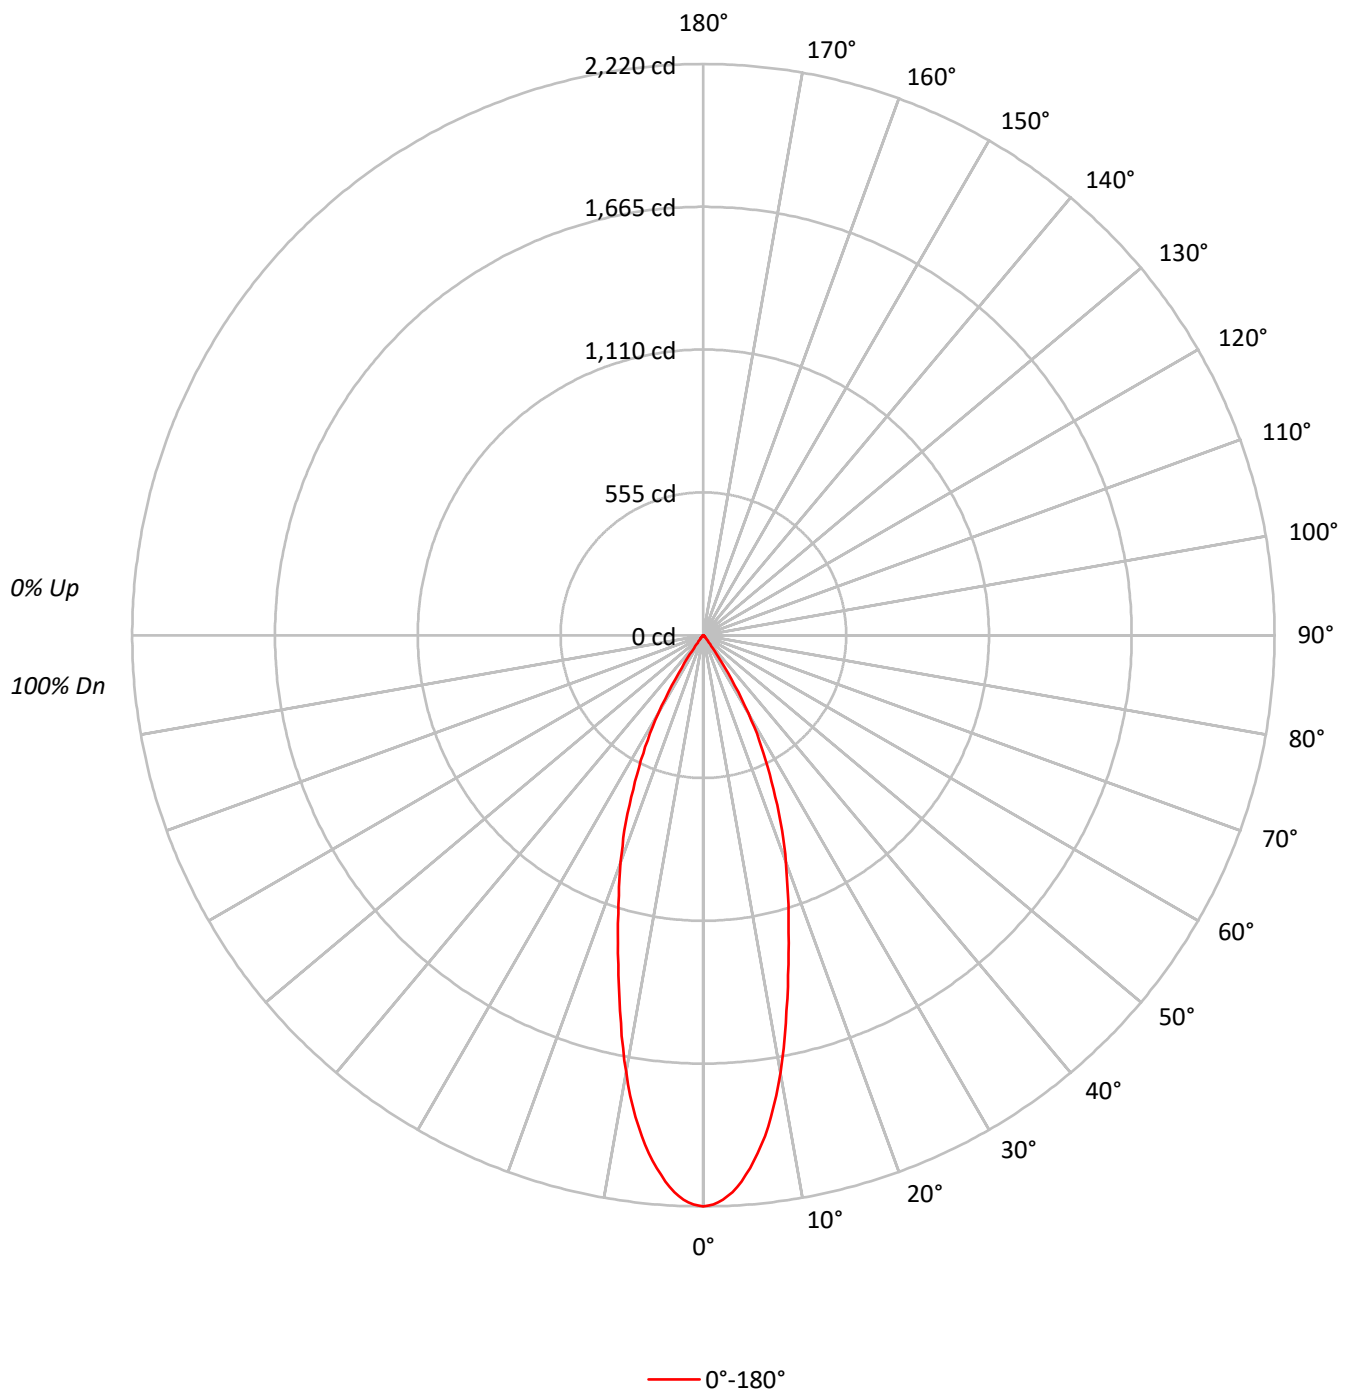

TEST NUMBER: P981009

CATALOG NUMBER: PRLX-CYL3-10-930-10L-FL-U-S-X-X-WHITE

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	99	98	97
2	110	106	102	99	108	104	101	98	101	98	96	98	96	94	95	94	92
3	106	100	96	93	104	99	95	92	96	93	91	94	91	89	92	90	88
4	101	95	91	87	100	94	90	87	92	88	86	90	87	85	88	86	84
5	98	91	86	82	96	90	85	82	88	84	81	87	83	81	85	82	80
6	94	87	82	78	93	86	81	78	84	80	77	83	80	77	82	79	76
7	90	83	78	74	89	82	77	74	81	77	74	80	76	73	79	76	73
8	87	79	74	71	86	79	74	71	78	74	71	77	73	70	76	73	70
9	84	76	71	68	83	76	71	68	75	70	68	74	70	67	73	70	67
10	81	73	68	65	80	73	68	65	72	68	65	71	67	65	71	67	64

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	486847
5°	457868
10°	384607
15°	290671
20°	219096
25°	152041
30°	88495
35°	24253
40°	5611
45°	1768
50°	1092
55°	765
60°	614
65°	519
70°	577
75°	593
80°	758
85°	755

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1768 cd/sqm

TEST NUMBER: P981009

CATALOG NUMBER: PRLX-CYL3-10-930-10L-FL-U-S-X-X-WHTE

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	187.3	20.5
10°-20°	356.5	39.0
20°-30°	286.2	31.3
30°-40°	74.8	8.2
40°-50°	5.9	0.6
50°-60°	1.9	0.2
60°-70°	1.0	0.1
70°-80°	0.8	0.1
80°-90°	0.3	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	830.1	90.7
0°-40°	904.9	98.9
0°-60°	912.7	99.8
0°-90°	914.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	914.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2220	
5°	2080	187
15°	1280	357
25°	628	286
35°	91	75
45°	6	6
55°	2	2
65°	1	1
75°	1	1
85°	0	0
90°	0	

TEST NUMBER: P981009

CATALOG NUMBER: PRLX-CYL3-10-930-10L-FL-U-S-X-X-WHTE

CANDELA DISTRIBUTION (FULL):

0°	
0°	2220.2
1°	2213.9
2°	2195.8
3°	2167.3
4°	2127.9
5°	2080.1
6°	2024.8
7°	1961.4
8°	1890.8
9°	1813.0
10°	1727.3
11°	1636.2
12°	1542.2
13°	1449.3
14°	1362.6
15°	1280.4
16°	1204.3
17°	1131.7
18°	1064.0
19°	1000.1
20°	938.9
21°	877.9
22°	818.6
23°	752.5
24°	689.0
25°	628.4
26°	570.7
27°	514.6
28°	462.3
29°	408.4
30°	349.5
31°	288.7
32°	230.2
33°	176.6
34°	129.4
35°	90.6
36°	62.4
37°	42.4
38°	30.6
39°	24.4
40°	19.6
41°	15.6
42°	12.3
43°	9.4
44°	7.3

TEST NUMBER: P981009

CATALOG NUMBER: PRLX-CYL3-10-930-10L-FL-U-S-X-X-WHTE

CANDELA DISTRIBUTION (continued):

	0°
45°	5.7
46°	5.0
47°	4.5
48°	4.0
49°	3.6
50°	3.2
51°	2.9
52°	2.6
53°	2.4
54°	2.2
55°	2.0
56°	1.8
57°	1.7
58°	1.6
59°	1.4
60°	1.4
61°	1.3
62°	1.2
63°	1.1
64°	1.1
65°	1.0
66°	1.0
67°	0.9
68°	0.9
69°	0.9
70°	0.9
71°	0.8
72°	0.8
73°	0.8
74°	0.8
75°	0.7
76°	0.7
77°	0.7
78°	0.7
79°	0.7
80°	0.6
81°	0.6
82°	0.6
83°	0.5
84°	0.4
85°	0.3
86°	0.2
87°	0.1
88°	0.0
89°	0.0

TEST NUMBER: P981009

CATALOG NUMBER: PRLX-CYL3-10-930-10L-FL-U-S-X-X-WHTE

CANDELA DISTRIBUTION (continued):

90° | $\frac{0^\circ}{0.0}$

TEST NUMBER: P981009

CATALOG NUMBER: PRLX-CYL3-10-930-10L-FL-U-S-X-X-WHTE

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.24	0.64	0.00	0.00	0.00	0.24	0.64
	8H	0.00	0.33	0.15	0.73	1.14	0.00	0.33	0.15	0.73	1.14
	12H	0.00	0.51	0.36	0.89	1.33	0.00	0.51	0.36	0.89	1.33
4H	2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.39	0.00	0.00	0.00	0.00	0.39
	6H	0.21	0.65	0.68	1.10	1.58	0.21	0.65	0.68	1.10	1.58
	8H	0.83	1.25	1.31	1.70	2.18	0.83	1.25	1.31	1.70	2.18
	12H	1.15	1.51	1.65	2.00	2.48	1.15	1.51	1.65	2.00	2.48
8H	4H	0.00	0.00	0.00	0.25	0.73	0.00	0.00	0.00	0.25	0.73
	6H	0.86	1.18	1.37	1.69	2.18	0.86	1.18	1.37	1.69	2.18
	8H	1.65	1.94	2.19	2.46	2.96	1.65	1.94	2.19	2.46	2.96
	12H	2.10	2.35	2.63	2.85	3.43	2.10	2.35	2.63	2.85	3.43
12H	4H	0.00	0.00	0.00	0.30	0.78	0.00	0.00	0.00	0.30	0.78
	6H	1.03	1.32	1.57	1.84	2.34	1.03	1.32	1.57	1.84	2.34
	8H	1.90	2.14	2.42	2.64	3.22	1.90	2.14	2.42	2.64	3.22

END OF REPORT