

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P981019

Luminaire Tested: PRLX-CYL3-10-930-23L-SP-U-S-X-X-WHTE

Issue Date: 4/11/2025

Test Information

Test Method: LM-79-2019
Report Number: P981019
TEST IS SCALED FROM (FO44196.PSO)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 4/11/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-CYL3-10-930-23L-SP-U-S-X-X-WHTE
Description: PrentaLux 3-INCH CYLINDER, SPOT OPTIC
2300 LUMENS
Light Source: 3000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 2107.6 lumens
Efficiency: N/A
Efficacy: 93.7 lumens/watt
Spacing Criteria (0/90/45): 0.28 / 0.28 / 0.29
Luminous Opening: Circular (Dia: 0.25' x H: 0')
CIE Type: Direct

Input Watts (W): 22.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P981019

CATALOG NUMBER: PRLX-CYL3-10-930-23L-SP-U-S-X-X-WHTE

Luminous Intensity Polar Plot

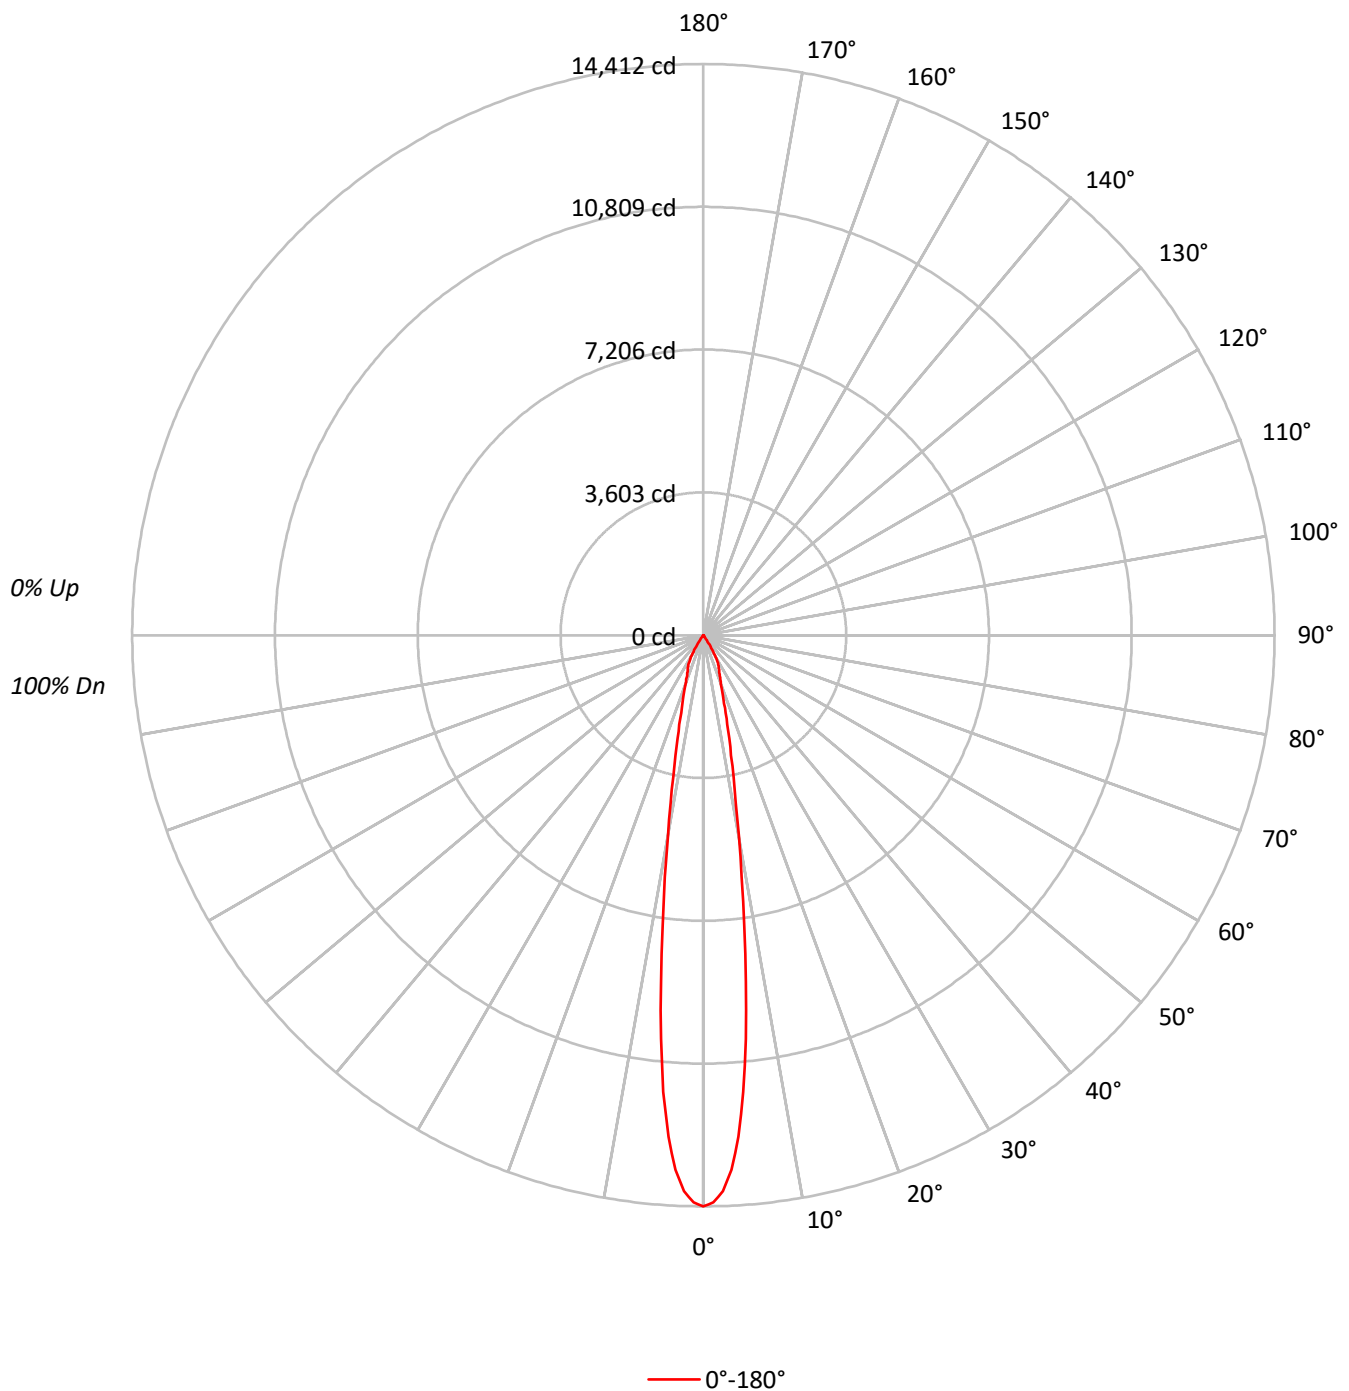

TEST NUMBER: P981019

CATALOG NUMBER: PRLX-CYL3-10-930-23L-SP-U-S-X-X-WHITE

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		0
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		100
1	115	113	111	109	113	111	109	108	107	106	104		103	102	101		97
2	111	108	105	102	109	106	103	101	103	101	99		100	98	97		94
3	108	103	100	97	106	102	99	96	99	97	95		97	95	93		91
4	105	99	95	92	103	98	95	92	96	93	91		94	92	90		88
5	102	96	92	89	100	95	91	88	93	90	88		92	89	87		85
6	99	92	88	85	97	92	88	85	90	87	85		89	86	84		83
7	96	90	85	83	95	89	85	82	88	84	82		87	84	82		80
8	93	87	83	80	92	86	83	80	86	82	80		85	82	79		78
9	91	84	80	78	90	84	80	78	83	80	77		83	79	77		76
10	89	82	78	76	88	82	78	76	81	78	75		81	77	75		74

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	3160207
5°	2547099
10°	1145180
15°	528879
20°	304316
25°	224069
30°	147694
35°	32364
40°	5296
45°	1458
50°	819
55°	612
60°	614
65°	675
70°	705
75°	763
80°	884
85°	1006

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1458 cd/sqm

TEST NUMBER: P981019

CATALOG NUMBER: PRLX-CYL3-10-930-23L-SP-U-S-X-X-WHITE

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	873.9	41.5
10°-20°	688.1	32.6
20°-30°	422.6	20.1
30°-40°	114.1	5.4
40°-50°	4.8	0.2
50°-60°	1.5	0.1
60°-70°	1.3	0.1
70°-80°	1.0	0.0
80°-90°	0.4	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1984.6	94.2
0°-40°	2098.6	99.6
0°-60°	2104.9	99.9
0°-90°	2107.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2107.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	14412	
5°	11572	874
15°	2330	688
25°	926	423
35°	121	114
45°	5	5
55°	2	2
65°	1	1
75°	1	1
85°	0	0
90°	0	

TEST NUMBER: P981019

CATALOG NUMBER: PRLX-CYL3-10-930-23L-SP-U-S-X-X-WHTE

CANDELA DISTRIBUTION (FULL):

0°	
0°	14411.7
1°	14317.6
2°	14037.3
3°	13501.8
4°	12680.3
5°	11571.5
6°	10250.7
7°	8802.5
8°	7414.4
9°	6178.9
10°	5143.1
11°	4310.8
12°	3647.5
13°	3117.9
14°	2685.5
15°	2329.7
16°	2039.8
17°	1800.2
18°	1605.5
19°	1439.7
20°	1304.1
21°	1194.2
22°	1105.1
23°	1032.8
24°	973.9
25°	926.1
26°	882.7
27°	829.1
28°	761.0
29°	676.8
30°	583.3
31°	485.1
32°	384.4
33°	285.3
34°	196.0
35°	120.9
36°	68.5
37°	40.1
38°	30.5
39°	24.5
40°	18.5
41°	13.4
42°	9.1
43°	6.7
44°	5.6

TEST NUMBER: P981019

CATALOG NUMBER: PRLX-CYL3-10-930-23L-SP-U-S-X-X-WHTE

CANDELA DISTRIBUTION (continued):

	0°
45°	4.7
46°	4.1
47°	3.5
48°	3.0
49°	2.7
50°	2.4
51°	2.2
52°	2.0
53°	1.9
54°	1.7
55°	1.6
56°	1.6
57°	1.5
58°	1.4
59°	1.4
60°	1.4
61°	1.4
62°	1.4
63°	1.4
64°	1.4
65°	1.3
66°	1.3
67°	1.2
68°	1.2
69°	1.2
70°	1.1
71°	1.1
72°	1.0
73°	1.0
74°	0.9
75°	0.9
76°	0.8
77°	0.8
78°	0.8
79°	0.8
80°	0.7
81°	0.7
82°	0.7
83°	0.6
84°	0.5
85°	0.4
86°	0.2
87°	0.1
88°	0.0
89°	0.0

TEST NUMBER: P981019

CATALOG NUMBER: PRLX-CYL3-10-930-23L-SP-U-S-X-X-WHTE

CANDELA DISTRIBUTION (continued):

90° | $\frac{0^\circ}{0.0}$

TEST NUMBER: P981019

CATALOG NUMBER: PRLX-CYL3-10-930-23L-SP-U-S-X-X-WHTE

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
4H	2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.28	0.00	0.00	0.00	0.00	0.28
	12H	0.00	0.00	0.00	0.17	0.65	0.00	0.00	0.00	0.17	0.65
8H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.28	0.00	0.00	0.00	0.00	0.28
	8H	0.00	0.07	0.32	0.59	1.09	0.00	0.07	0.32	0.59	1.09
	12H	0.32	0.56	0.85	1.06	1.65	0.32	0.56	0.85	1.06	1.65
12H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.44	0.00	0.00	0.00	0.00	0.44
	8H	0.04	0.28	0.57	0.78	1.37	0.04	0.28	0.57	0.78	1.37

END OF REPORT