

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P981027

Luminaire Tested: PRLX-CYL3-10-935-15L-SP-U-S-X-X-WHTE

Issue Date: 4/11/2025

**Test Information**

Test Method: LM-79-2019  
Report Number: P981027  
TEST IS SCALED FROM ( FO44196.PSO)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 4/11/2025  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PrentaLux  
Catalog Number: PRLX-CYL3-10-935-15L-SP-U-S-X-X-WHTE  
Description: PrentaLux 3-INCH CYLINDER, SPOT OPTIC  
1500 LUMENS  
Light Source: 3500K CCT, 90 CRI LEDS  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1452.2 lumens  
Efficiency: N/A  
Efficacy: 107.6 lumens/watt  
Spacing Criteria (0/90/45): 0.28 / 0.28 / 0.29  
Luminous Opening: Circular (Dia: 0.25' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 13.5  
Input Voltage (V): 120  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P981027

CATALOG NUMBER: PRLX-CYL3-10-935-15L-SP-U-S-X-X-WHTE

### Luminous Intensity Polar Plot

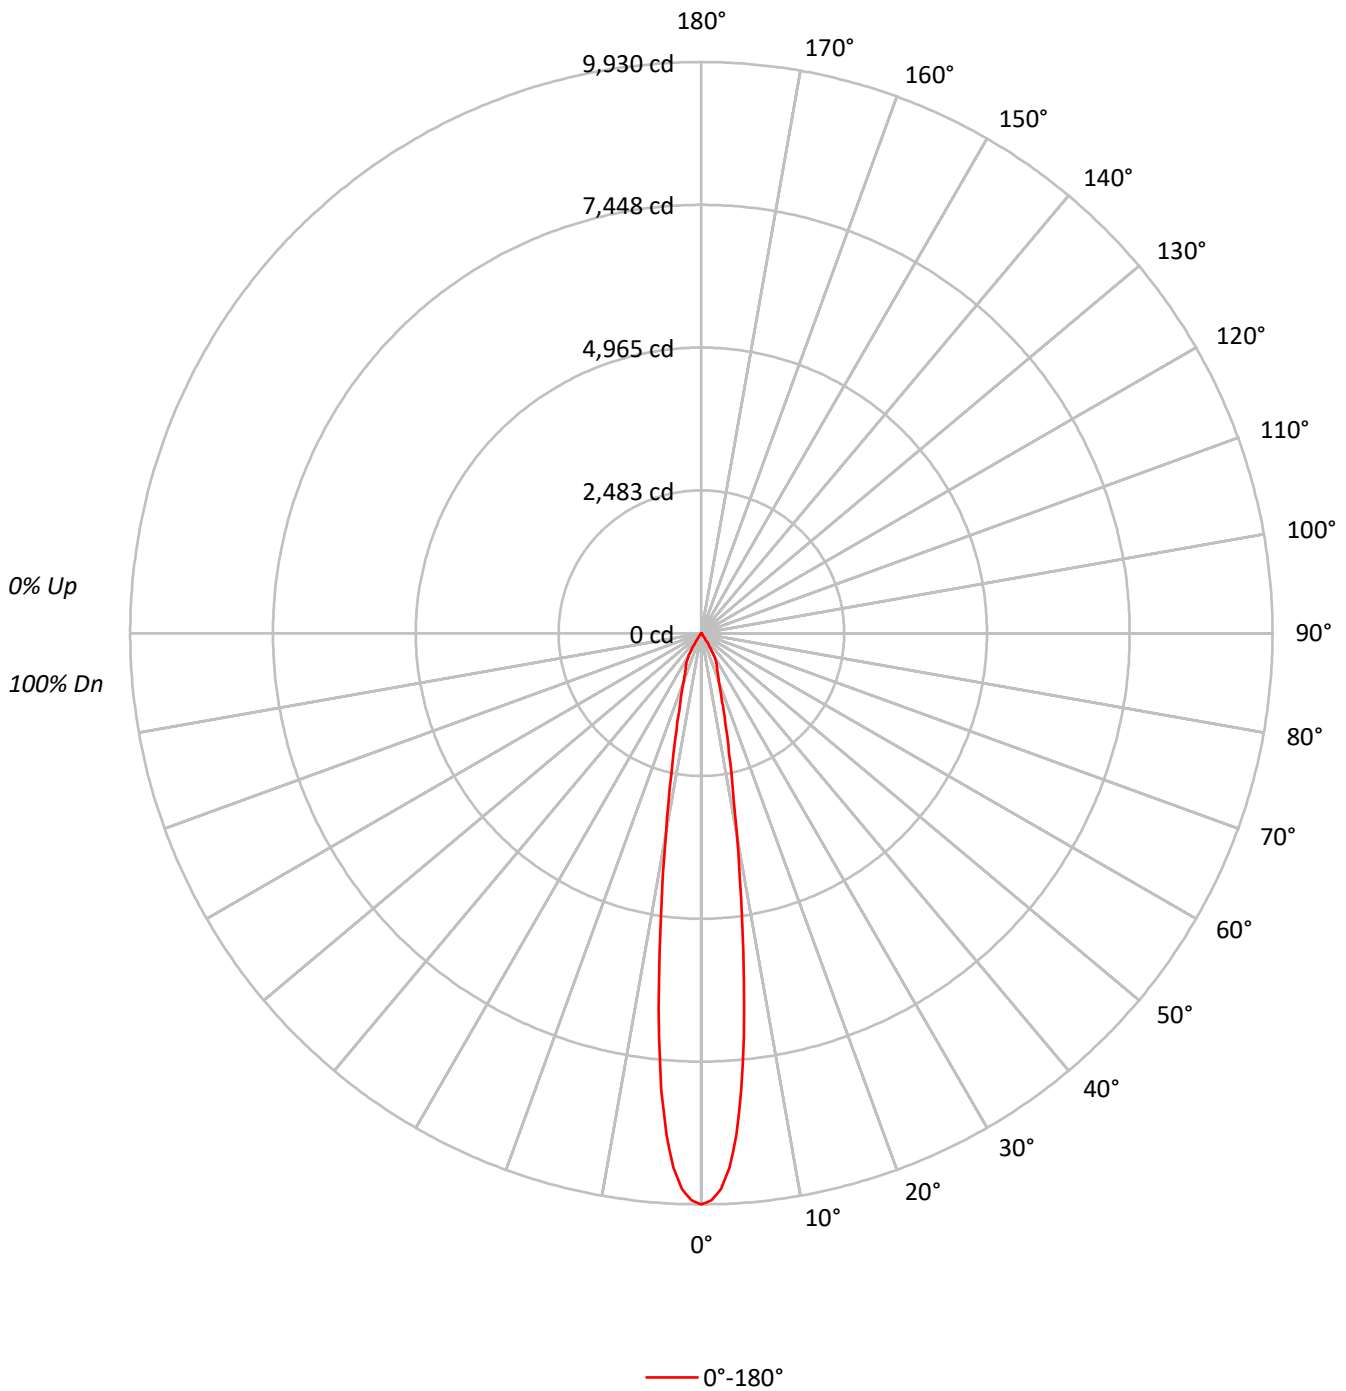



TEST NUMBER: P981027

CATALOG NUMBER: PRLX-CYL3-10-935-15L-SP-U-S-X-X-WHTE

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	97
2	111	108	105	102	109	106	103	101	103	101	99	100	98	97	98	96	95	94
3	108	103	100	97	106	102	99	96	99	97	95	97	95	93	95	93	92	91
4	105	99	95	92	103	98	95	92	96	93	91	94	92	90	93	91	89	88
5	102	96	92	89	100	95	91	88	93	90	88	92	89	87	90	88	86	85
6	99	92	88	85	97	92	88	85	90	87	85	89	86	84	88	86	84	83
7	96	90	85	83	95	89	85	82	88	84	82	87	84	82	86	83	81	80
8	93	87	83	80	92	86	83	80	86	82	80	85	82	79	84	81	79	78
9	91	84	80	78	90	84	80	78	83	80	77	83	79	77	82	79	77	76
10	89	82	78	76	88	82	78	76	81	78	75	81	77	75	80	77	75	74

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	2177391
5°	1754937
10°	789030
15°	364406
20°	209668
25°	154388
30°	101762
35°	22299
40°	3635
45°	992
50°	580
55°	421
60°	439
65°	467
70°	513
75°	508
80°	631
85°	755

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 992 cd/sqm

TEST NUMBER: P981027

CATALOG NUMBER: PRLX-CYL3-10-935-15L-SP-U-S-X-X-WHTE

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	602.1	41.5
10°-20°	474.1	32.6
20°-30°	291.2	20.1
30°-40°	78.6	5.4
40°-50°	3.3	0.2
50°-60°	1.1	0.1
60°-70°	0.9	0.1
70°-80°	0.7	0.0
80°-90°	0.3	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1367.4	94.2
0°-40°	1446.0	99.6
0°-60°	1450.3	99.9
0°-90°	1452.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1452.2	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	9930	
5°	7973	602
15°	1605	474
25°	638	291
35°	83	79
45°	3	3
55°	1	1
65°	1	1
75°	1	1
85°	0	0
90°	0	

TEST NUMBER: P981027

CATALOG NUMBER: PRLX-CYL3-10-935-15L-SP-U-S-X-X-WHITE

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	9929.7
1°	9864.8
2°	9671.7
3°	9302.7
4°	8736.7
5°	7972.7
6°	7062.8
7°	6064.9
8°	5108.5
9°	4257.3
10°	3543.6
11°	2970.1
12°	2513.1
13°	2148.3
14°	1850.3
15°	1605.2
16°	1405.4
17°	1240.4
18°	1106.2
19°	992.0
20°	898.5
21°	822.8
22°	761.4
23°	711.6
24°	671.0
25°	638.1
26°	608.2
27°	571.3
28°	524.3
29°	466.3
30°	401.9
31°	334.2
32°	264.9
33°	196.6
34°	135.0
35°	83.3
36°	47.2
37°	27.6
38°	21.0
39°	16.9
40°	12.7
41°	9.2
42°	6.3
43°	4.6
44°	3.9

TEST NUMBER: P981027

CATALOG NUMBER: PRLX-CYL3-10-935-15L-SP-U-S-X-X-WHITE

**CANDELA DISTRIBUTION (continued):**


	0°
45°	3.2
46°	2.8
47°	2.4
48°	2.1
49°	1.9
50°	1.7
51°	1.5
52°	1.4
53°	1.3
54°	1.2
55°	1.1
56°	1.1
57°	1.0
58°	1.0
59°	1.0
60°	1.0
61°	1.0
62°	1.0
63°	1.0
64°	1.0
65°	0.9
66°	0.9
67°	0.8
68°	0.8
69°	0.8
70°	0.8
71°	0.8
72°	0.7
73°	0.7
74°	0.6
75°	0.6
76°	0.6
77°	0.6
78°	0.6
79°	0.6
80°	0.5
81°	0.5
82°	0.5
83°	0.4
84°	0.3
85°	0.3
86°	0.1
87°	0.1
88°	0.0
89°	0.0



TEST NUMBER: P981027

CATALOG NUMBER: PRLX-CYL3-10-935-15L-SP-U-S-X-X-WHTE

CANDELA DISTRIBUTION (continued):







TEST NUMBER: P981027  
 CATALOG NUMBER: PRLX-CYL3-10-935-15L-SP-U-S-X-X-WHTE

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
4H	2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
8H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.46	0.00	0.00	0.00	0.00	0.46
12H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.23	0.00	0.00	0.00	0.00	0.23