

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P981030

Luminaire Tested: PRLX-CYL3-10-935-23L-MD-U-S-X-X-WHTE

Issue Date: 4/11/2025

Test Information

Test Method: LM-79-2019
Report Number: P981030
TEST IS SCALED FROM (FO44193.PSO)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 4/11/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-CYL3-10-935-23L-MD-U-S-X-X-WHTE
Description: PrentaLux 3-INCH CYLINDER, MEDIUM OPTIC
2300 LUMENS
Light Source: 3500K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 2446.8 lumens
Efficiency: N/A
Efficacy: 108.7 lumens/watt
Spacing Criteria (0/90/45): 0.32 / 0.32 / 0.37
Luminous Opening: Circular (Dia: 0.25' x H: 0')
CIE Type: Direct

Input Watts (W): 22.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P981030

CATALOG NUMBER: PRLX-CYL3-10-935-23L-MD-U-S-X-X-WHTE

Luminous Intensity Polar Plot

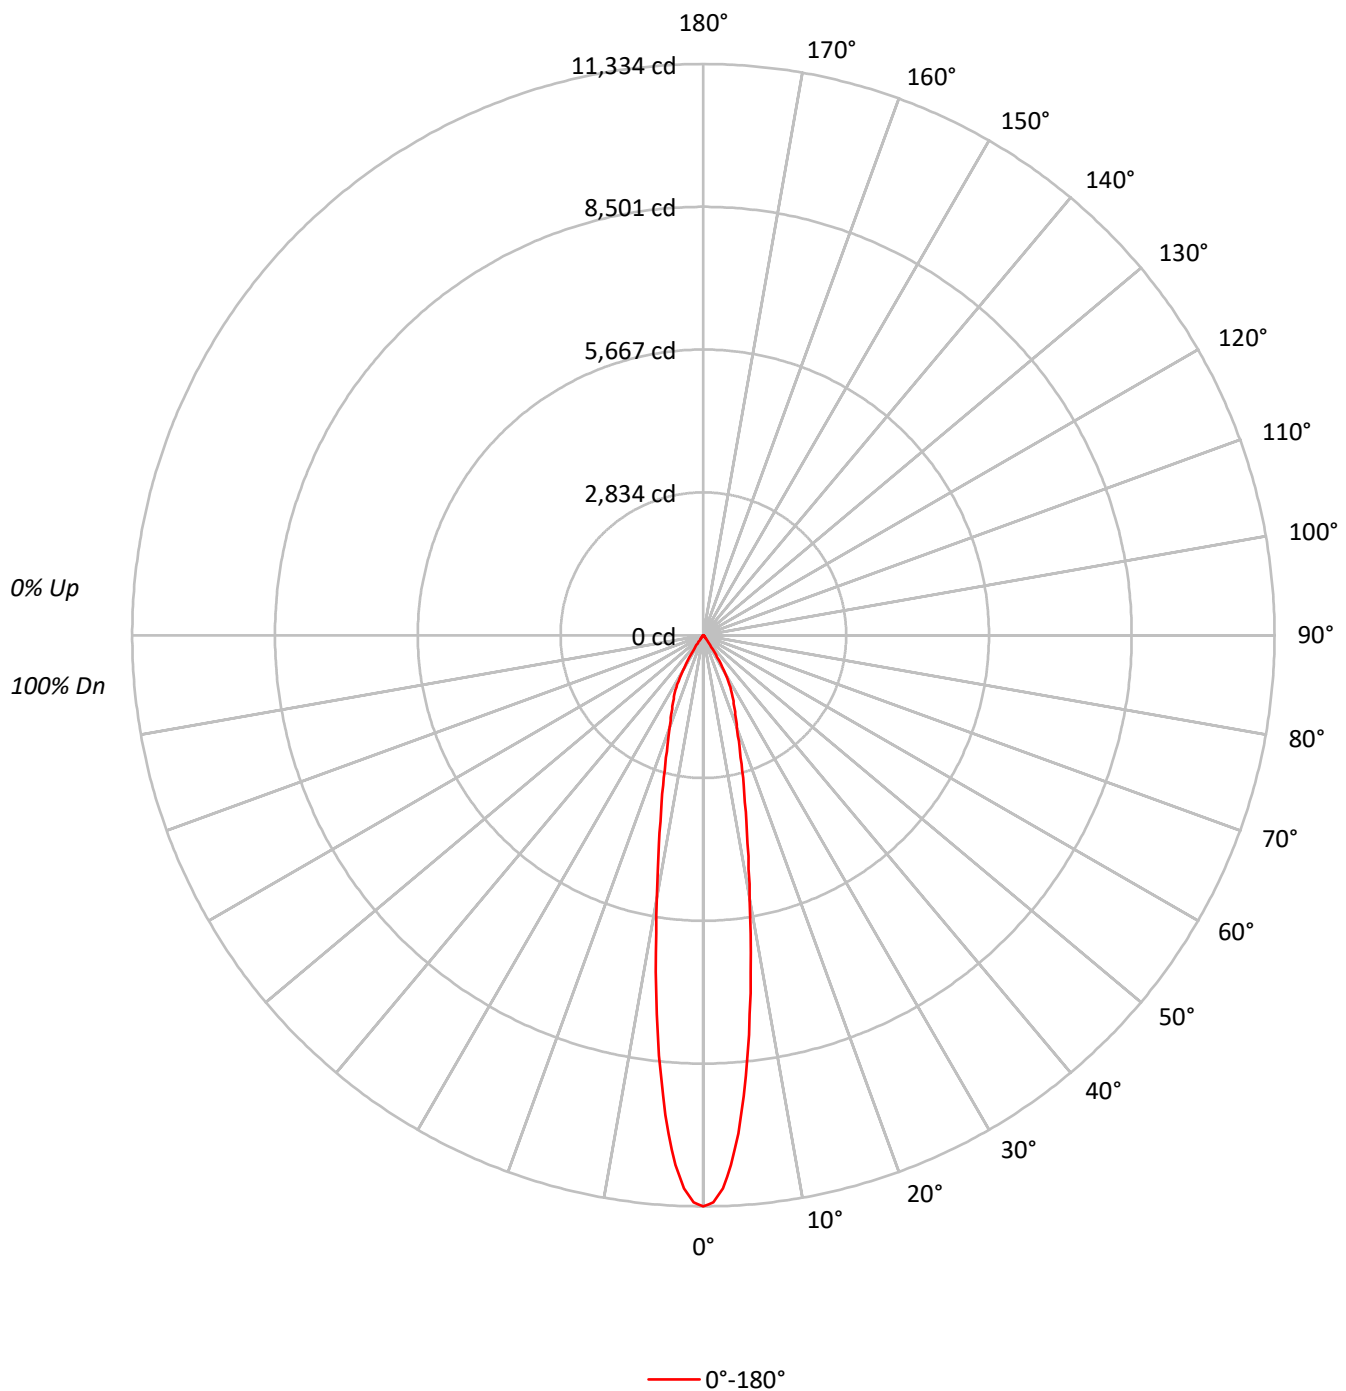

TEST NUMBER: P981030

CATALOG NUMBER: PRLX-CYL3-10-935-23L-MD-U-S-X-X-WHITE

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10			
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	115	112	110	109	112	110	108	107	106	105	104	103	102	101	99	98	98	96		
2	111	107	103	101	108	105	102	100	102	99	97	99	97	95	96	95	93	92		
3	107	102	98	95	105	100	97	94	98	95	92	95	93	91	93	91	90	88		
4	103	97	93	89	101	96	92	89	94	91	88	92	89	87	90	88	86	85		
5	99	93	88	85	98	92	88	85	90	87	84	89	86	83	87	85	83	82		
6	96	89	85	81	95	89	84	81	87	83	81	86	83	80	85	82	80	78		
7	93	86	81	78	92	85	81	78	84	80	77	83	80	77	82	79	77	76		
8	90	83	78	75	89	82	78	75	81	77	75	80	77	74	80	76	74	73		
9	87	80	75	72	86	79	75	72	79	75	72	78	74	72	77	74	72	71		
10	85	77	73	70	84	77	73	70	76	72	70	75	72	69	75	72	69	68		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2485261
5°	2022447
10°	1182031
15°	699936
20°	456136
25°	336890
30°	206386
35°	52307
40°	16288
45°	3814
50°	1740
55°	1338
60°	1447
65°	1660
70°	1923
75°	2118
80°	2904
85°	3522

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3814 cd/sqm

TEST NUMBER: P981030

CATALOG NUMBER: PRLX-CYL3-10-935-23L-MD-U-S-X-X-WHTE

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	744.4	30.4
10°-20°	875.0	35.8
20°-30°	631.1	25.8
30°-40°	171.0	7.0
40°-50°	14.8	0.6
50°-60°	3.4	0.1
60°-70°	3.2	0.1
70°-80°	2.8	0.1
80°-90°	1.3	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2250.5	92.0
0°-40°	2421.5	99.0
0°-60°	2439.7	99.7
0°-90°	2446.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2446.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	11334	
5°	9188	744
15°	3083	875
25°	1392	631
35°	195	171
45°	12	15
55°	4	3
65°	3	3
75°	2	3
85°	1	1
90°	0	

TEST NUMBER: P981030

CATALOG NUMBER: PRLX-CYL3-10-935-23L-MD-U-S-X-X-WHTE

CANDELA DISTRIBUTION (FULL):

0°	
0°	11333.7
1°	11254.5
2°	10988.1
3°	10528.9
4°	9916.2
5°	9188.0
6°	8393.9
7°	7571.0
8°	6752.4
9°	5991.6
10°	5308.6
11°	4721.9
12°	4226.9
13°	3794.0
14°	3413.3
15°	3083.2
16°	2794.6
17°	2536.4
18°	2304.6
19°	2115.5
20°	1954.7
21°	1821.5
22°	1697.6
23°	1586.3
24°	1484.3
25°	1392.4
26°	1305.3
27°	1211.3
28°	1105.8
29°	969.4
30°	815.1
31°	662.5
32°	521.8
33°	394.1
34°	282.8
35°	195.4
36°	135.7
37°	98.7
38°	81.1
39°	68.4
40°	56.9
41°	46.6
42°	36.5
43°	25.4
44°	16.3

TEST NUMBER: P981030

CATALOG NUMBER: PRLX-CYL3-10-935-23L-MD-U-S-X-X-WHTE

CANDELA DISTRIBUTION (continued):

	0°
45°	12.3
46°	9.8
47°	8.1
48°	6.7
49°	5.7
50°	5.1
51°	4.6
52°	4.2
53°	3.9
54°	3.7
55°	3.5
56°	3.5
57°	3.4
58°	3.3
59°	3.3
60°	3.3
61°	3.2
62°	3.2
63°	3.2
64°	3.2
65°	3.2
66°	3.2
67°	3.2
68°	3.1
69°	3.1
70°	3.0
71°	3.0
72°	2.9
73°	2.8
74°	2.6
75°	2.5
76°	2.5
77°	2.4
78°	2.4
79°	2.3
80°	2.3
81°	2.2
82°	2.1
83°	2.0
84°	1.7
85°	1.4
86°	0.7
87°	0.2
88°	0.1
89°	0.0

TEST NUMBER: P981030

CATALOG NUMBER: PRLX-CYL3-10-935-23L-MD-U-S-X-X-WHTE

CANDELA DISTRIBUTION (continued):

90° | $\overset{0^\circ}{\rule{1.5cm}{0.4pt}}$
0.0

TEST NUMBER: P981030

CATALOG NUMBER: PRLX-CYL3-10-935-23L-MD-U-S-X-X-WHTE

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.74	1.52	1.12	1.86	2.23	0.74	1.52	1.12	1.86	2.23
	4H	2.05	2.78	2.46	3.13	3.52	2.05	2.78	2.46	3.13	3.52
	6H	3.49	4.15	3.91	4.53	4.93	3.49	4.15	3.91	4.53	4.93
	8H	4.23	4.85	4.67	5.24	5.65	4.23	4.85	4.67	5.24	5.65
	12H	4.65	5.24	5.09	5.63	6.06	4.65	5.24	5.09	5.63	6.06
4H	2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	1.85	2.44	2.27	2.85	3.26	1.85	2.44	2.27	2.85	3.26
	4H	3.28	3.81	3.72	4.23	4.68	3.28	3.81	3.72	4.23	4.68
	6H	4.90	5.34	5.37	5.79	6.27	4.90	5.34	5.37	5.79	6.27
	8H	5.71	6.12	6.19	6.58	7.05	5.71	6.12	6.19	6.58	7.05
	12H	6.27	6.63	6.77	7.12	7.60	6.27	6.63	6.77	7.12	7.60
8H	4H	3.82	4.24	4.30	4.69	5.17	3.82	4.24	4.30	4.69	5.17
	6H	5.70	6.02	6.21	6.53	7.01	5.70	6.02	6.21	6.53	7.01
	8H	6.68	6.97	7.22	7.49	7.99	6.68	6.97	7.22	7.49	7.99
	12H	7.42	7.67	7.95	8.17	8.75	7.42	7.67	7.95	8.17	8.75
12H	4H	3.95	4.30	4.44	4.79	5.27	3.95	4.30	4.44	4.79	5.27
	6H	5.91	6.20	6.45	6.73	7.22	5.91	6.20	6.45	6.73	7.22
	8H	7.00	7.25	7.53	7.75	8.33	7.00	7.25	7.53	7.75	8.33