

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P979314

Luminaire Tested: PRLX-CYL6-927-48L-FL-U-S-X-X-BLAK

Issue Date: 4/3/2025

Test Information

Test Method: LM-79-2019
Report Number: P979314
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2502-353-9)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 4/3/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-CYL6-927-48L-FL-U-S-X-X-BLAK
Description: 3D PRINTED LUMINAIRE, INTEGRAL LED LIGHT ENGINE, BLACK TRIM WITH FLOOD OPTIC
Light Source: 2700K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4421.8 lumens
Efficiency: N/A
Efficacy: 132.0 lumens/watt
Spacing Criteria (0/90/45): 0.62 / 0.62 / 0.59
Luminous Opening: Circular (Dia: 1.17' x H: 0')
CIE Type: Direct

Input Watts (W): 33.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P979314

CATALOG NUMBER: PRLX-CYL6-927-48L-FL-U-S-X-X-BLAK

Luminous Intensity Polar Plot

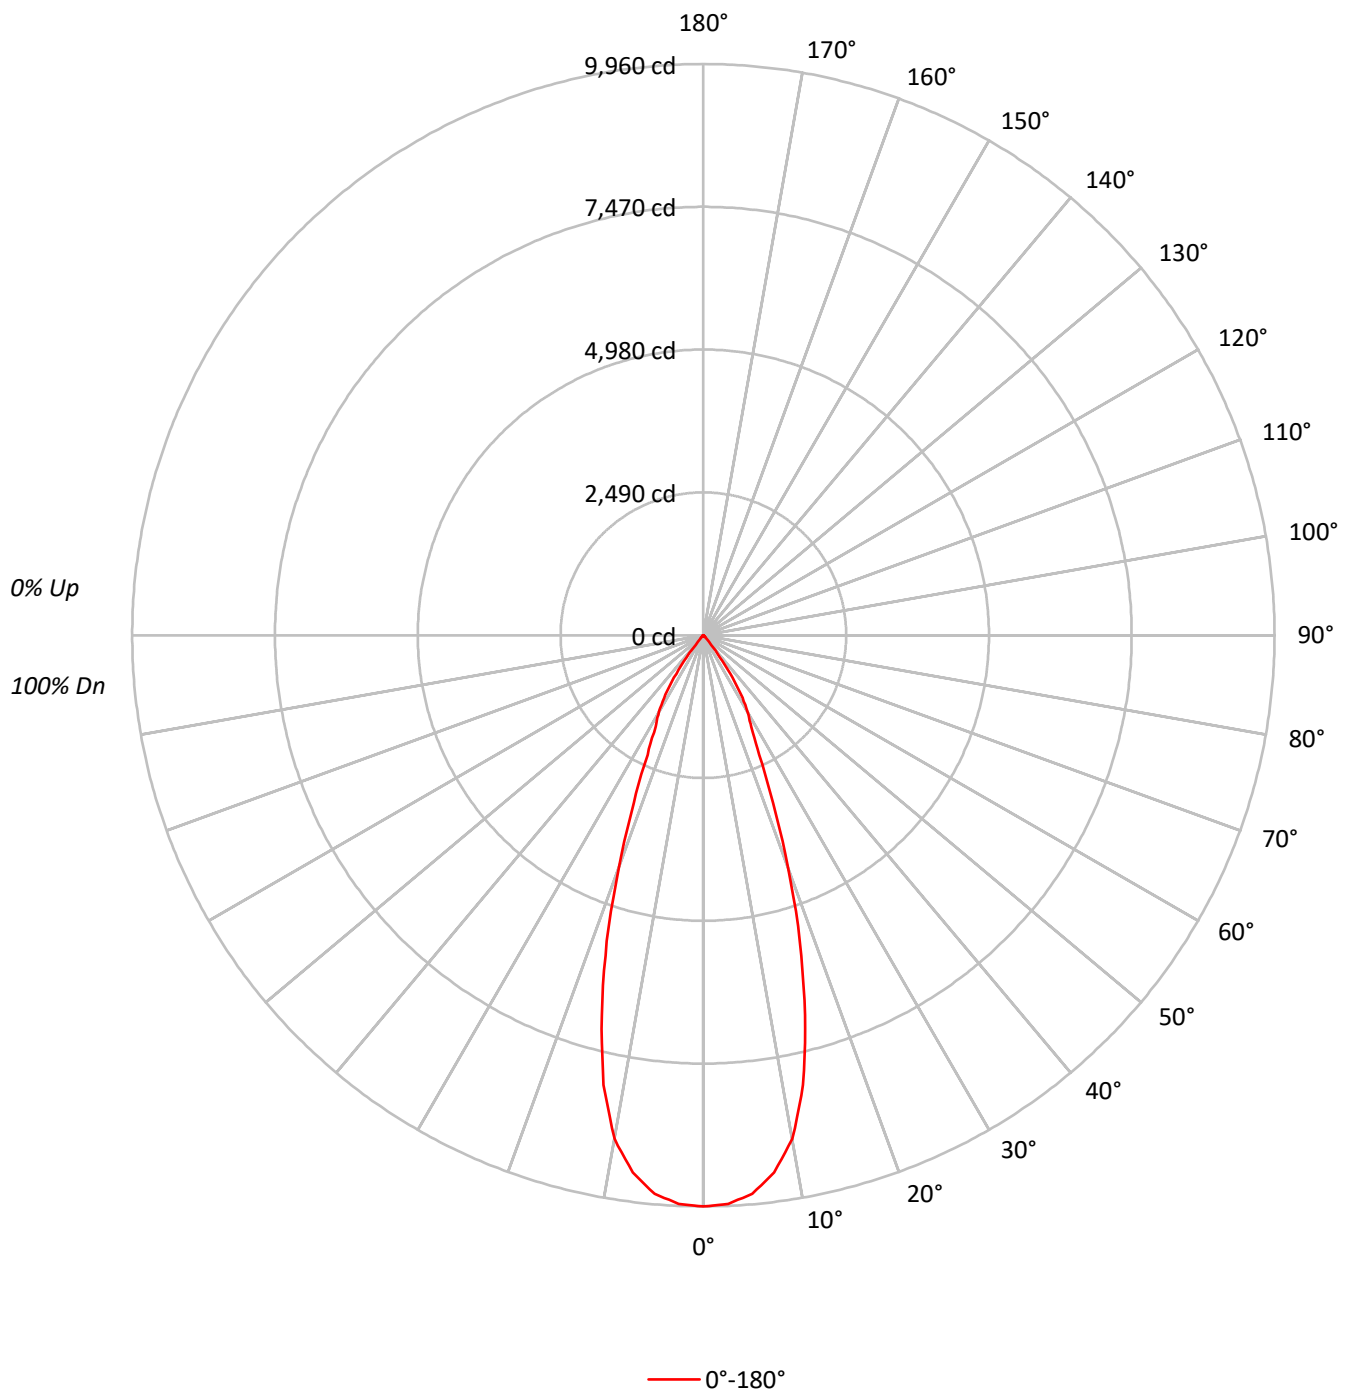

TEST NUMBER: P979314

CATALOG NUMBER: PRLX-CYL6-927-48L-FL-U-S-X-X-BLAK

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		0
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		100
1	114	112	110	108	112	110	108	106	106	104	103		102	101	100		95
2	110	106	102	100	108	104	101	99	101	99	96		98	96	94		91
3	106	100	96	93	104	99	95	92	96	93	91		94	92	89		87
4	102	95	91	87	100	94	90	87	92	89	86		90	87	85		83
5	98	91	86	83	96	90	85	82	88	84	81		87	83	81		79
6	94	87	82	78	93	86	81	78	85	81	78		83	80	77		75
7	91	83	78	75	89	82	78	74	81	77	74		80	76	74		72
8	87	79	75	71	86	79	74	71	78	74	71		77	73	70		69
9	84	76	71	68	83	76	71	68	75	71	68		74	70	68		66
10	81	73	68	65	80	73	68	65	72	68	65		71	68	65		64

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	100284
5°	98806
10°	91173
15°	71455
20°	46130
25°	25582
30°	17961
35°	10052
40°	1229
45°	337
50°	154
55°	74
60°	28
65°	0
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 337 cd/sqm

TEST NUMBER: P979314

CATALOG NUMBER: PRLX-CYL6-927-48L-FL-U-S-X-X-BLAK

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	905.8	20.5
10°-20°	1851.6	41.9
20°-30°	1142.3	25.8
30°-40°	493.4	11.2
40°-50°	23.9	0.5
50°-60°	4.3	0.1
60°-70°	0.5	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3899.7	88.2
0°-40°	4393.1	99.4
0°-60°	4421.3	100.0
0°-90°	4421.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4421.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	9960	
5°	9776	906
15°	6855	1852
25°	2303	1142
35°	818	493
45°	24	24
55°	4	4
65°	0	1
75°	0	0
85°	0	0
90°	0	

TEST NUMBER: P979314

CATALOG NUMBER: PRLX-CYL6-927-48L-FL-U-S-X-X-BLAK

CANDELA DISTRIBUTION (FULL):

	0°
0°	9959.7
2.5°	9926.2
5°	9775.5
7.5°	9446.2
10°	8917.3
12.5°	8031.1
15°	6854.7
17.5°	5591.8
20°	4305.1
22.5°	3167.8
25°	2302.6
27.5°	1798.8
30°	1544.8
32.5°	1228.0
35°	817.8
37.5°	396.3
40°	93.5
42.5°	36.3
45°	23.7
47.5°	15.4
50°	9.8
52.5°	7.0
55°	4.2
57.5°	2.8
60°	1.4
62.5°	1.4
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

TEST NUMBER: P979314

CATALOG NUMBER: PRLX-CYL6-927-48L-FL-U-S-X-X-BLAK

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
4H	2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
8H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
12H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

END OF REPORT