

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P979338

Luminaire Tested: PRLX-CYL6-927-74L-WD-U-S-X-X-BLAK

Issue Date: 4/3/2025

Test Information

Test Method: LM-79-2019
Report Number: P979338
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2502-353-10)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 4/3/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-CYL6-927-74L-WD-U-S-X-X-BLAK
Description: 3D PRINTED LUMINAIRE, INTEGRAL LED LIGHT ENGINE, BLACK TRIM WITH WIDE FLOOD OPTIC
Light Source: 2700K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6354.6 lumens
Efficiency: N/A
Efficacy: 103.3 lumens/watt
Spacing Criteria (0/90/45): 1.06 / 1.06 / 0.91
Luminous Opening: Circular (Dia: 1.17' x H: 0')
CIE Type: Direct

Input Watts (W): 61.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P979338

CATALOG NUMBER: PRLX-CYL6-927-74L-WD-U-S-X-X-BLAK

Luminous Intensity Polar Plot

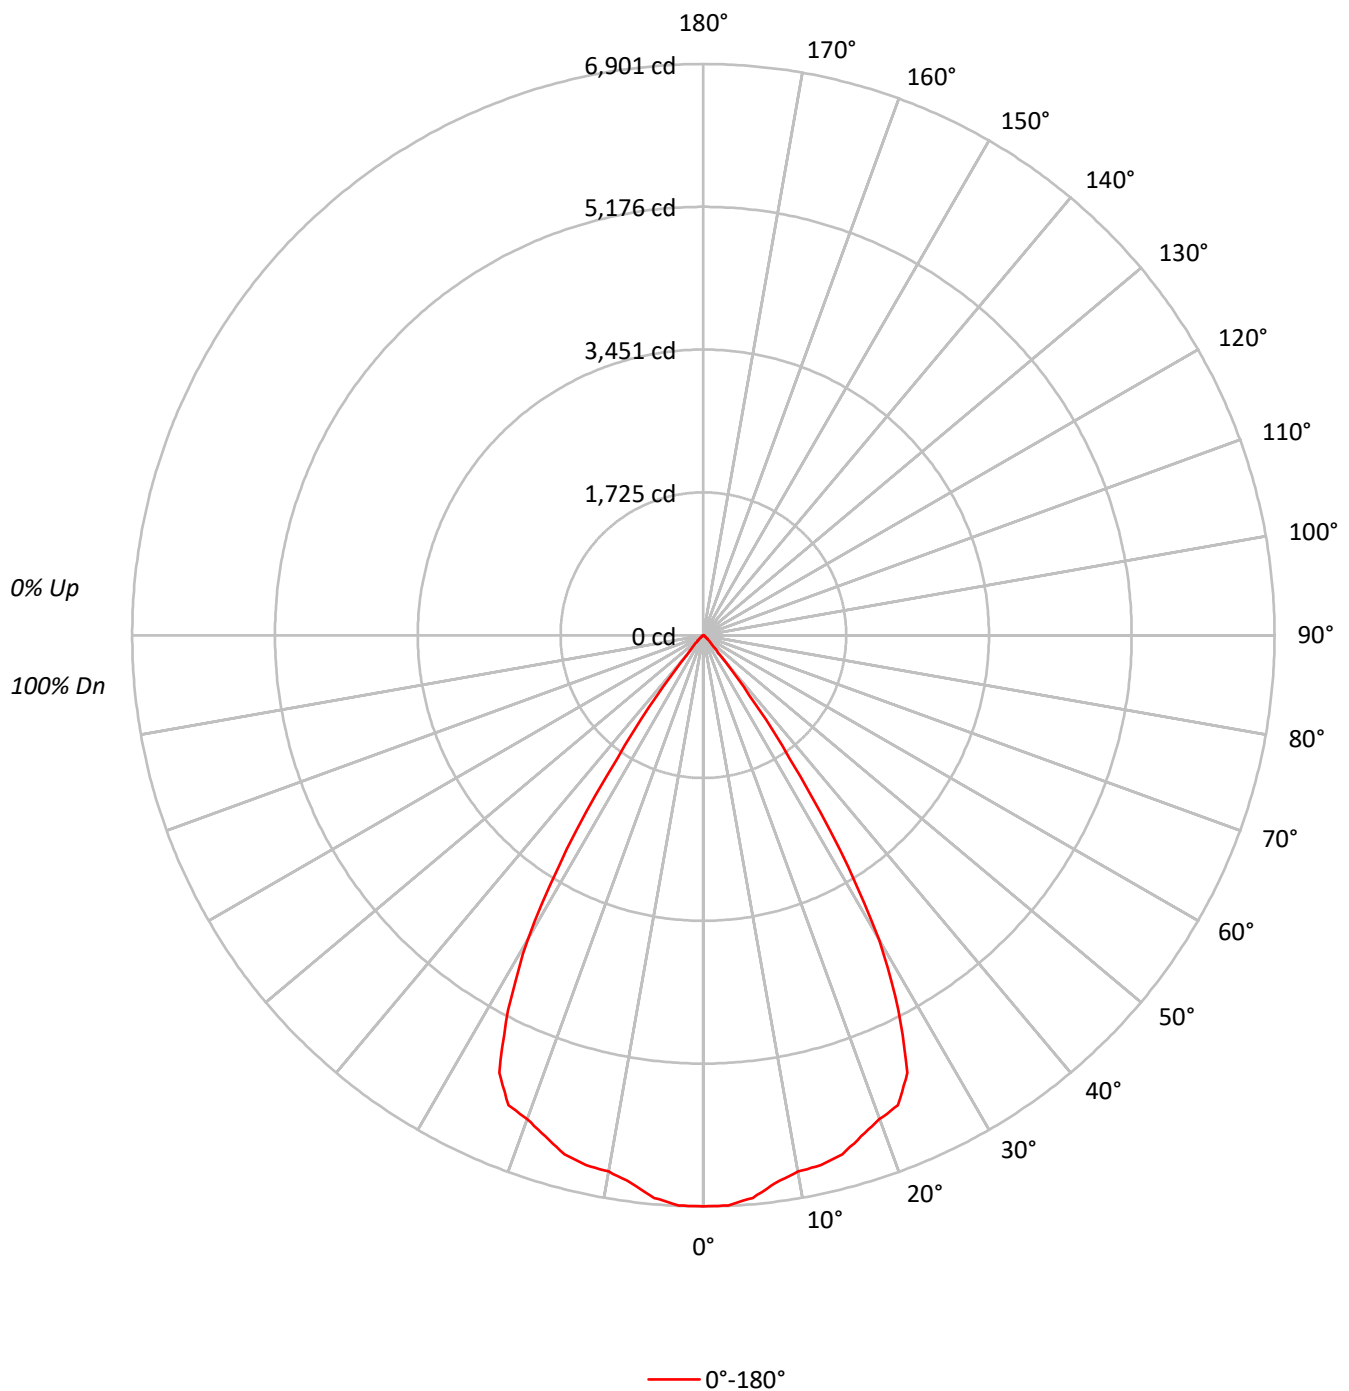

TEST NUMBER: P979338

CATALOG NUMBER: PRLX-CYL6-927-74L-WD-U-S-X-X-BLAK

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	114	111	109	107	111	109	107	105	105	103	102		101	100	99		98
2	108	104	100	97	106	102	99	96	99	96	94		96	94	92		93
3	103	97	92	89	101	96	92	88	93	90	87		91	88	85		89
4	98	91	86	82	97	90	85	81	88	84	80		86	82	80		84
5	94	86	80	76	92	85	80	76	83	78	75		81	77	74		80
6	89	81	75	71	88	80	75	71	78	74	70		77	73	70		76
7	85	76	70	66	84	75	70	66	74	69	66		73	69	65		72
8	81	72	66	62	80	71	66	62	70	65	62		69	65	61		68
9	77	68	62	58	76	67	62	58	66	62	58		66	61	58		65
10	74	64	59	55	73	64	59	55	63	58	55		62	58	55		62

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	69487
5°	68968
10°	67275
15°	67669
20°	66646
25°	64791
30°	49405
35°	22339
40°	4052
45°	1504
50°	675
55°	341
60°	131
65°	0
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1504 cd/sqm

TEST NUMBER: P979338

CATALOG NUMBER: PRLX-CYL6-927-74L-WD-U-S-X-X-BLAK

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	642.0	10.1
10°-20°	1822.4	28.7
20°-30°	2555.6	40.2
30°-40°	1217.9	19.2
40°-50°	97.1	1.5
50°-60°	18.3	0.3
60°-70°	1.3	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5020.1	79.0
0°-40°	6237.9	98.2
0°-60°	6353.3	100.0
0°-90°	6354.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6354.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	6901	
5°	6824	642
15°	6492	1822
25°	5832	2556
35°	1817	1218
45°	106	97
55°	19	18
65°	0	1
75°	0	0
85°	0	0
90°	0	

TEST NUMBER: P979338

CATALOG NUMBER: PRLX-CYL6-927-74L-WD-U-S-X-X-BLAK

CANDELA DISTRIBUTION (FULL):

0°	
0°	6901.1
2.5°	6894.6
5°	6823.5
7.5°	6674.7
10°	6579.9
12.5°	6556.2
15°	6491.5
17.5°	6347.0
20°	6219.8
22.5°	6146.5
25°	5831.8
27.5°	5107.4
30°	4249.3
32.5°	3067.9
35°	1817.4
37.5°	909.8
40°	308.3
42.5°	163.9
45°	105.6
47.5°	69.0
50°	43.1
52.5°	28.0
55°	19.4
57.5°	10.8
60°	6.5
62.5°	2.2
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

TEST NUMBER: P979338

CATALOG NUMBER: PRLX-CYL6-927-74L-WD-U-S-X-X-BLAK

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
4H	2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
8H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
12H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

END OF REPORT