

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P979374

Luminaire Tested: PRLX-CYL6-930-31L-FL-U-S-X-X-BLAK

Issue Date: 4/3/2025

Test Information

Test Method: LM-79-2019
Report Number: P979374
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2502-353-9)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 4/3/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-CYL6-930-31L-FL-U-S-X-X-BLAK
Description: 3D PRINTED LUMINAIRE, INTEGRAL LED LIGHT ENGINE, BLACK TRIM WITH FLOOD OPTIC
Light Source: 3000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3067.0 lumens
Efficiency: N/A
Efficacy: 149.6 lumens/watt
Spacing Criteria (0/90/45): 0.62 / 0.62 / 0.59
Luminous Opening: Circular (Dia: 1.17' x H: 0')
CIE Type: Direct

Input Watts (W): 20.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P979374

CATALOG NUMBER: PRLX-CYL6-930-31L-FL-U-S-X-X-BLAK

Luminous Intensity Polar Plot

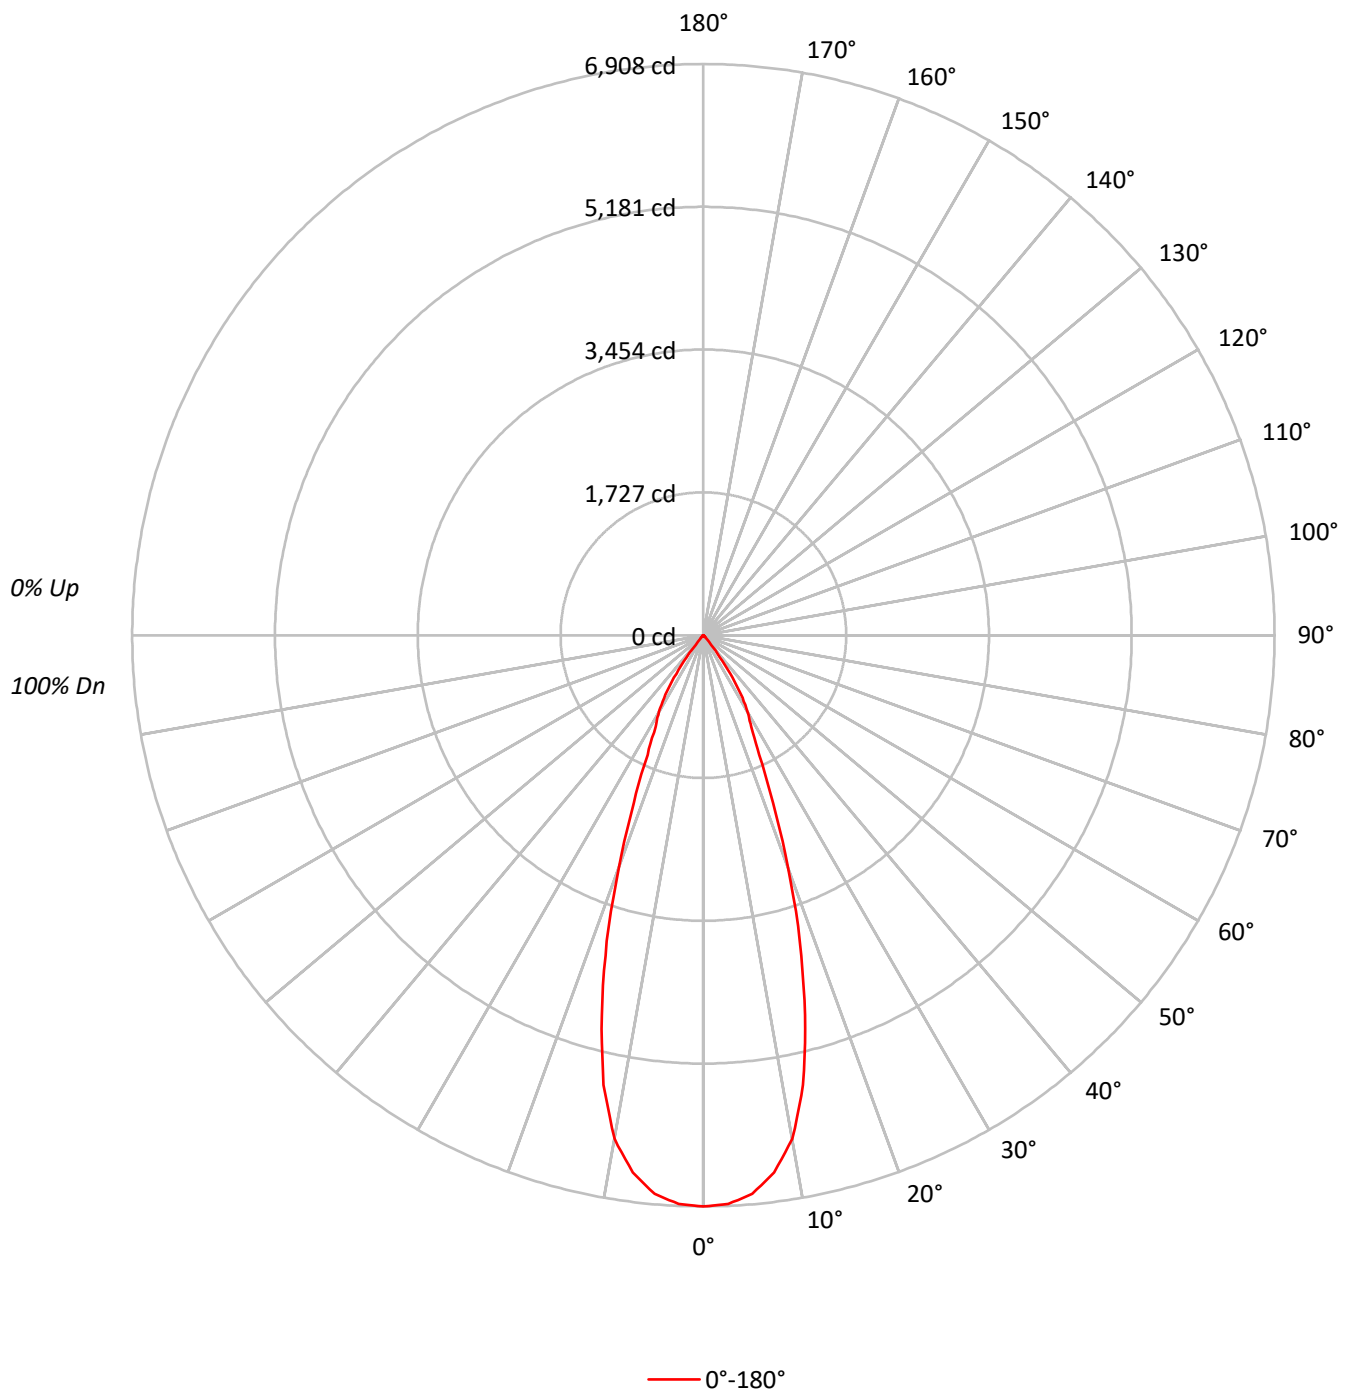

CATALOG NUMBER: PRLX-CYL6-930-31L-FL-U-S-X-X-BLAK

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100					100			
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	99	98	97	95					95			
2	110	106	102	100	108	104	101	99	101	99	96	98	96	94	95	94	92	91					91			
3	106	100	96	93	104	99	95	92	96	93	91	94	92	89	92	90	88	87					87			
4	102	95	91	87	100	94	90	87	92	89	86	90	87	85	89	86	84	83					83			
5	98	91	86	83	96	90	85	82	88	84	81	87	83	81	85	82	80	79					79			
6	94	87	82	78	93	86	81	78	85	81	78	83	80	77	82	79	77	75					75			
7	91	83	78	75	89	82	78	74	81	77	74	80	76	74	79	76	73	72					72			
8	87	79	75	71	86	79	74	71	78	74	71	77	73	70	76	73	70	69					69			
9	84	76	71	68	83	76	71	68	75	71	68	74	70	68	73	70	67	66					66			
10	81	73	68	65	80	73	68	65	72	68	65	71	68	65	71	67	65	64					64			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	69558
5°	68532
10°	63239
15°	49562
20°	31997
25°	17744
30°	12458
35°	6972
40°	853
45°	235
50°	107
55°	51
60°	20
65°	0
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Luminance: 235 cd/sqm

TEST NUMBER: P979374

CATALOG NUMBER: PRLX-CYL6-930-31L-FL-U-S-X-X-BLAK

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	628.3	20.5
10°-20°	1284.3	41.9
20°-30°	792.3	25.8
30°-40°	342.2	11.2
40°-50°	16.6	0.5
50°-60°	3.0	0.1
60°-70°	0.4	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2704.9	88.2
0°-40°	3047.1	99.4
0°-60°	3066.6	100.0
0°-90°	3067.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3067.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	6908	
5°	6780	628
15°	4754	1284
25°	1597	792
35°	567	342
45°	16	17
55°	3	3
65°	0	0
75°	0	0
85°	0	0
90°	0	

TEST NUMBER: P979374

CATALOG NUMBER: PRLX-CYL6-930-31L-FL-U-S-X-X-BLAK

CANDELA DISTRIBUTION (FULL):

0°	
0°	6908.1
2.5°	6884.9
5°	6780.3
7.5°	6551.9
10°	6185.1
12.5°	5570.4
15°	4754.5
17.5°	3878.5
20°	2986.1
22.5°	2197.2
25°	1597.1
27.5°	1247.7
30°	1071.5
32.5°	851.8
35°	567.2
37.5°	274.9
40°	64.9
42.5°	25.2
45°	16.5
47.5°	10.6
50°	6.8
52.5°	4.8
55°	2.9
57.5°	1.9
60°	1.0
62.5°	1.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

TEST NUMBER: P979374

CATALOG NUMBER: PRLX-CYL6-930-31L-FL-U-S-X-X-BLAK

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
4H	2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
8H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
12H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

END OF REPORT