

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P979414

Luminaire Tested: PRLX-CYL6-930-74L-FL-U-S-X-X-BLAK

Issue Date: 4/3/2025

Test Information

Test Method: LM-79-2019
Report Number: P979414
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2502-353-9)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 4/3/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-CYL6-930-74L-FL-U-S-X-X-BLAK
Description: 3D PRINTED LUMINAIRE, INTEGRAL LED LIGHT ENGINE, BLACK TRIM WITH FLOOD OPTIC
Light Source: 3000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7242.0 lumens
Efficiency: N/A
Efficacy: 117.8 lumens/watt
Spacing Criteria (0/90/45): 0.62 / 0.62 / 0.59
Luminous Opening: Circular (Dia: 1.17' x H: 0')
CIE Type: Direct

Input Watts (W): 61.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P979414

CATALOG NUMBER: PRLX-CYL6-930-74L-FL-U-S-X-X-BLAK

Luminous Intensity Polar Plot

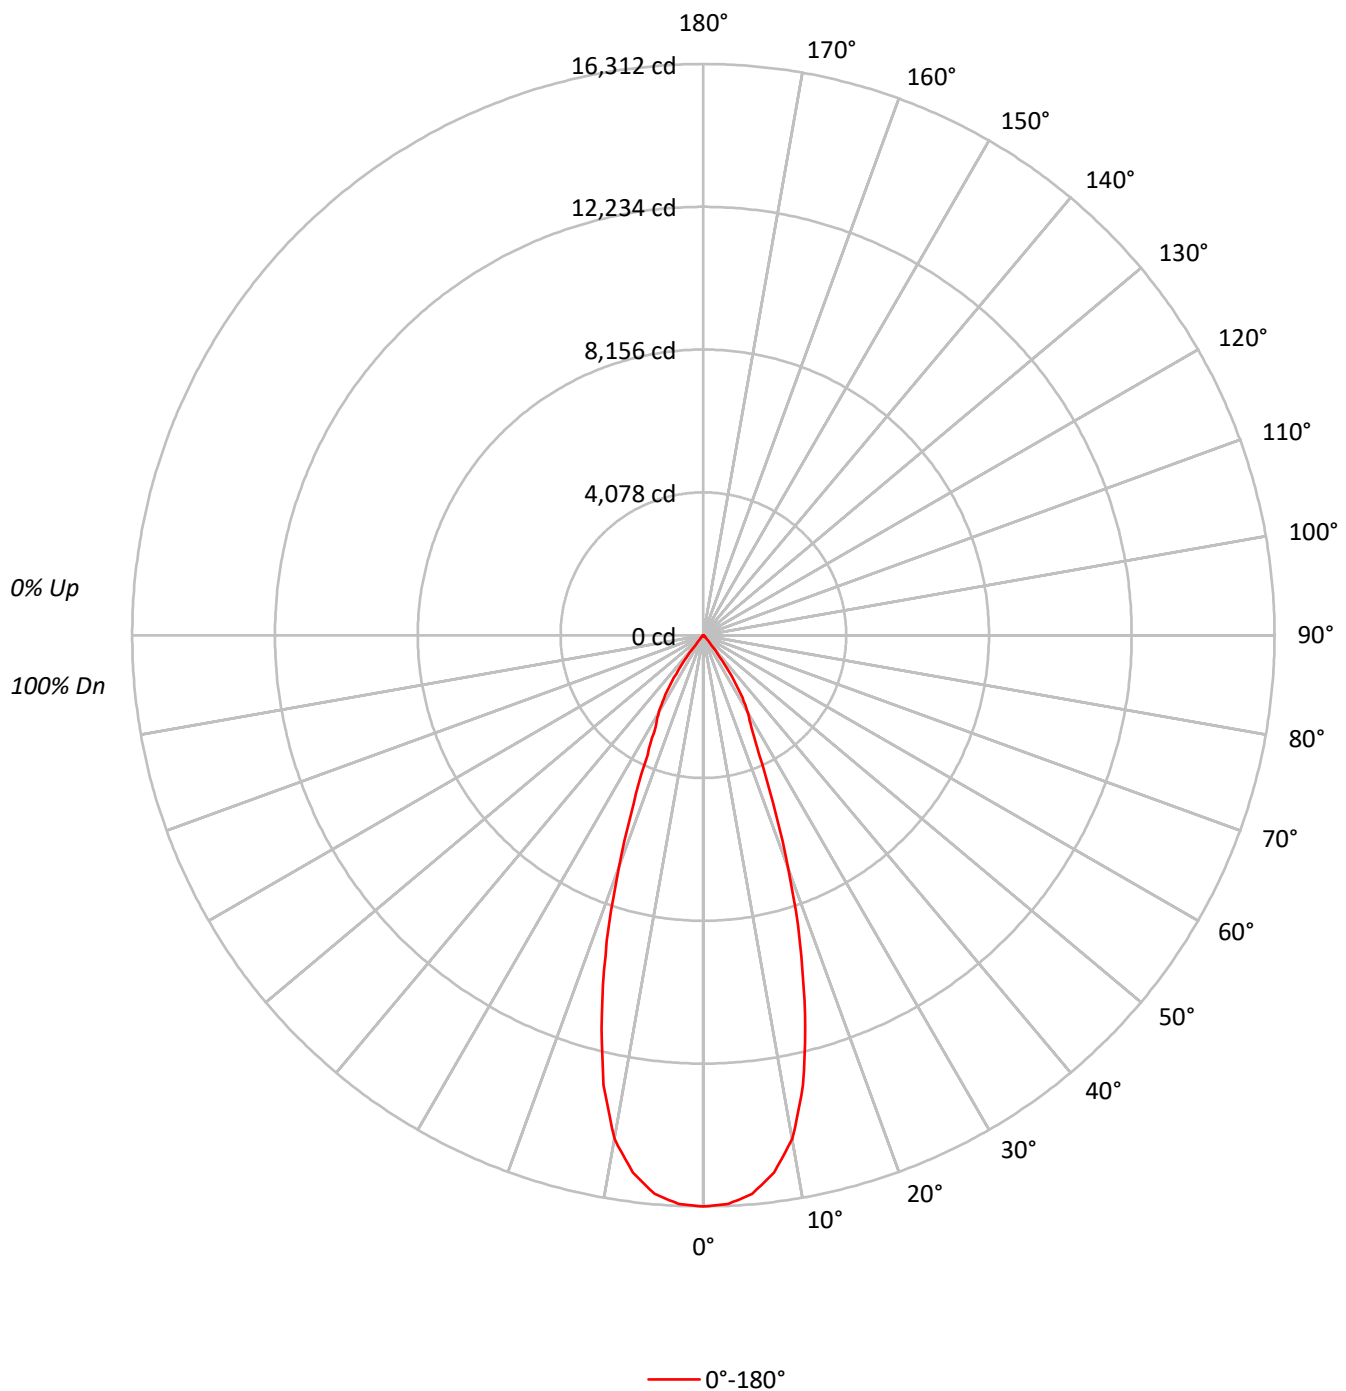

CATALOG NUMBER: PRLX-CYL6-930-74L-FL-U-S-X-X-BLAK

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																										
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100								
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	99	98	97	95								
2	110	106	102	100	108	104	101	99	101	99	96	98	96	94	95	94	92	91								
3	106	100	96	93	104	99	95	92	96	93	91	94	92	89	92	90	88	87								
4	102	95	91	87	100	94	90	87	92	89	86	90	87	85	89	86	84	83								
5	98	91	86	83	96	90	85	82	88	84	81	87	83	81	85	82	80	79								
6	94	87	82	78	93	86	81	78	85	81	78	83	80	77	82	79	77	75								
7	91	83	78	75	89	82	78	74	81	77	74	80	76	74	79	76	73	72								
8	87	79	75	71	86	79	74	71	78	74	71	77	73	70	76	73	70	69								
9	84	76	71	68	83	76	71	68	75	71	68	74	70	68	73	70	67	66								
10	81	73	68	65	80	73	68	65	72	68	65	71	68	65	71	67	65	64								

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	164246
5°	161824
10°	149323
15°	117028
20°	75552
25°	41898
30°	29417
35°	16463
40°	2012
45°	554
50°	251
55°	121
60°	46
65°	0
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Luminance: 554 cd/sqm

TEST NUMBER: P979414

CATALOG NUMBER: PRLX-CYL6-930-74L-FL-U-S-X-X-BLAK

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1483.5	20.5
10°-20°	3032.6	41.9
20°-30°	1870.9	25.8
30°-40°	808.1	11.2
40°-50°	39.1	0.5
50°-60°	7.1	0.1
60°-70°	0.8	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	6386.9	88.2
0°-40°	7195.0	99.4
0°-60°	7241.2	100.0
0°-90°	7242.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7242.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	16312	
5°	16010	###
15°	11227	3033
25°	3771	1871
35°	1339	808
45°	39	39
55°	7	7
65°	0	1
75°	0	0
85°	0	0
90°	0	

TEST NUMBER: P979414

CATALOG NUMBER: PRLX-CYL6-930-74L-FL-U-S-X-X-BLAK

CANDELA DISTRIBUTION (FULL):

	0°
0°	16312.0
2.5°	16257.1
5°	16010.3
7.5°	15470.9
10°	14604.7
12.5°	13153.4
15°	11226.6
17.5°	9158.2
20°	7050.9
22.5°	5188.2
25°	3771.2
27.5°	2946.1
30°	2530.1
32.5°	2011.3
35°	1339.3
37.5°	649.1
40°	153.1
42.5°	59.4
45°	38.9
47.5°	25.1
50°	16.0
52.5°	11.4
55°	6.9
57.5°	4.6
60°	2.3
62.5°	2.3
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

TEST NUMBER: P979414

CATALOG NUMBER: PRLX-CYL6-930-74L-FL-U-S-X-X-BLAK

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
4H	2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
8H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
12H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

END OF REPORT