

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P979444

Luminaire Tested: PRLX-CYL6-935-23L-FL-U-S-X-X-BLAK

Issue Date: 4/3/2025

**Test Information**

Test Method: LM-79-2019  
Report Number: P979444  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2502-353-9)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 4/3/2025  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PrentaLux  
Catalog Number: PRLX-CYL6-935-23L-FL-U-S-X-X-BLAK  
Description: 3D PRINTED LUMINAIRE, INTEGRAL LED LIGHT ENGINE, BLACK TRIM WITH FLOOD OPTIC  
Light Source: 3500K CCT, 90 CRI LEDS  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 2347.4 lumens  
Efficiency: N/A  
Efficacy: 156.5 lumens/watt  
Spacing Criteria (0/90/45): 0.62 / 0.62 / 0.59  
Luminous Opening: Circular (Dia: 1.17' x H: 0')  
CIE Type: Direct

Input Watts (W): 15  
Input Voltage (V): 120  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P979444

CATALOG NUMBER: PRLX-CYL6-935-23L-FL-U-S-X-X-BLAK

### Luminous Intensity Polar Plot

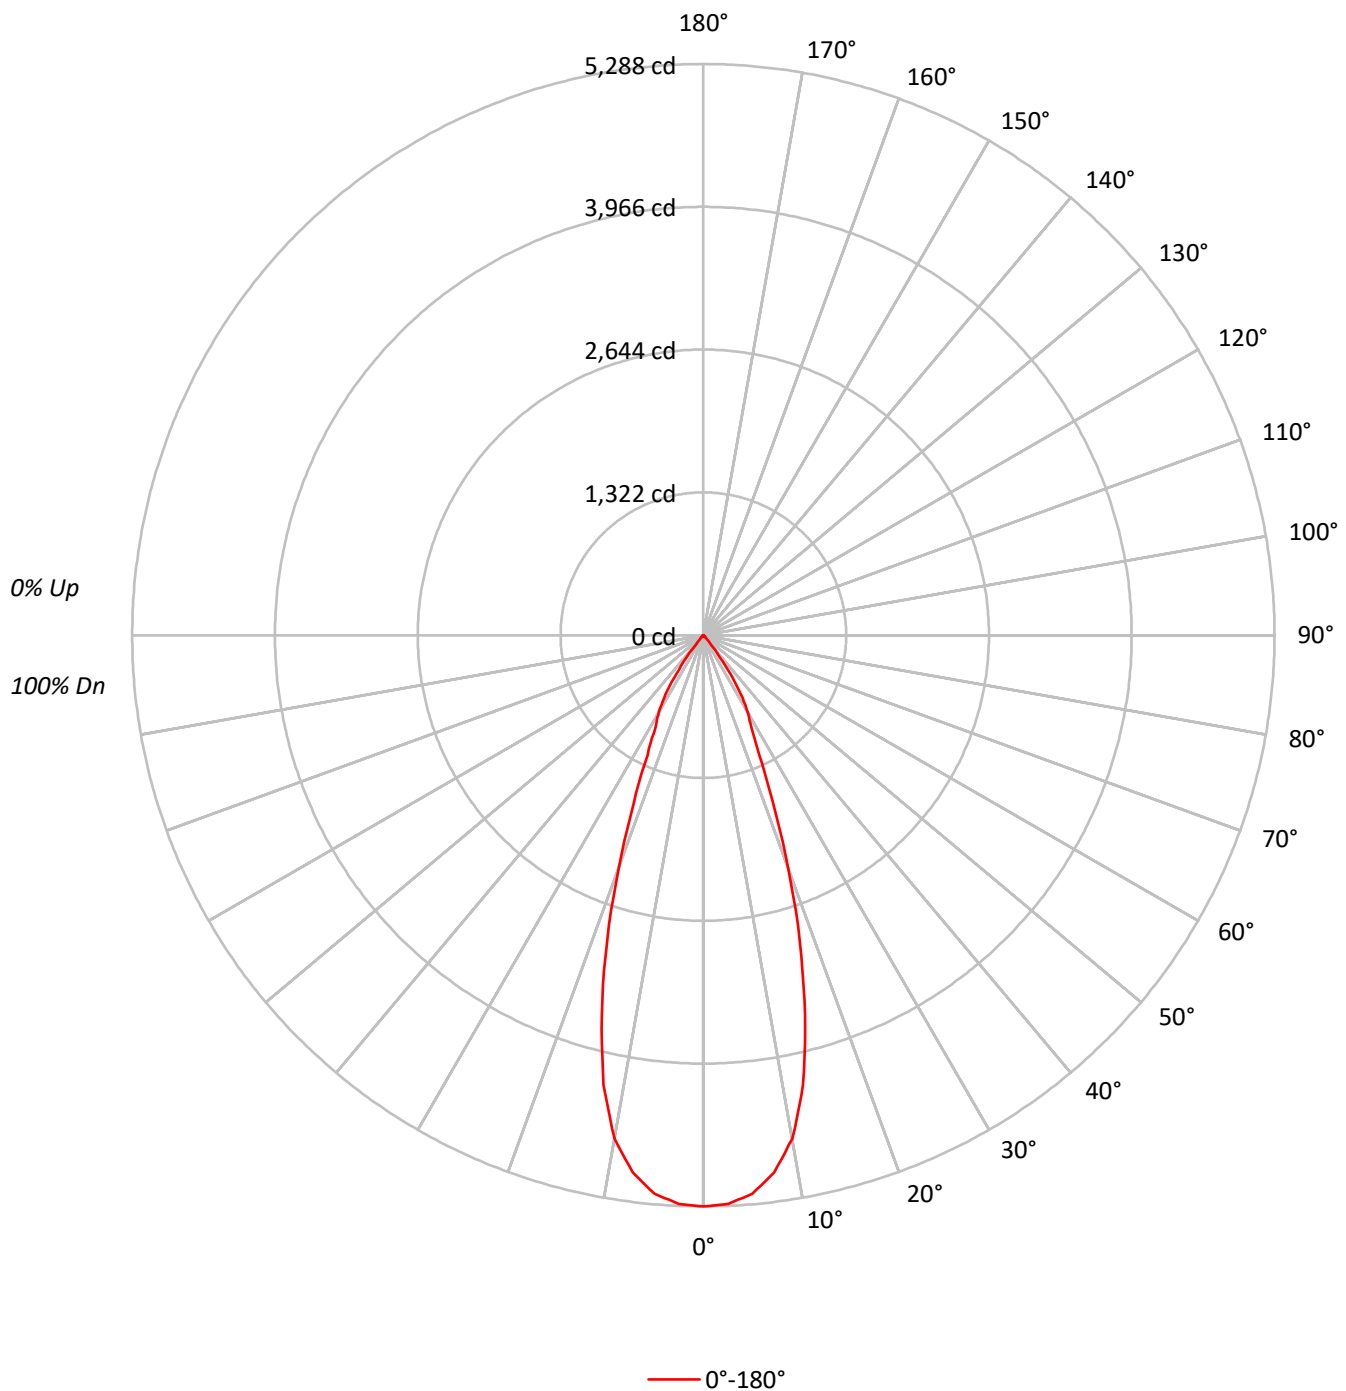

TEST NUMBER: P979444

CATALOG NUMBER: PRLX-CYL6-935-23L-FL-U-S-X-X-BLAK

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| RF  | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |
| RC  | 80  |     |     |     | 70  |     |     |     | 50  |     |     |     | 30  |     |     |     | 10  |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  |
| RCR |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 |
| 1   | 114 | 112 | 110 | 108 | 112 | 110 | 108 | 106 | 106 | 104 | 103 | 102 | 101 | 100 | 99  | 98  | 97  |
| 2   | 110 | 106 | 102 | 100 | 108 | 104 | 101 | 99  | 101 | 99  | 96  | 98  | 96  | 94  | 95  | 94  | 92  |
| 3   | 106 | 100 | 96  | 93  | 104 | 99  | 95  | 92  | 96  | 93  | 91  | 94  | 92  | 89  | 92  | 90  | 88  |
| 4   | 102 | 95  | 91  | 87  | 100 | 94  | 90  | 87  | 92  | 89  | 86  | 90  | 87  | 85  | 89  | 86  | 84  |
| 5   | 98  | 91  | 86  | 83  | 96  | 90  | 85  | 82  | 88  | 84  | 81  | 87  | 83  | 81  | 85  | 82  | 80  |
| 6   | 94  | 87  | 82  | 78  | 93  | 86  | 81  | 78  | 85  | 81  | 78  | 83  | 80  | 77  | 82  | 79  | 77  |
| 7   | 91  | 83  | 78  | 75  | 89  | 82  | 78  | 74  | 81  | 77  | 74  | 80  | 76  | 74  | 79  | 76  | 73  |
| 8   | 87  | 79  | 75  | 71  | 86  | 79  | 74  | 71  | 78  | 74  | 71  | 77  | 73  | 70  | 76  | 73  | 70  |
| 9   | 84  | 76  | 71  | 68  | 83  | 76  | 71  | 68  | 75  | 71  | 68  | 74  | 70  | 68  | 73  | 70  | 67  |
| 10  | 81  | 73  | 68  | 65  | 80  | 73  | 68  | 65  | 72  | 68  | 65  | 71  | 68  | 65  | 71  | 67  | 65  |

**AVERAGE LUMINANCE (cd/sqm):**

|     |       |
|-----|-------|
|     | 0°    |
| 0°  | 53240 |
| 5°  | 52455 |
| 10° | 48402 |
| 15° | 37935 |
| 20° | 24490 |
| 25° | 13581 |
| 30° | 9535  |
| 35° | 5336  |
| 40° | 652   |
| 45° | 179   |
| 50° | 81    |
| 55° | 39    |
| 60° | 14    |
| 65° | 0     |
| 70° | 0     |
| 75° | 0     |
| 80° | 0     |
| 85° | 0     |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
Vertical Angle: 45°  
Luminance: 179 cd/sqm

TEST NUMBER: P979444

CATALOG NUMBER: PRLX-CYL6-935-23L-FL-U-S-X-X-BLAK

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 480.9  | 20.5      |
| 10°-20°   | 983.0  | 41.9      |
| 20°-30°   | 606.4  | 25.8      |
| 30°-40°   | 261.9  | 11.2      |
| 40°-50°   | 12.7   | 0.5       |
| 50°-60°   | 2.3    | 0.1       |
| 60°-70°   | 0.3    | 0.0       |
| 70°-80°   | 0.0    | 0.0       |
| 80°-90°   | 0.0    | 0.0       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| 0°-30°    | 2070.3 | 88.2      |
| 0°-40°    | 2332.2 | 99.4      |
| 0°-60°    | 2347.2 | 100.0     |
| 0°-90°    | 2347.4 | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 2347.4 | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°   | Flux |
|-----|------|------|
| 0°  | 5288 |      |
| 5°  | 5190 | 481  |
| 15° | 3639 | 983  |
| 25° | 1222 | 606  |
| 35° | 434  | 262  |
| 45° | 13   | 13   |
| 55° | 2    | 2    |
| 65° | 0    | 0    |
| 75° | 0    | 0    |
| 85° | 0    | 0    |
| 90° | 0    |      |

TEST NUMBER: P979444

CATALOG NUMBER: PRLX-CYL6-935-23L-FL-U-S-X-X-BLAK

**CANDELA DISTRIBUTION (FULL):**

| 0°    |        |
|-------|--------|
| 0°    | 5287.5 |
| 2.5°  | 5269.7 |
| 5°    | 5189.7 |
| 7.5°  | 5014.8 |
| 10°   | 4734.0 |
| 12.5° | 4263.6 |
| 15°   | 3639.1 |
| 17.5° | 2968.6 |
| 20°   | 2285.5 |
| 22.5° | 1681.7 |
| 25°   | 1222.4 |
| 27.5° | 955.0  |
| 30°   | 820.1  |
| 32.5° | 651.9  |
| 35°   | 434.1  |
| 37.5° | 210.4  |
| 40°   | 49.6   |
| 42.5° | 19.3   |
| 45°   | 12.6   |
| 47.5° | 8.1    |
| 50°   | 5.2    |
| 52.5° | 3.7    |
| 55°   | 2.2    |
| 57.5° | 1.5    |
| 60°   | 0.7    |
| 62.5° | 0.7    |
| 65°   | 0.0    |
| 67.5° | 0.0    |
| 70°   | 0.0    |
| 72.5° | 0.0    |
| 75°   | 0.0    |
| 77.5° | 0.0    |
| 80°   | 0.0    |
| 82.5° | 0.0    |
| 85°   | 0.0    |
| 87.5° | 0.0    |
| 90°   | 0.0    |

TEST NUMBER: P979444

CATALOG NUMBER: PRLX-CYL6-935-23L-FL-U-S-X-X-BLAK

**CIE UGR TABLE:**

| Reflectances:   |      |                  |      |      |      |      |                |      |      |      |      |
|-----------------|------|------------------|------|------|------|------|----------------|------|------|------|------|
| Ceiling         |      | 0.7              | 0.7  | 0.5  | 0.5  | 0.3  | 0.7            | 0.7  | 0.5  | 0.5  | 0.3  |
| Wall            |      | 0.5              | 0.3  | 0.5  | 0.3  | 0.3  | 0.5            | 0.3  | 0.5  | 0.3  | 0.3  |
| Reference plane |      | 0.2              | 0.2  | 0.2  | 0.2  | 0.2  | 0.2            | 0.2  | 0.2  | 0.2  | 0.2  |
| Room dimensions |      | Viewed crosswise |      |      |      |      | Viewed endwise |      |      |      |      |
| X=2H            | Y=2H | 0.00             | 0.00 | 0.00 | 0.00 | 0.00 | 0.00           | 0.00 | 0.00 | 0.00 | 0.00 |
|                 | 3H   | 0.00             | 0.00 | 0.00 | 0.00 | 0.00 | 0.00           | 0.00 | 0.00 | 0.00 | 0.00 |
|                 | 4H   | 0.00             | 0.00 | 0.00 | 0.00 | 0.00 | 0.00           | 0.00 | 0.00 | 0.00 | 0.00 |
|                 | 6H   | 0.00             | 0.00 | 0.00 | 0.00 | 0.00 | 0.00           | 0.00 | 0.00 | 0.00 | 0.00 |
|                 | 8H   | 0.00             | 0.00 | 0.00 | 0.00 | 0.00 | 0.00           | 0.00 | 0.00 | 0.00 | 0.00 |
|                 | 12H  | 0.00             | 0.00 | 0.00 | 0.00 | 0.00 | 0.00           | 0.00 | 0.00 | 0.00 | 0.00 |
| 4H              | 2H   | 0.00             | 0.00 | 0.00 | 0.00 | 0.00 | 0.00           | 0.00 | 0.00 | 0.00 | 0.00 |
|                 | 3H   | 0.00             | 0.00 | 0.00 | 0.00 | 0.00 | 0.00           | 0.00 | 0.00 | 0.00 | 0.00 |
|                 | 4H   | 0.00             | 0.00 | 0.00 | 0.00 | 0.00 | 0.00           | 0.00 | 0.00 | 0.00 | 0.00 |
|                 | 6H   | 0.00             | 0.00 | 0.00 | 0.00 | 0.00 | 0.00           | 0.00 | 0.00 | 0.00 | 0.00 |
|                 | 8H   | 0.00             | 0.00 | 0.00 | 0.00 | 0.00 | 0.00           | 0.00 | 0.00 | 0.00 | 0.00 |
|                 | 12H  | 0.00             | 0.00 | 0.00 | 0.00 | 0.00 | 0.00           | 0.00 | 0.00 | 0.00 | 0.00 |
| 8H              | 4H   | 0.00             | 0.00 | 0.00 | 0.00 | 0.00 | 0.00           | 0.00 | 0.00 | 0.00 | 0.00 |
|                 | 6H   | 0.00             | 0.00 | 0.00 | 0.00 | 0.00 | 0.00           | 0.00 | 0.00 | 0.00 | 0.00 |
|                 | 8H   | 0.00             | 0.00 | 0.00 | 0.00 | 0.00 | 0.00           | 0.00 | 0.00 | 0.00 | 0.00 |
|                 | 12H  | 0.00             | 0.00 | 0.00 | 0.00 | 0.00 | 0.00           | 0.00 | 0.00 | 0.00 | 0.00 |
| 12H             | 4H   | 0.00             | 0.00 | 0.00 | 0.00 | 0.00 | 0.00           | 0.00 | 0.00 | 0.00 | 0.00 |
|                 | 6H   | 0.00             | 0.00 | 0.00 | 0.00 | 0.00 | 0.00           | 0.00 | 0.00 | 0.00 | 0.00 |
|                 | 8H   | 0.00             | 0.00 | 0.00 | 0.00 | 0.00 | 0.00           | 0.00 | 0.00 | 0.00 | 0.00 |

END OF REPORT