

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P979564

Luminaire Tested: PRLX-CYL6-940-62L-FL-U-S-X-X-BLAK

Issue Date: 4/3/2025

Test Information

Test Method: LM-79-2019
Report Number: P979564
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2502-353-9)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 4/3/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-CYL6-940-62L-FL-U-S-X-X-BLAK
Description: 3D PRINTED LUMINAIRE, INTEGRAL LED LIGHT ENGINE, BLACK TRIM WITH FLOOD OPTIC
Light Source: 4000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6542.2 lumens
Efficiency: N/A
Efficacy: 136.3 lumens/watt
Spacing Criteria (0/90/45): 0.62 / 0.62 / 0.59
Luminous Opening: Circular (Dia: 1.17' x H: 0')
CIE Type: Direct

Input Watts (W): 48
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P979564

CATALOG NUMBER: PRLX-CYL6-940-62L-FL-U-S-X-X-BLAK

Luminous Intensity Polar Plot

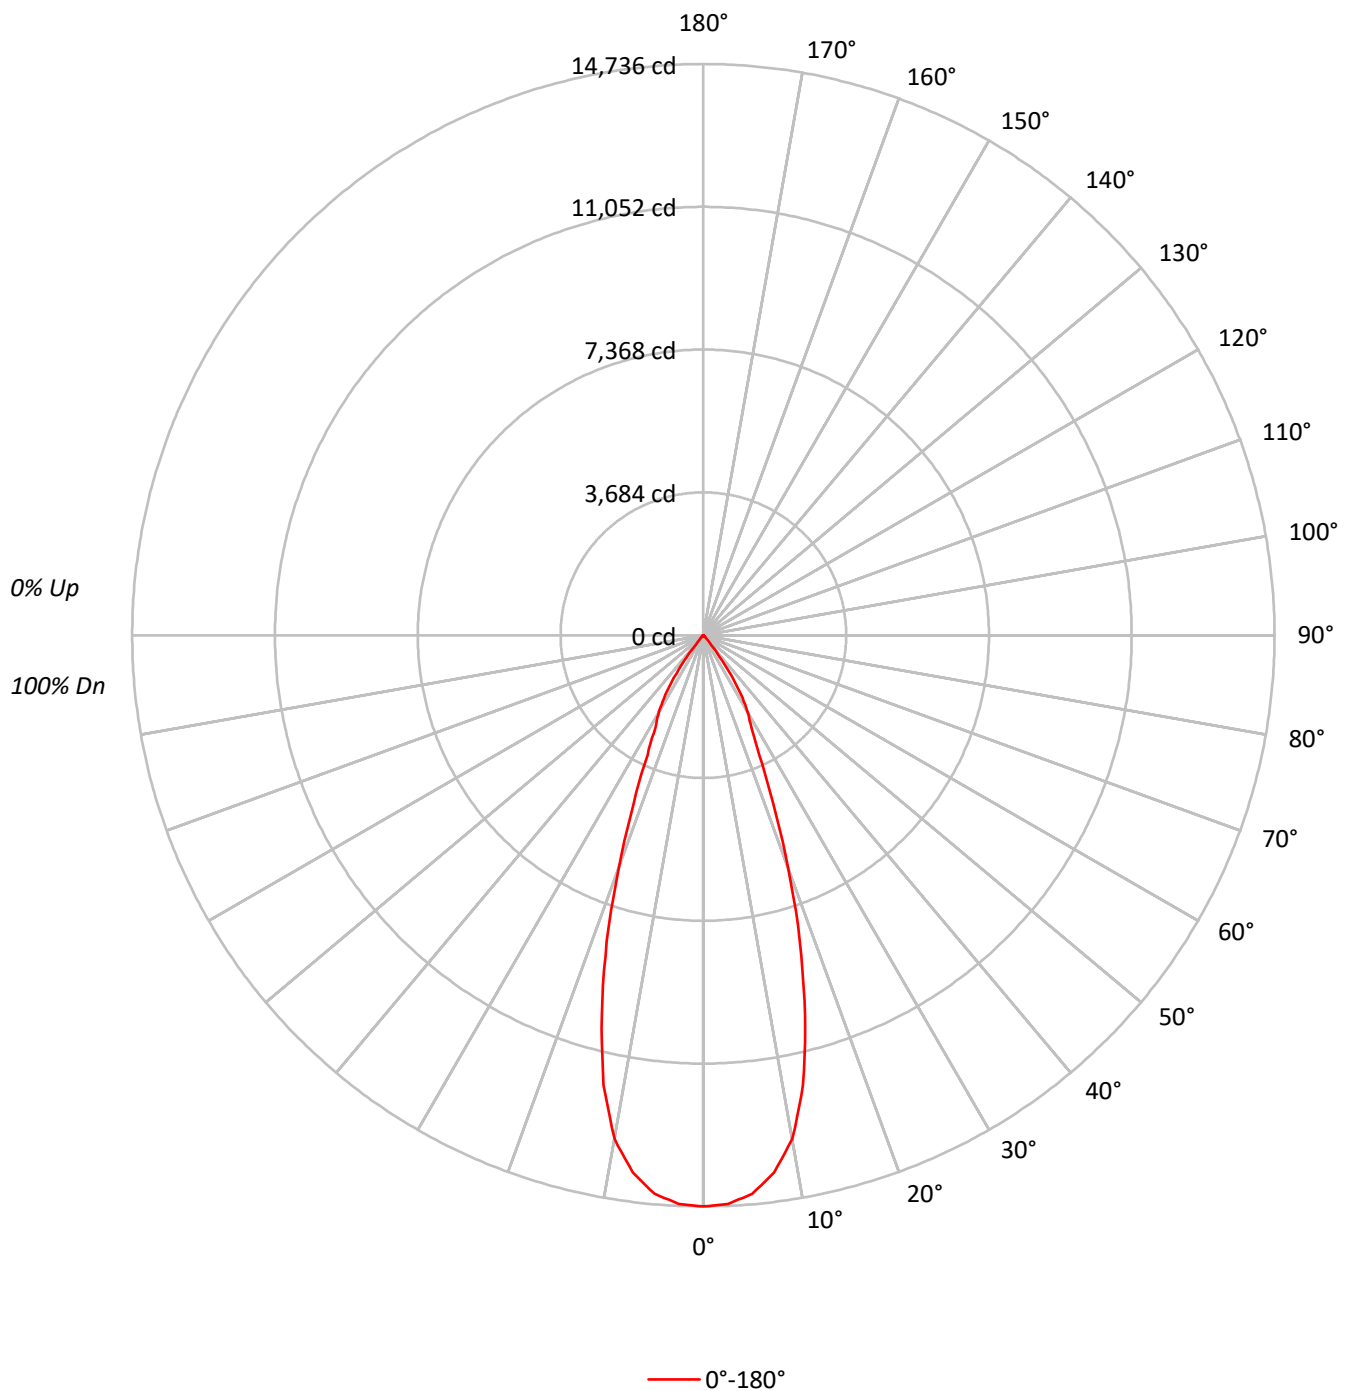

TEST NUMBER: P979564

CATALOG NUMBER: PRLX-CYL6-940-62L-FL-U-S-X-BLAK

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		0
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		100
1	114	112	110	108	112	110	108	106	106	104	103		102	101	100		95
2	110	106	102	100	108	104	101	99	101	99	96		98	96	94		91
3	106	100	96	93	104	99	95	92	96	93	91		94	92	89		87
4	102	95	91	87	100	94	90	87	92	89	86		90	87	85		83
5	98	91	86	83	96	90	85	82	88	84	81		87	83	81		79
6	94	87	82	78	93	86	81	78	85	81	78		83	80	77		75
7	91	83	78	75	89	82	78	74	81	77	74		80	76	74		72
8	87	79	75	71	86	79	74	71	78	74	71		77	73	70		69
9	84	76	71	68	83	76	71	68	75	71	68		74	70	68		66
10	81	73	68	65	80	73	68	65	72	68	65		71	68	65		64

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	148374
5°	146186
10°	134894
15°	105720
20°	68252
25°	37848
30°	26574
35°	14872
40°	1818
45°	500
50°	227
55°	109
60°	42
65°	0
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 500 cd/sqm

TEST NUMBER: P979564

CATALOG NUMBER: PRLX-CYL6-940-62L-FL-U-S-X-X-BLAK

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1340.2	20.5
10°-20°	2739.5	41.9
20°-30°	1690.1	25.8
30°-40°	730.0	11.2
40°-50°	35.3	0.5
50°-60°	6.4	0.1
60°-70°	0.8	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5769.8	88.2
0°-40°	6499.7	99.4
0°-60°	6541.4	100.0
0°-90°	6542.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6542.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	14736	
5°	14463	###
15°	10142	2740
25°	3407	1690
35°	1210	730
45°	35	35
55°	6	6
65°	0	1
75°	0	0
85°	0	0
90°	0	

TEST NUMBER: P979564

CATALOG NUMBER: PRLX-CYL6-940-62L-FL-U-S-X-X-BLAK

CANDELA DISTRIBUTION (FULL):

	0°
0°	14735.7
2.5°	14686.2
5°	14463.2
7.5°	13975.9
10°	13193.4
12.5°	11882.3
15°	10141.8
17.5°	8273.2
20°	6369.6
22.5°	4686.9
25°	3406.7
27.5°	2661.4
30°	2285.6
32.5°	1816.9
35°	1209.9
37.5°	586.4
40°	138.3
42.5°	53.7
45°	35.1
47.5°	22.7
50°	14.5
52.5°	10.3
55°	6.2
57.5°	4.1
60°	2.1
62.5°	2.1
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

TEST NUMBER: P979564

CATALOG NUMBER: PRLX-CYL6-940-62L-FL-U-S-X-X-BLAK

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
4H	2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
8H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
12H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

END OF REPORT