

Scaled data based on original data using  
LM-79-2024 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P1503977

Luminaire Tested: PRLX-SM6-03-LS-FS-010-XXXX-BRNZ-XX-OT (4000K-1200LM)

Issue Date: 7/28/2026

**Test Information**

Test Method: LM-79-2024  
Report Number: P1503977  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2606-836-20)  
Test Lab: INNOVATION CENTER  
Issue Date: 7/28/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PrentaLux  
Catalog Number: PRLX-SM6-03-LS-FS-010-XXXX-BRNZ-XX-OT (4000K-1200LM)  
Description: PrentaLux Fluxyn SM6 SURFACE MOUNT, DISC, OPEN TAPERED, BRONZE REFLECTOR  
LIGHT LEVEL 3 - 1200 NOMINAL LUMENS  
Light Source: SELECTABLE CCT - 4000K CCT, 90 CRI  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 877.8 lumens  
Efficiency: N/A  
Efficacy: 70.8 lumens/watt  
Spacing Criteria (0/90/45): 1.15 / 1.15 / 1.22  
Luminous Opening: Circular (Dia: 1.17' x H: 0')  
CIE Type: Direct

Input Watts (W): 12.4  
Input Voltage (V): 120  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1503977

CATALOG NUMBER: PRLX-SM6-03-LS-FS-010-XXXX-BRNZ-XX-OT (4000K-1200LM)

### Luminous Intensity Polar Plot

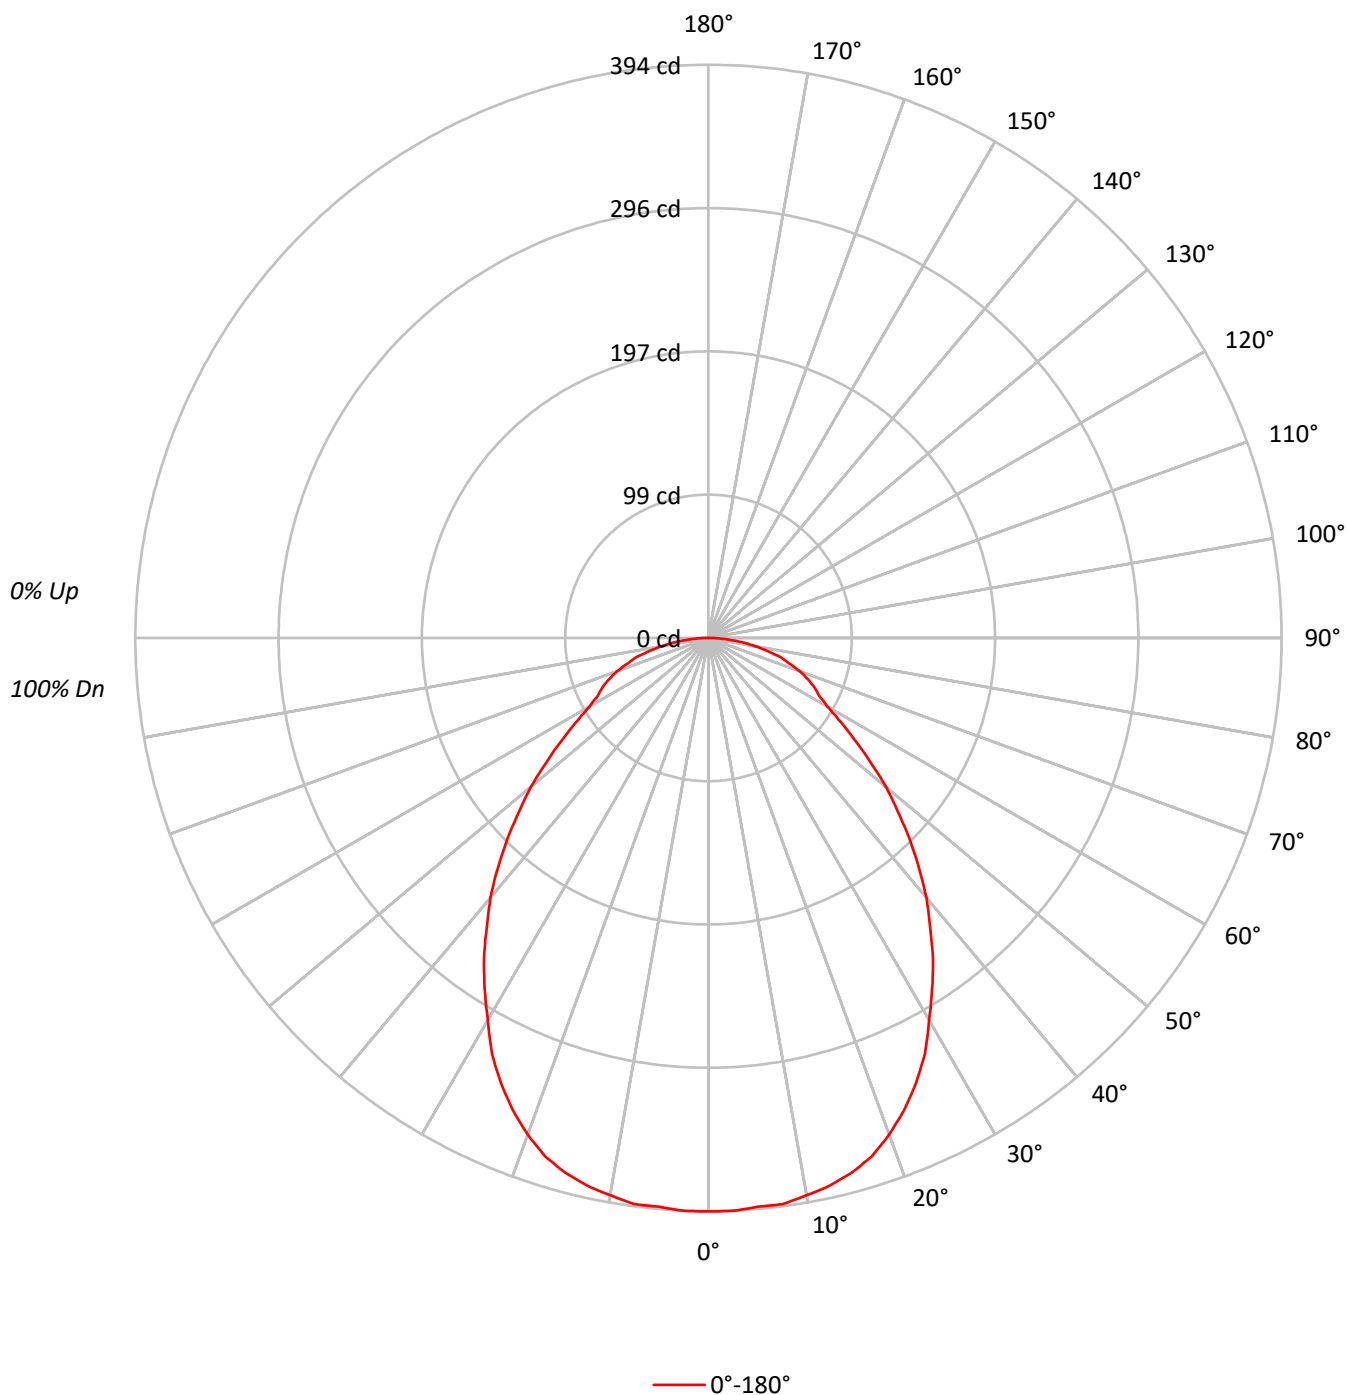



TEST NUMBER: P1503977

CATALOG NUMBER: PRLX-SM6-03-LS-FS-010-XXXX-BRNZ-XX-OT (4000K-1200LM)

### COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

|     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |  |  |    |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|--|--|----|
| RF  | 20  |     |     |     |     | 20  |     |     |     |     | 20  |     |     |     |     | 20  |     |     |  |  | 20 |
| RC  | 80  |     |     |     |     | 70  |     |     |     |     | 50  |     |     |     |     | 30  |     |     |  |  | 0  |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 0   |  |  |    |
| RCR |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |  |  |    |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 |  |  |    |
| 1   | 109 | 105 | 101 | 97  | 107 | 103 | 99  | 96  | 98  | 95  | 93  | 95  | 92  | 90  | 91  | 89  | 87  | 85  |  |  |    |
| 2   | 100 | 93  | 86  | 81  | 98  | 91  | 85  | 80  | 87  | 82  | 78  | 84  | 80  | 76  | 81  | 78  | 75  | 73  |  |  |    |
| 3   | 92  | 82  | 75  | 69  | 90  | 81  | 74  | 68  | 78  | 72  | 67  | 75  | 70  | 66  | 73  | 68  | 65  | 62  |  |  |    |
| 4   | 85  | 74  | 65  | 59  | 83  | 72  | 65  | 59  | 70  | 63  | 58  | 68  | 62  | 57  | 66  | 61  | 56  | 54  |  |  |    |
| 5   | 79  | 66  | 58  | 52  | 77  | 65  | 57  | 51  | 63  | 56  | 51  | 61  | 55  | 50  | 60  | 54  | 50  | 48  |  |  |    |
| 6   | 73  | 60  | 52  | 46  | 71  | 59  | 51  | 46  | 58  | 51  | 45  | 56  | 50  | 45  | 55  | 49  | 44  | 43  |  |  |    |
| 7   | 68  | 55  | 47  | 41  | 66  | 54  | 46  | 41  | 53  | 46  | 41  | 51  | 45  | 40  | 50  | 44  | 40  | 38  |  |  |    |
| 8   | 64  | 51  | 43  | 37  | 62  | 50  | 42  | 37  | 49  | 42  | 37  | 47  | 41  | 36  | 46  | 41  | 36  | 34  |  |  |    |
| 9   | 60  | 47  | 39  | 34  | 58  | 46  | 39  | 33  | 45  | 38  | 33  | 44  | 38  | 33  | 43  | 37  | 33  | 31  |  |  |    |
| 10  | 56  | 43  | 36  | 31  | 55  | 43  | 36  | 31  | 42  | 35  | 30  | 41  | 35  | 30  | 40  | 34  | 30  | 29  |  |  |    |

**AVERAGE LUMINANCE (cd/sqm):**

|     | 0°   |
|-----|------|
| 0°  | 3969 |
| 5°  | 3967 |
| 10° | 3977 |
| 15° | 3966 |
| 20° | 3893 |
| 25° | 3751 |
| 30° | 3526 |
| 35° | 3308 |
| 40° | 3064 |
| 45° | 2782 |
| 50° | 2497 |
| 55° | 2166 |
| 60° | 1899 |
| 65° | 1918 |
| 70° | 1967 |
| 75° | 2000 |
| 80° | 1890 |
| 85° | 1583 |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°

Vertical Angle:  $45^\circ$

Luminance: 2782 cd/sqm

TEST NUMBER: P1503977

CATALOG NUMBER: PRLX-SM6-03-LS-FS-010-XXXX-BRNZ-XX-OT (4000K-1200LM)

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 37.4   | 4.3       |
| 10°-20°   | 107.1  | 12.2      |
| 20°-30°   | 154.8  | 17.6      |
| 30°-40°   | 167.8  | 19.1      |
| 40°-50°   | 150.7  | 17.2      |
| 50°-60°   | 111.3  | 12.7      |
| 60°-70°   | 79.4   | 9.0       |
| 70°-80°   | 52.9   | 6.0       |
| 80°-90°   | 16.6   | 1.9       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| 0°-30°    | 299.2  | 34.1      |
| 0°-40°    | 467.0  | 53.2      |
| 0°-60°    | 729.0  | 83.0      |
| 0°-90°    | 877.8  | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 877.8  | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°  | Flux |
|-----|-----|------|
| 0°  | 394 |      |
| 5°  | 392 | 37   |
| 15° | 380 | 107  |
| 25° | 338 | 155  |
| 35° | 269 | 168  |
| 45° | 195 | 151  |
| 55° | 123 | 111  |
| 65° | 80  | 79   |
| 75° | 51  | 53   |
| 85° | 14  | 17   |
| 90° | 0   |      |

TEST NUMBER: P1503977

CATALOG NUMBER: PRLX-SM6-03-LS-FS-010-XXXX-BRNZ-XX-OT (4000K-1200LM)

**CANDELA DISTRIBUTION (FULL):**

|       | 0°    |
|-------|-------|
| 0°    | 394.2 |
| 2.5°  | 394.2 |
| 5°    | 392.5 |
| 7.5°  | 392.5 |
| 10°   | 389.0 |
| 12.5° | 385.6 |
| 15°   | 380.5 |
| 17.5° | 373.6 |
| 20°   | 363.3 |
| 22.5° | 351.3 |
| 25°   | 337.6 |
| 27.5° | 322.2 |
| 30°   | 303.3 |
| 32.5° | 286.2 |
| 35°   | 269.1 |
| 37.5° | 250.2 |
| 40°   | 233.1 |
| 42.5° | 214.2 |
| 45°   | 195.4 |
| 47.5° | 176.5 |
| 50°   | 159.4 |
| 52.5° | 140.5 |
| 55°   | 123.4 |
| 57.5° | 108.0 |
| 60°   | 94.3  |
| 62.5° | 85.7  |
| 65°   | 80.5  |
| 67.5° | 73.7  |
| 70°   | 66.8  |
| 72.5° | 58.3  |
| 75°   | 51.4  |
| 77.5° | 41.1  |
| 80°   | 32.6  |
| 82.5° | 24.0  |
| 85°   | 13.7  |
| 87.5° | 6.9   |
| 90°   | 0.0   |

(END OF REPORT)