

Scaled data based on original data using
LM-79-2024 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P1504529

Luminaire Tested: PRLX-UHBS2-1218-MV-L8C5-U-A-06-WHGL-PS (3000K_L12_Narrow_120V)

Issue Date: 7/31/2026

Test Information

Test Method: LM-79-2024
Report Number: P1504529
TEST IS SCALED FROM IESNA LM-79-24 TEST DATA (G2-2602-677-46)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 7/31/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-UHBS2-1218-MV-L8C5-U-A-06-WHGL-PS (3000K_L12_Narrow_120V)
Description: PrentaLux UHBS2 6-INCH SELECTABLE HIGH BAY 1218 LIGHT ENGINE, DOMIC WHITE SHADE, NARROW DISTRIBUTION
LIGHT LEVEL 1 - 12,000 LUMENS
Light Source:
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11063.3 lumens
Efficiency: N/A
Efficacy: 133.6 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.98
Luminous Opening: Circular (Dia: 1.29' x H: 0')
CIE Type: Direct

Input Watts (W): 82.8
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1504529

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-U-A-06-WHGL-PS (3000K_L12_Narrow_120V)

Luminous Intensity Polar Plot

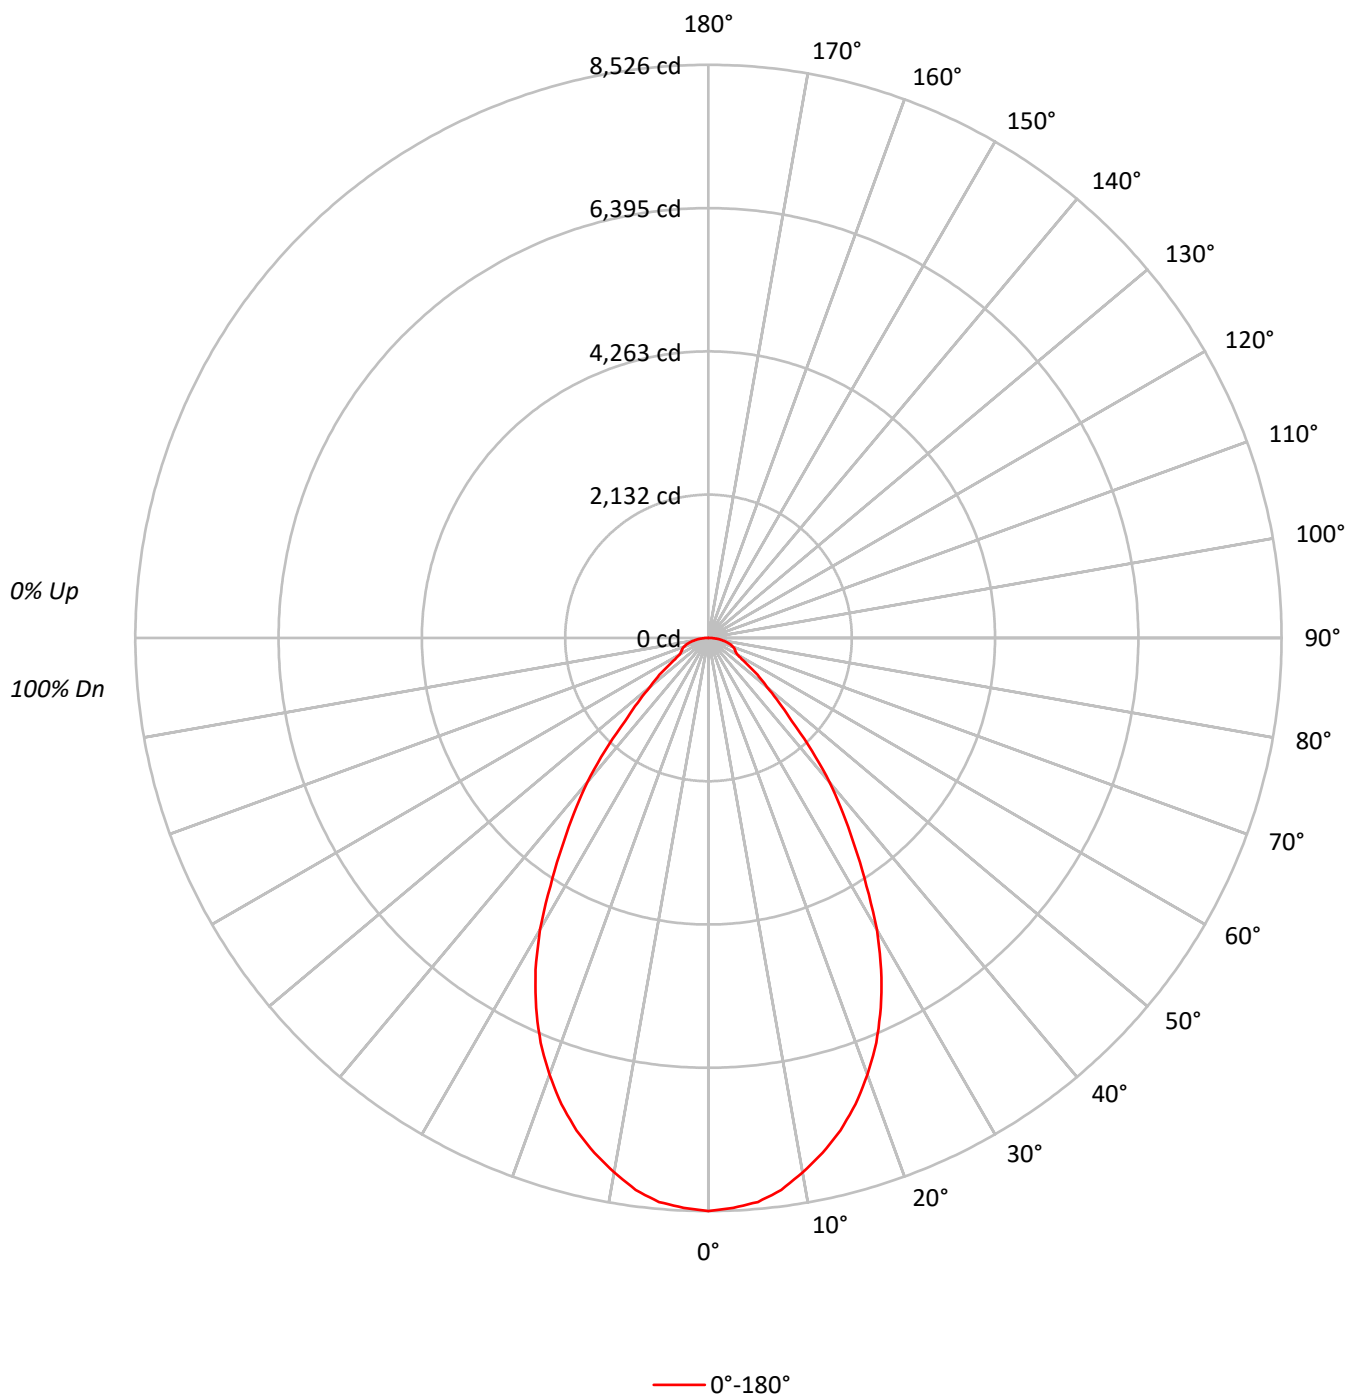

TEST NUMBER: P1504529

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-U-A-06-WHGL-PS (3000K_L12_Narrow_120V)

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10			
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	111	108	105	102	109	106	103	100	102	99	97	98	96	94	94	93	91	89		
2	104	98	93	88	102	96	91	87	93	89	85	90	86	83	87	84	82	80		
3	97	89	83	78	95	88	82	77	85	80	76	82	78	75	80	77	74	72		
4	91	82	75	70	89	81	74	69	78	73	68	76	71	67	74	70	67	65		
5	85	75	68	63	84	74	68	63	72	66	62	71	65	61	69	64	61	59		
6	80	70	62	57	79	69	62	57	67	61	56	66	60	56	64	59	56	54		
7	76	64	57	52	74	64	57	52	62	56	52	61	56	51	60	55	51	50		
8	71	60	53	48	70	59	53	48	58	52	48	57	52	48	56	51	47	46		
9	67	56	49	44	66	56	49	44	54	48	44	54	48	44	53	48	44	42		
10	64	53	46	41	63	52	46	41	51	45	41	50	45	41	49	44	41	39		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	70034
5°	69452
10°	67321
15°	64485
20°	60445
25°	55015
30°	47506
35°	38068
40°	30083
45°	20374
50°	14517
55°	10787
60°	8178
65°	8510
70°	9386
75°	9959
80°	10242
85°	10547

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 20374 cd/sqm

TEST NUMBER: P1504529

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-U-A-06-WHGL-PS (3000K_L12_Narrow_120V)

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	792.8	7.2
10°-20°	2123.0	19.2
20°-30°	2765.1	25.0
30°-40°	2386.7	21.6
40°-50°	1420.1	12.8
50°-60°	691.7	6.3
60°-70°	436.6	3.9
70°-80°	327.3	3.0
80°-90°	120.1	1.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5680.8	51.3
0°-40°	8067.5	72.9
0°-60°	10179.2	92.0
0°-90°	11063.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	11063.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	8526	
5°	8423	793
15°	7583	2123
25°	6070	2765
35°	3796	2387
45°	1754	1420
55°	753	692
65°	438	437
75°	314	327
85°	112	120
90°	0	

TEST NUMBER: P1504529

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-U-A-06-WHGL-PS (3000K_L12_Narrow_120V)

CANDELA DISTRIBUTION (FULL):

0°	
0°	8525.7
2.5°	8486.0
5°	8422.7
7.5°	8284.1
10°	8070.9
12.5°	7843.8
15°	7582.7
17.5°	7272.2
20°	6914.6
22.5°	6519.8
25°	6069.8
27.5°	5567.1
30°	5008.4
32.5°	4375.2
35°	3796.2
37.5°	3289.5
40°	2805.4
42.5°	2277.6
45°	1753.8
47.5°	1424.6
50°	1136.0
52.5°	953.5
55°	753.2
57.5°	586.2
60°	497.8
62.5°	461.4
65°	437.8
67.5°	418.4
70°	390.8
72.5°	355.9
75°	313.8
77.5°	266.8
80°	216.5
82.5°	165.4
85°	111.9
87.5°	55.9
90°	0.0

(END OF REPORT)