

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P1221182

Luminaire Tested: PRLX-UHBS2-1218-MV-L8C5-BLAK-08 (3500K_L18_Narrow_120V)

Issue Date: 1/21/2026

Test Information

Test Method: LM-79-2019
Report Number: P1221182
TEST IS SCALED FROM IESNA LM-79-24 TEST DATA (G2-2510-574-11)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/21/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-UHBS2-1218-MV-L8C5-BLAK-08 (3500K_L18_Narrow_120V)
Description: PrentaLux UHBS2 SELECTABLE HIGH BAY. 1218 LIGHT ENGINE, BLACK SHADE, NARROW DISTRIBUTION.
LIGHT LEVEL 1 - 18,000 LUMENS
Light Source: 3500K CCT, 80 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11990.7 lumens
Efficiency: N/A
Efficacy: 99.3 lumens/watt
Spacing Criteria (0/90/45): 0.97 / 0.97 / 0.95
Luminous Opening: Vertical Cylinder (Dia: 1.58' x H: 0.67')
CIE Type: Direct

Input Watts (W): 120.8
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1221182

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-BLAK-08 (3500K_L18_Narrow_120V)

Luminous Intensity Polar Plot

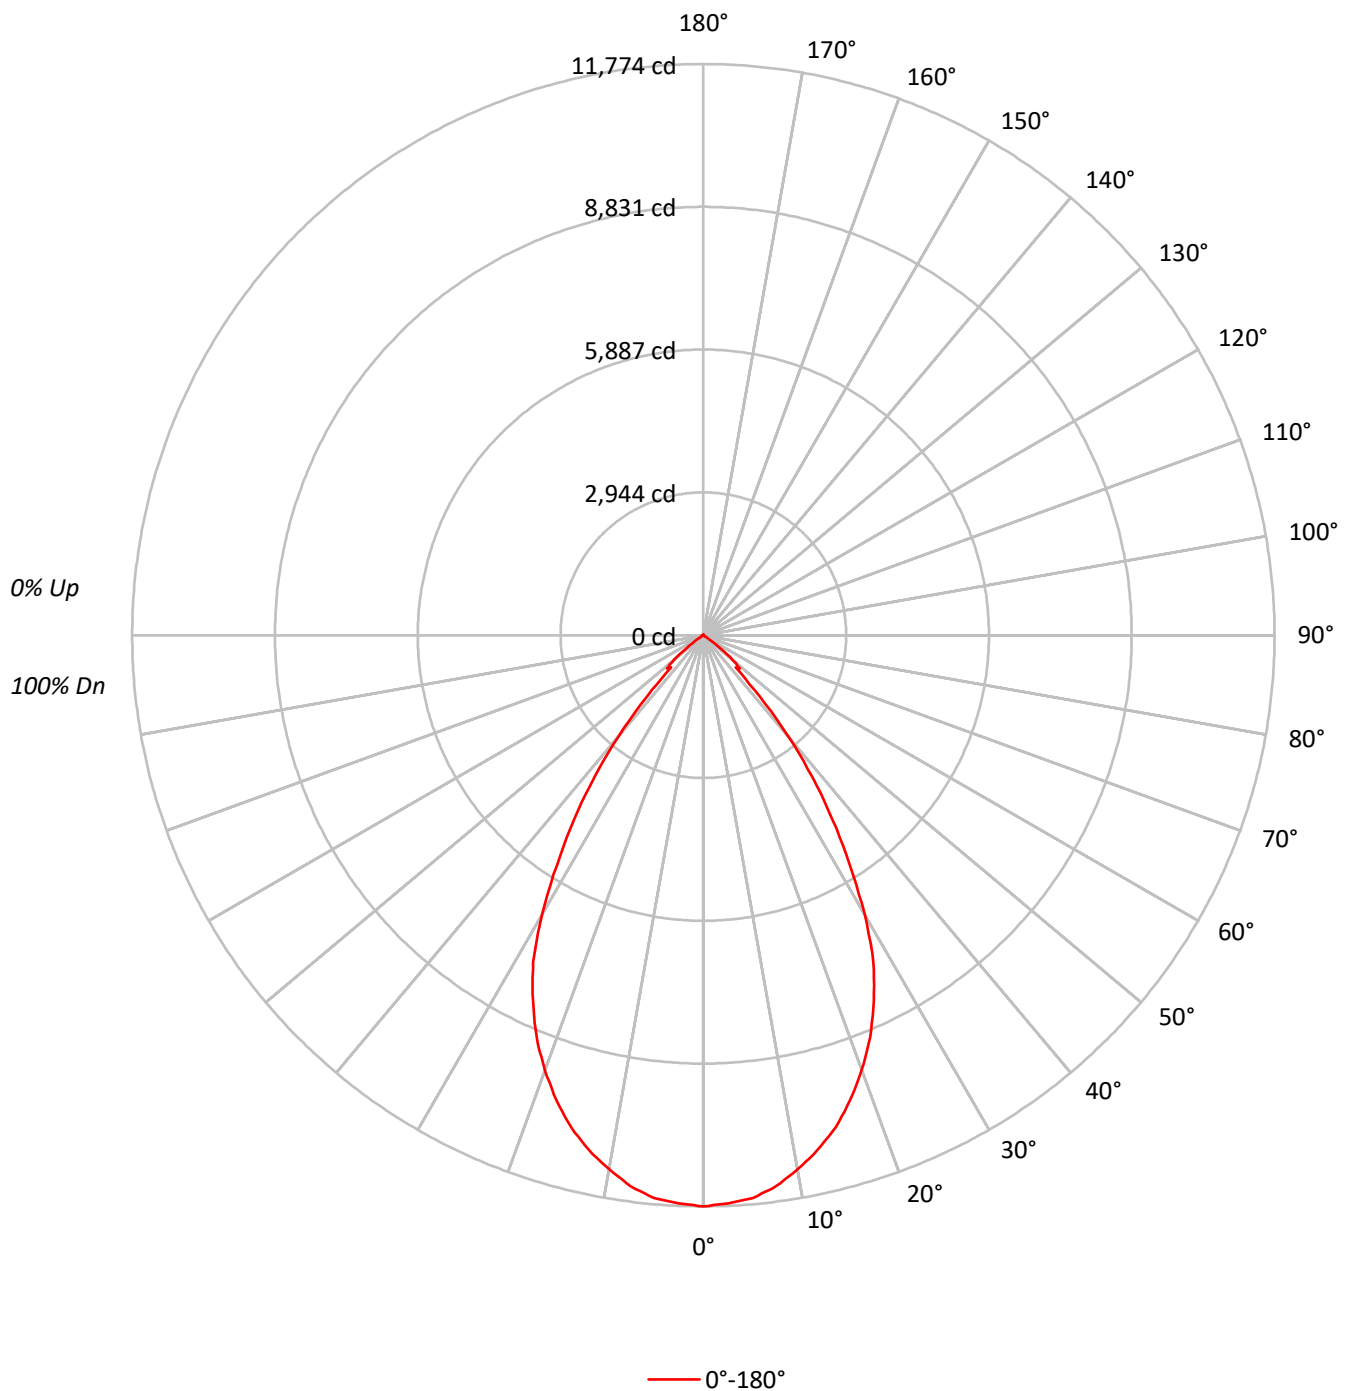

TEST NUMBER: P1221182

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-BLAK-08 (3500K_L18_Narrow_120V)

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	113	110	108	106	111	108	106	104	104	102	101	100	99	98	97	96	95	93		
2	107	102	98	95	105	101	97	94	97	94	91	94	92	89	92	89	88	86		
3	102	95	90	86	100	94	89	85	91	87	84	88	85	82	86	83	81	79		
4	96	88	83	78	94	87	82	78	85	80	77	83	79	76	81	78	75	73		
5	91	82	76	72	89	81	76	71	79	75	71	78	73	70	76	72	69	68		
6	86	77	71	66	85	76	70	66	74	69	65	73	68	65	72	68	64	63		
7	82	72	66	61	80	71	65	61	70	65	61	69	64	60	68	63	60	59		
8	77	67	61	57	76	67	61	57	66	60	57	65	60	56	64	59	56	55		
9	73	63	57	53	72	63	57	53	62	57	53	61	56	53	60	56	52	51		
10	70	60	54	50	69	59	53	50	58	53	49	58	53	49	57	52	49	48		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	64364
5°	61047
10°	56699
15°	52009
20°	46445
25°	40139
30°	32041
35°	22521
40°	13452
45°	4714
50°	4090
55°	593
60°	166
65°	155
70°	143
75°	123
80°	91
85°	51

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 47.5°
Luminance: 5200 cd/sqm

TEST NUMBER: P1221182

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-BLAK-08 (3500K_L18_Narrow_120V)

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1096.6	9.1
10°-20°	2938.8	24.5
20°-30°	3779.2	31.5
30°-40°	2880.8	24.0
40°-50°	1029.7	8.6
50°-60°	204.8	1.7
60°-70°	25.2	0.2
70°-80°	18.4	0.2
80°-90°	6.7	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.1	0.0
130°-140°	1.2	0.0
140°-150°	2.6	0.0
150°-160°	3.1	0.0
160°-170°	2.5	0.0
170°-180°	1.0	0.0
0°-30°	7814.5	65.2
0°-40°	10695.3	89.2
0°-60°	11929.9	99.5
0°-90°	11980.1	99.9
90°-120°	0.0	0.0
90°-150°	4.0	0.0
90°-180°	11.0	0.1
0°-180°	11990.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	11774	
5°	11646	###
15°	10509	2939
25°	8318	3779
35°	4641	2881
45°	937	1030
55°	110	205
65°	26	25
75°	18	18
85°	6	6
90°	0	0
95°	0	0
105°	0	0
115°	0	0
125°	0	0
135°	1	1
145°	5	3
155°	7	3
165°	9	3
175°	10	1
180°	10	

TEST NUMBER: P1221182

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-BLAK-08 (3500K_L18_Narrow_120V)

CANDELA DISTRIBUTION (FULL):

0°	
0°	11773.5
2.5°	11719.7
5°	11646.0
7.5°	11460.1
10°	11179.4
12.5°	10874.2
15°	10509.4
17.5°	10058.0
20°	9541.1
22.5°	8979.8
25°	8317.9
27.5°	7599.9
30°	6646.8
32.5°	5621.3
35°	4641.3
37.5°	3694.1
40°	2732.9
42.5°	1696.8
45°	936.7
47.5°	1018.5
50°	788.2
52.5°	373.0
55°	109.9
57.5°	49.1
60°	29.2
62.5°	26.9
65°	25.7
67.5°	23.4
70°	22.2
72.5°	19.9
75°	17.5
77.5°	15.2
80°	11.7
82.5°	9.4
85°	5.8
87.5°	3.5
90°	0.0
92.5°	0.0
95°	0.0
97.5°	0.0
100°	0.0
102.5°	0.0
105°	0.0
107.5°	0.0
110°	0.0

TEST NUMBER: P1221182

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-BLAK-08 (3500K_L18_Narrow_120V)

CANDELA DISTRIBUTION (continued):

	0°
112.5°	0.0
115°	0.0
117.5°	0.0
120°	0.0
122.5°	0.0
125°	0.0
127.5°	0.0
130°	1.2
132.5°	1.2
135°	1.2
137.5°	2.3
140°	2.3
142.5°	3.5
145°	4.7
147.5°	4.7
150°	5.8
152.5°	5.8
155°	7.0
157.5°	7.0
160°	8.2
162.5°	8.2
165°	9.4
167.5°	9.4
170°	10.5
172.5°	10.5
175°	10.5
177.5°	10.5
180°	10.5

TEST NUMBER: P1221182

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-BLAK-08 (3500K_L18_Narrow_120V)

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
4H	2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
8H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
12H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

END OF REPORT