

Scaled data based on original data using
LM-79-2024 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P1504538

Luminaire Tested: PRLX-UHBS2-1218-MV-L8C5-U-A-06-WHGL-PS (3500K_L12_Narrow_120V)

Issue Date: 7/31/2026

Test Information

Test Method: LM-79-2024
Report Number: P1504538
TEST IS SCALED FROM IESNA LM-79-24 TEST DATA (G2-2602-677-46)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 7/31/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-UHBS2-1218-MV-L8C5-U-A-06-WHGL-PS (3500K_L12_Narrow_120V)
Description: PrentaLux UHBS2 6-INCH SELECTABLE HIGH BAY 1218 LIGHT ENGINE, DOMIC WHITE
SHADE, NARROW DISTRIBUTION
LIGHT LEVEL 1 - 12,000 LUMENS
Light Source:
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11375.5 lumens
Efficiency: N/A
Efficacy: 139.2 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.98
Luminous Opening: Circular (Dia: 1.29' x H: 0')
CIE Type: Direct

Input Watts (W): 81.7
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1504538

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-U-A-06-WHGL-PS (3500K_L12_Narrow_120V)

Luminous Intensity Polar Plot

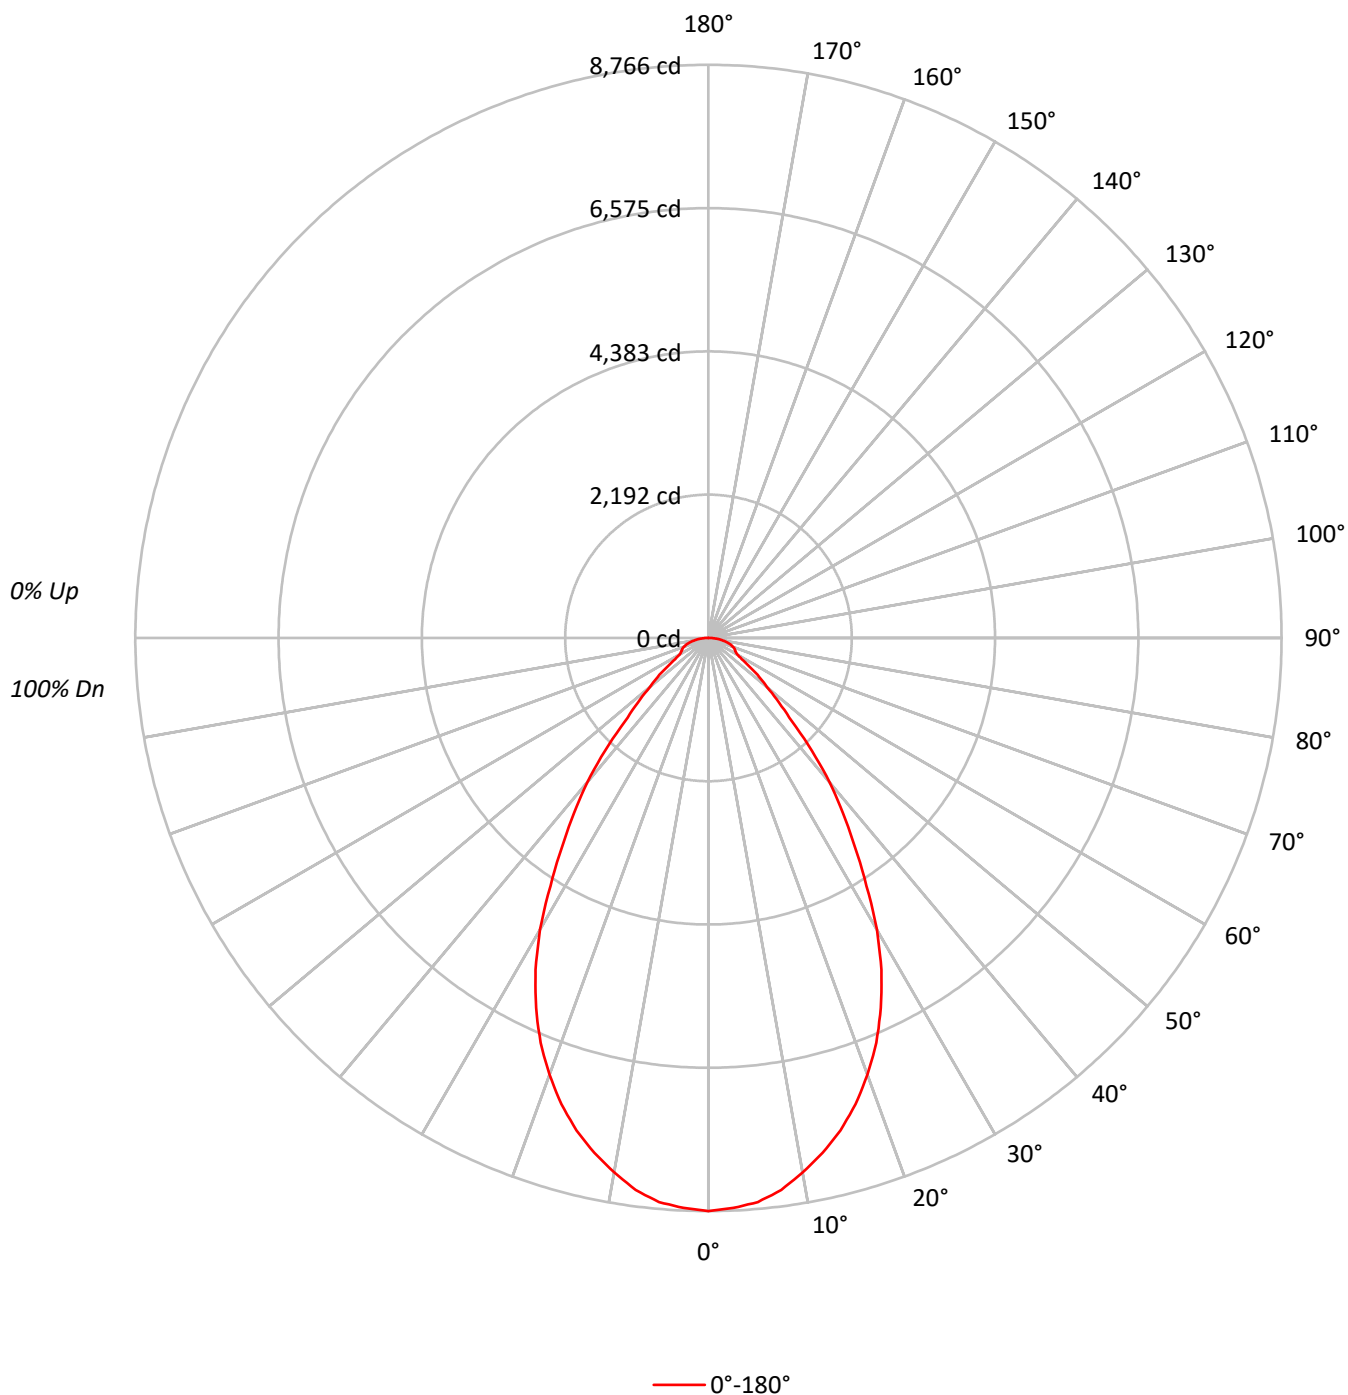



TEST NUMBER: P1504538

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-U-A-06-WHGL-PS (3500K_L12_Narrow_120V)

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10			
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	111	108	105	102	109	106	103	100	102	99	97	98	96	94	94	93	91	89		
2	104	98	93	88	102	96	91	87	93	89	85	90	86	83	87	84	82	80		
3	97	89	83	78	95	88	82	77	85	80	76	82	78	75	80	77	74	72		
4	91	82	75	70	89	81	74	69	78	73	68	76	71	67	74	70	67	65		
5	85	75	68	63	84	74	68	63	72	66	62	71	65	61	69	64	61	59		
6	80	70	62	57	79	69	62	57	67	61	56	66	60	56	64	59	56	54		
7	76	64	57	52	74	64	57	52	62	56	52	61	56	51	60	55	51	50		
8	71	60	53	48	70	59	53	48	58	52	48	57	52	48	56	51	47	46		
9	67	56	49	44	66	56	49	44	54	48	44	54	48	44	53	48	44	42		
10	64	53	46	41	63	52	46	41	51	45	41	50	45	41	49	44	41	39		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	72010
5°	71412
10°	69220
15°	66305
20°	62151
25°	56567
30°	48846
35°	39143
40°	30932
45°	20949
50°	14926
55°	11092
60°	8410
65°	8751
70°	9650
75°	10239
80°	10530
85°	10848

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 20949 cd/sqm

TEST NUMBER: P1504538

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-U-A-06-WHGL-PS (3500K_L12_Narrow_120V)

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	815.1	7.2
10°-20°	2182.9	19.2
20°-30°	2843.1	25.0
30°-40°	2454.0	21.6
40°-50°	1460.1	12.8
50°-60°	711.2	6.3
60°-70°	448.9	3.9
70°-80°	336.5	3.0
80°-90°	123.5	1.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5841.1	51.3
0°-40°	8295.1	72.9
0°-60°	10466.5	92.0
0°-90°	11375.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	11375.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	8766	
5°	8660	815
15°	7797	2183
25°	6241	2843
35°	3903	2454
45°	1803	1460
55°	774	711
65°	450	449
75°	323	337
85°	115	124
90°	0	

TEST NUMBER: P1504538

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-U-A-06-WHGL-PS (3500K_L12_Narrow_120V)

CANDELA DISTRIBUTION (FULL):

0°	
0°	8766.3
2.5°	8725.5
5°	8660.4
7.5°	8517.9
10°	8298.6
12.5°	8065.2
15°	7796.7
17.5°	7477.4
20°	7109.8
22.5°	6703.8
25°	6241.1
27.5°	5724.2
30°	5149.7
32.5°	4498.6
35°	3903.4
37.5°	3382.3
40°	2884.6
42.5°	2341.9
45°	1803.3
47.5°	1464.8
50°	1168.0
52.5°	980.4
55°	774.5
57.5°	602.8
60°	511.9
62.5°	474.4
65°	450.2
67.5°	430.2
70°	401.8
72.5°	366.0
75°	322.6
77.5°	274.3
80°	222.6
82.5°	170.1
85°	115.1
87.5°	57.5
90°	0.0

(END OF REPORT)