

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P1221191

Luminaire Tested: PRLX-UHBS2-1218-MV-L8C5-BLAK-08 (4000K_L18_Narrow_120V)

Issue Date: 1/21/2026

Test Information

Test Method: LM-79-2019
Report Number: P1221191
TEST IS SCALED FROM IESNA LM-79-24 TEST DATA (G2-2510-574-11)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/21/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-UHBS2-1218-MV-L8C5-BLAK-08 (4000K_L18_Narrow_120V)
Description: PrentaLux UHBS2 SELECTABLE HIGH BAY. 1218 LIGHT ENGINE, BLACK SHADE, NARROW DISTRIBUTION.
LIGHT LEVEL 1 - 18,000 LUMENS
Light Source: 4000K CCT, 80 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12250.6 lumens
Efficiency: N/A
Efficacy: 103.0 lumens/watt
Spacing Criteria (0/90/45): 0.97 / 0.97 / 0.95
Luminous Opening: Vertical Cylinder (Dia: 1.58' x H: 0.67')
CIE Type: Direct

Input Watts (W): 118.9
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1221191

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-BLAK-08 (4000K_L18_Narrow_120V)

Luminous Intensity Polar Plot

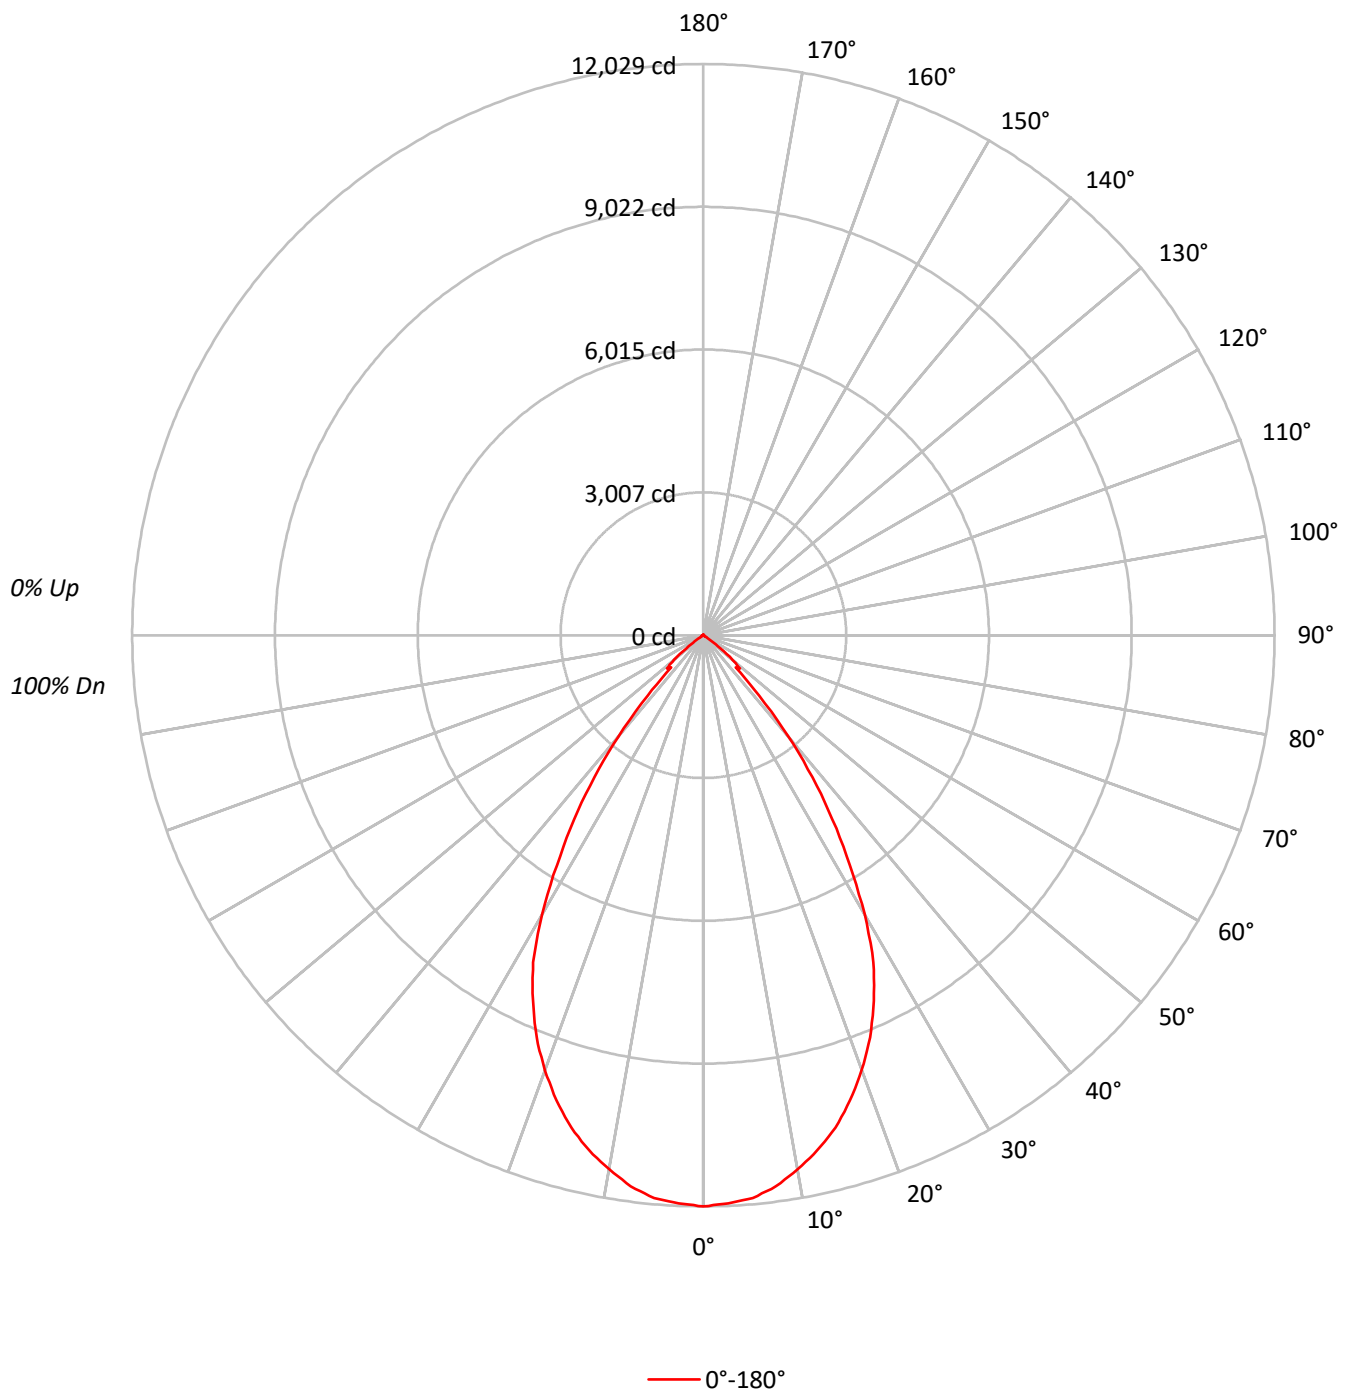

TEST NUMBER: P1221191

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-BLAK-08 (4000K_L18_Narrow_120V)

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102
1	113	110	108	106	111	108	106	104	104	102	101	100	99	98	97	96	95
2	107	102	98	95	105	101	97	94	97	94	91	94	92	89	92	89	88
3	102	95	90	86	100	94	89	85	91	87	84	88	85	82	86	83	81
4	96	88	83	78	94	87	82	78	85	80	77	83	79	76	81	78	75
5	91	82	76	72	89	81	76	71	79	75	71	78	73	70	76	72	69
6	86	77	71	66	85	76	70	66	74	69	65	73	68	65	72	68	64
7	82	72	66	61	80	71	65	61	70	65	61	69	64	60	68	63	60
8	77	67	61	57	76	67	61	57	66	60	57	65	60	56	64	59	56
9	73	63	57	53	72	63	57	53	62	57	53	61	56	53	60	56	52
10	70	60	54	50	69	59	53	50	58	53	49	58	53	49	57	52	49

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	65758
5°	62369
10°	57927
15°	53136
20°	47451
25°	41009
30°	32736
35°	23009
40°	13743
45°	4817
50°	4178
55°	606
60°	170
65°	158
70°	147
75°	126
80°	93
85°	53

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 47.5°
Luminance: 5312 cd/sqm

TEST NUMBER: P1221191

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-BLAK-08 (4000K_L18_Narrow_120V)

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1120.3	9.1
10°-20°	3002.4	24.5
20°-30°	3861.1	31.5
30°-40°	2943.3	24.0
40°-50°	1052.0	8.6
50°-60°	209.3	1.7
60°-70°	25.8	0.2
70°-80°	18.7	0.2
80°-90°	6.8	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.1	0.0
130°-140°	1.3	0.0
140°-150°	2.7	0.0
150°-160°	3.2	0.0
160°-170°	2.6	0.0
170°-180°	1.0	0.0
0°-30°	7983.8	65.2
0°-40°	10927.1	89.2
0°-60°	12188.4	99.5
0°-90°	12239.7	99.9
90°-120°	0.0	0.0
90°-150°	4.1	0.0
90°-180°	11.0	0.1
0°-180°	12250.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	12029	
5°	11898	###
15°	10737	3002
25°	8498	3861
35°	4742	2943
45°	957	1052
55°	112	209
65°	26	26
75°	18	19
85°	6	6
90°	0	0
95°	0	0
105°	0	0
115°	0	0
125°	0	0
135°	1	1
145°	5	3
155°	7	3
165°	10	3
175°	11	1
180°	11	

TEST NUMBER: P1221191

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-BLAK-08 (4000K_L18_Narrow_120V)

CANDELA DISTRIBUTION (FULL):

0°	
0°	12028.6
2.5°	11973.6
5°	11898.3
7.5°	11708.4
10°	11421.6
12.5°	11109.8
15°	10737.1
17.5°	10275.9
20°	9747.8
22.5°	9174.3
25°	8498.1
27.5°	7764.6
30°	6790.9
32.5°	5743.1
35°	4741.9
37.5°	3774.2
40°	2792.1
42.5°	1733.6
45°	957.0
47.5°	1040.6
50°	805.2
52.5°	381.1
55°	112.3
57.5°	50.2
60°	29.9
62.5°	27.5
65°	26.3
67.5°	23.9
70°	22.7
72.5°	20.3
75°	17.9
77.5°	15.5
80°	11.9
82.5°	9.6
85°	6.0
87.5°	3.6
90°	0.0
92.5°	0.0
95°	0.0
97.5°	0.0
100°	0.0
102.5°	0.0
105°	0.0
107.5°	0.0
110°	0.0

TEST NUMBER: P1221191

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-BLAK-08 (4000K_L18_Narrow_120V)

CANDELA DISTRIBUTION (continued):

	0°
112.5°	0.0
115°	0.0
117.5°	0.0
120°	0.0
122.5°	0.0
125°	0.0
127.5°	0.0
130°	1.2
132.5°	1.2
135°	1.2
137.5°	2.4
140°	2.4
142.5°	3.6
145°	4.8
147.5°	4.8
150°	6.0
152.5°	6.0
155°	7.2
157.5°	7.2
160°	8.4
162.5°	8.4
165°	9.6
167.5°	9.6
170°	10.8
172.5°	10.8
175°	10.8
177.5°	10.8
180°	10.8

TEST NUMBER: P1221191

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-BLAK-08 (4000K_L18_Narrow_120V)

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
4H	2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
8H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
12H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

END OF REPORT