

Scaled data based on original data using  
LM-79-2024 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P1504592

Luminaire Tested: PRLX-UHBS2-1218-MV-L8C5-U-B-04-BLAK-PS (4000K\_L12\_Narrow\_120V)

Issue Date: 7/31/2026

**Test Information**

Test Method: LM-79-2024  
Report Number: P1504592  
TEST IS SCALED FROM IESNA LM-79-24 TEST DATA (G2-2602-677-28)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 7/31/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PrentaLux  
Catalog Number: PRLX-UHBS2-1218-MV-L8C5-U-B-04-BLAK-PS (4000K\_L12\_Narrow\_120V)  
Description: PrentaLux UHBS2 4-INCH SELECTABLE HIGH BAY 1218 LIGHT ENGINE, CONIC BLACK SHADE, NARROW DISTRIBUTION  
LIGHT LEVEL 1 - 12,000 LUMENS  
Light Source: 4000K CCT, 80 CRI LEDS  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 10800.9 lumens  
Efficiency: N/A  
Efficacy: 133.8 lumens/watt  
Spacing Criteria (0/90/45): 0.94 / 0.94 / 0.97  
Luminous Opening: Circular (Dia: 1.26' x H: 0')  
CIE Type: Direct

Input Watts (W): 80.7  
Input Voltage (V): 120  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1504592

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-U-B-04-BLAK-PS (4000K\_L12\_Narrow\_120V)

### Luminous Intensity Polar Plot

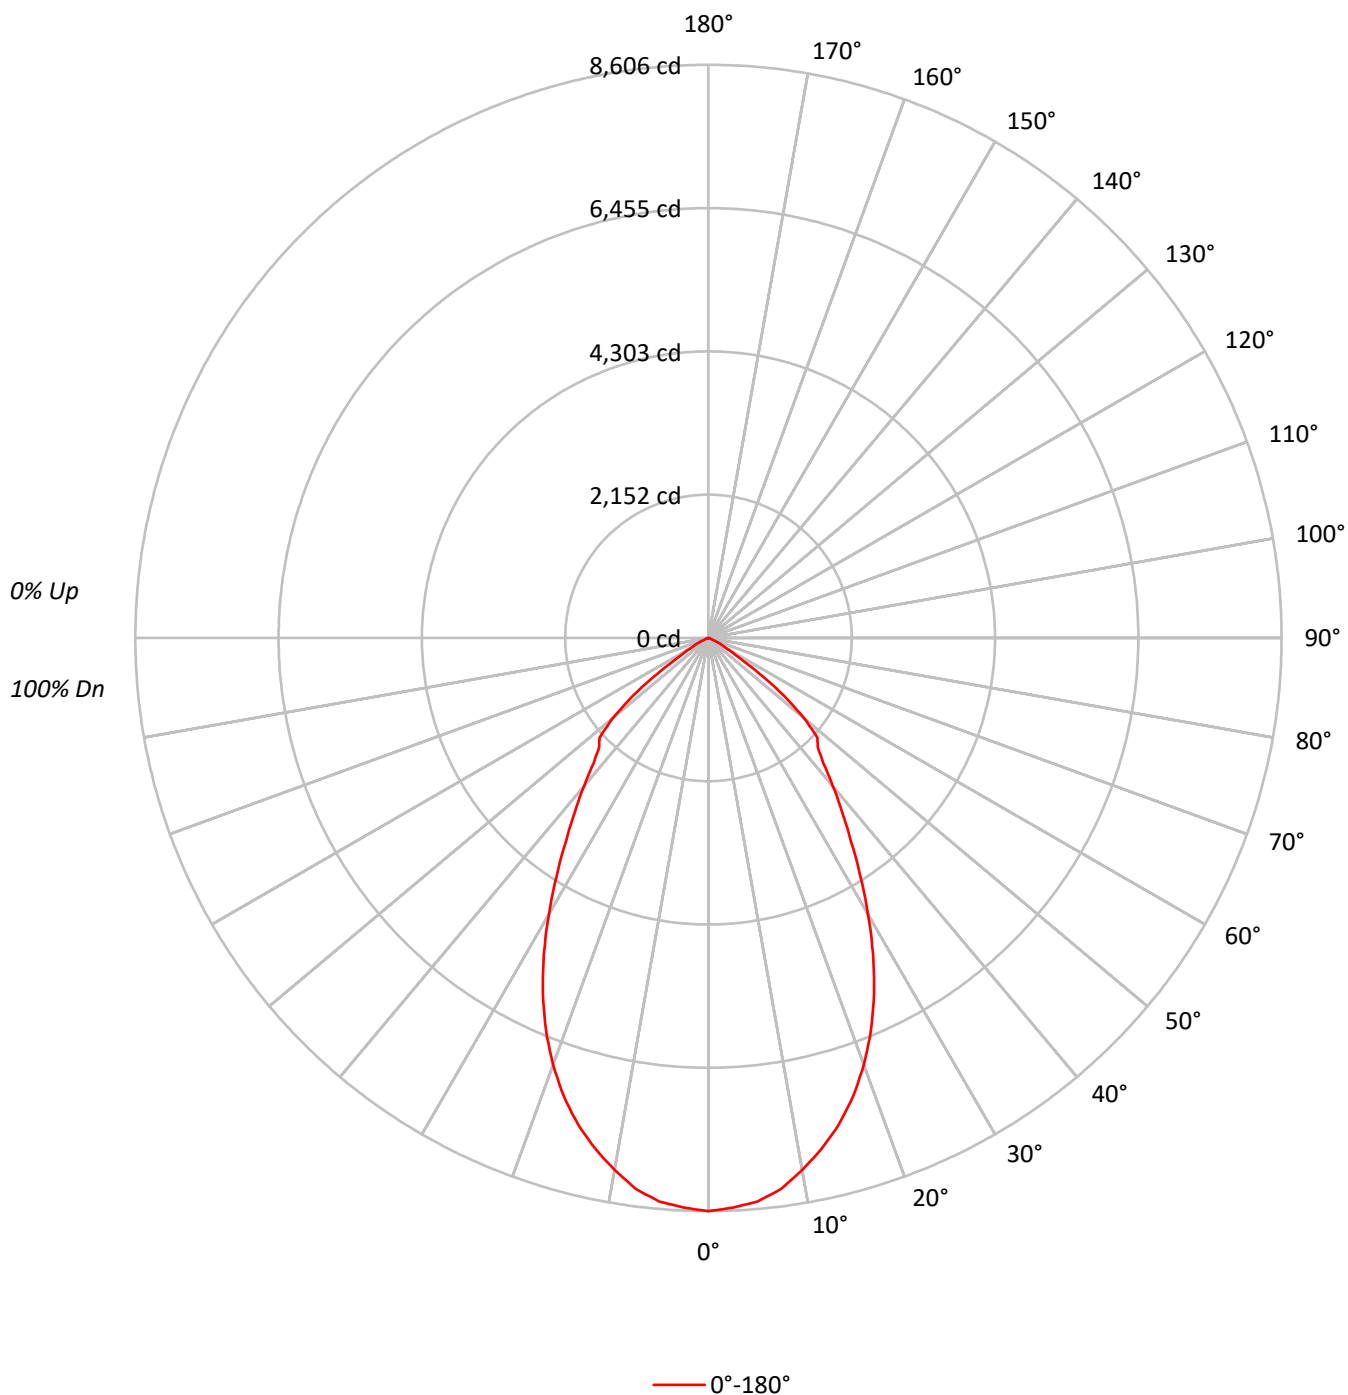



TEST NUMBER: P1504592

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-U-B-04-BLAK-PS (4000K\_L12\_Narrow\_120V)

### COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

|     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |  |  |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|--|--|
| RF  | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |  |  |
| RC  | 80  |     |     |     | 70  |     |     |     | 50  |     |     |     | 30  |     |     |     | 10  |     |  |  |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 0   |  |  |
| RCR |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |  |  |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 |  |  |
| 1   | 113 | 109 | 106 | 104 | 110 | 107 | 105 | 102 | 103 | 101 | 99  | 99  | 98  | 96  | 96  | 95  | 93  | 91  |  |  |
| 2   | 106 | 100 | 95  | 91  | 103 | 98  | 94  | 90  | 95  | 91  | 88  | 92  | 89  | 86  | 89  | 87  | 84  | 83  |  |  |
| 3   | 99  | 91  | 86  | 81  | 97  | 90  | 85  | 80  | 87  | 83  | 79  | 85  | 81  | 78  | 82  | 79  | 76  | 75  |  |  |
| 4   | 93  | 84  | 77  | 72  | 91  | 83  | 77  | 72  | 80  | 75  | 71  | 78  | 74  | 70  | 76  | 73  | 69  | 68  |  |  |
| 5   | 87  | 77  | 70  | 65  | 85  | 76  | 70  | 65  | 74  | 69  | 64  | 72  | 68  | 64  | 71  | 67  | 63  | 61  |  |  |
| 6   | 82  | 71  | 64  | 59  | 80  | 70  | 64  | 59  | 69  | 63  | 59  | 67  | 62  | 58  | 66  | 61  | 58  | 56  |  |  |
| 7   | 77  | 66  | 59  | 54  | 75  | 65  | 59  | 54  | 64  | 58  | 54  | 63  | 57  | 53  | 61  | 57  | 53  | 51  |  |  |
| 8   | 72  | 61  | 54  | 50  | 71  | 61  | 54  | 49  | 59  | 53  | 49  | 58  | 53  | 49  | 57  | 52  | 49  | 47  |  |  |
| 9   | 68  | 57  | 50  | 46  | 67  | 57  | 50  | 46  | 56  | 50  | 45  | 55  | 49  | 45  | 54  | 49  | 45  | 44  |  |  |
| 10  | 65  | 53  | 47  | 42  | 63  | 53  | 47  | 42  | 52  | 46  | 42  | 51  | 46  | 42  | 50  | 45  | 42  | 40  |  |  |

**AVERAGE LUMINANCE (cd/sqm):**

|     | 0°    |
|-----|-------|
| 0°  | 74491 |
| 5°  | 73785 |
| 10° | 71282 |
| 15° | 67769 |
| 20° | 62814 |
| 25° | 56180 |
| 30° | 47892 |
| 35° | 39465 |
| 40° | 32847 |
| 45° | 28376 |
| 50° | 25210 |
| 55° | 14152 |
| 60° | 5747  |
| 65° | 2423  |
| 70° | 640   |
| 75° | 254   |
| 80° | 294   |
| 85° | 248   |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°

Vertical Angle:  $47.5^\circ$

Luminance: 28434 cd/sqm

TEST NUMBER: P1504592

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-U-B-04-BLAK-PS (4000K\_L12\_Narrow\_120V)

**ZONAL LUMENS:**

| Zone      | Lumens  | % Fixture |
|-----------|---------|-----------|
| 0°-10°    | 798.5   | 7.4       |
| 10°-20°   | 2114.8  | 19.6      |
| 20°-30°   | 2682.1  | 24.8      |
| 30°-40°   | 2351.9  | 21.8      |
| 40°-50°   | 1825.6  | 16.9      |
| 50°-60°   | 875.1   | 8.1       |
| 60°-70°   | 139.2   | 1.3       |
| 70°-80°   | 10.5    | 0.1       |
| 80°-90°   | 3.1     | 0.0       |
| 90°-100°  | 0.0     | 0.0       |
| 100°-110° | 0.0     | 0.0       |
| 110°-120° | 0.0     | 0.0       |
| 120°-130° | 0.0     | 0.0       |
| 130°-140° | 0.0     | 0.0       |
| 140°-150° | 0.0     | 0.0       |
| 150°-160° | 0.0     | 0.0       |
| 160°-170° | 0.0     | 0.0       |
| 170°-180° | 0.0     | 0.0       |
| 0°-30°    | 5595.4  | 51.8      |
| 0°-40°    | 7947.3  | 73.6      |
| 0°-60°    | 10648.0 | 98.6      |
| 0°-90°    | 10800.9 | 100.0     |
| 90°-120°  | 0.0     | 0.0       |
| 90°-150°  | 0.0     | 0.0       |
| 90°-180°  | 0.0     | 0.0       |
| 0°-180°   | 10800.9 | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°   | Flux |
|-----|------|------|
| 0°  | 8606 |      |
| 5°  | 8492 | 799  |
| 15° | 7563 | 2115 |
| 25° | 5883 | 2682 |
| 35° | 3735 | 2352 |
| 45° | 2318 | 1826 |
| 55° | 938  | 875  |
| 65° | 118  | 139  |
| 75° | 8    | 11   |
| 85° | 2    | 3    |
| 90° | 0    |      |

TEST NUMBER: P1504592

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-U-B-04-BLAK-PS (4000K\_L12\_Narrow\_120V)

**CANDELA DISTRIBUTION (FULL):**

| 0°    |        |
|-------|--------|
| 0°    | 8606.3 |
| 2.5°  | 8559.8 |
| 5°    | 8492.3 |
| 7.5°  | 8343.6 |
| 10°   | 8110.4 |
| 12.5° | 7854.4 |
| 15°   | 7562.9 |
| 17.5° | 7220.8 |
| 20°   | 6819.5 |
| 22.5° | 6376.8 |
| 25°   | 5882.6 |
| 27.5° | 5351.2 |
| 30°   | 4791.9 |
| 32.5° | 4243.6 |
| 35°   | 3735.0 |
| 37.5° | 3294.8 |
| 40°   | 2907.1 |
| 42.5° | 2550.6 |
| 45°   | 2318.2 |
| 47.5° | 2219.4 |
| 50°   | 1872.2 |
| 52.5° | 1440.4 |
| 55°   | 937.8  |
| 57.5° | 485.8  |
| 60°   | 332.0  |
| 62.5° | 213.7  |
| 65°   | 118.3  |
| 67.5° | 58.3   |
| 70°   | 25.3   |
| 72.5° | 10.1   |
| 75°   | 7.6    |
| 77.5° | 6.8    |
| 80°   | 5.9    |
| 82.5° | 4.2    |
| 85°   | 2.5    |
| 87.5° | 1.7    |
| 90°   | 0.0    |

(END OF REPORT)