

Scaled data based on original data using
LM-79-2024 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P1504549

Luminaire Tested: PRLX-UHBS2-1218-MV-L8C5-U-A-06-WHGL-PS (4000K_L16_Medium_120V)

Issue Date: 7/31/2026

Test Information

Test Method: LM-79-2024
Report Number: P1504549
TEST IS SCALED FROM IESNA LM-79-24 TEST DATA (G2-2602-677-47)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 7/31/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-UHBS2-1218-MV-L8C5-U-A-06-WHGL-PS (4000K_L16_Medium_120V)
Description: PrentaLux UHBS2 6-INCH SELECTABLE HIGH BAY 1218 LIGHT ENGINE, DOMIC WHITE SHADE, MEDIUM DISTRIBUTION
LIGHT LEVEL 2 - 16,000 LUMENS
Light Source:
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14362.5 lumens
Efficiency: N/A
Efficacy: 144.3 lumens/watt
Spacing Criteria (0/90/45): 1.15 / 1.15 / 1.08
Luminous Opening: Circular (Dia: 1.29' x H: 0')
CIE Type: Direct

Input Watts (W): 99.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1504549

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-U-A-06-WHGL-PS (4000K_L16_Medium_120V)

Luminous Intensity Polar Plot

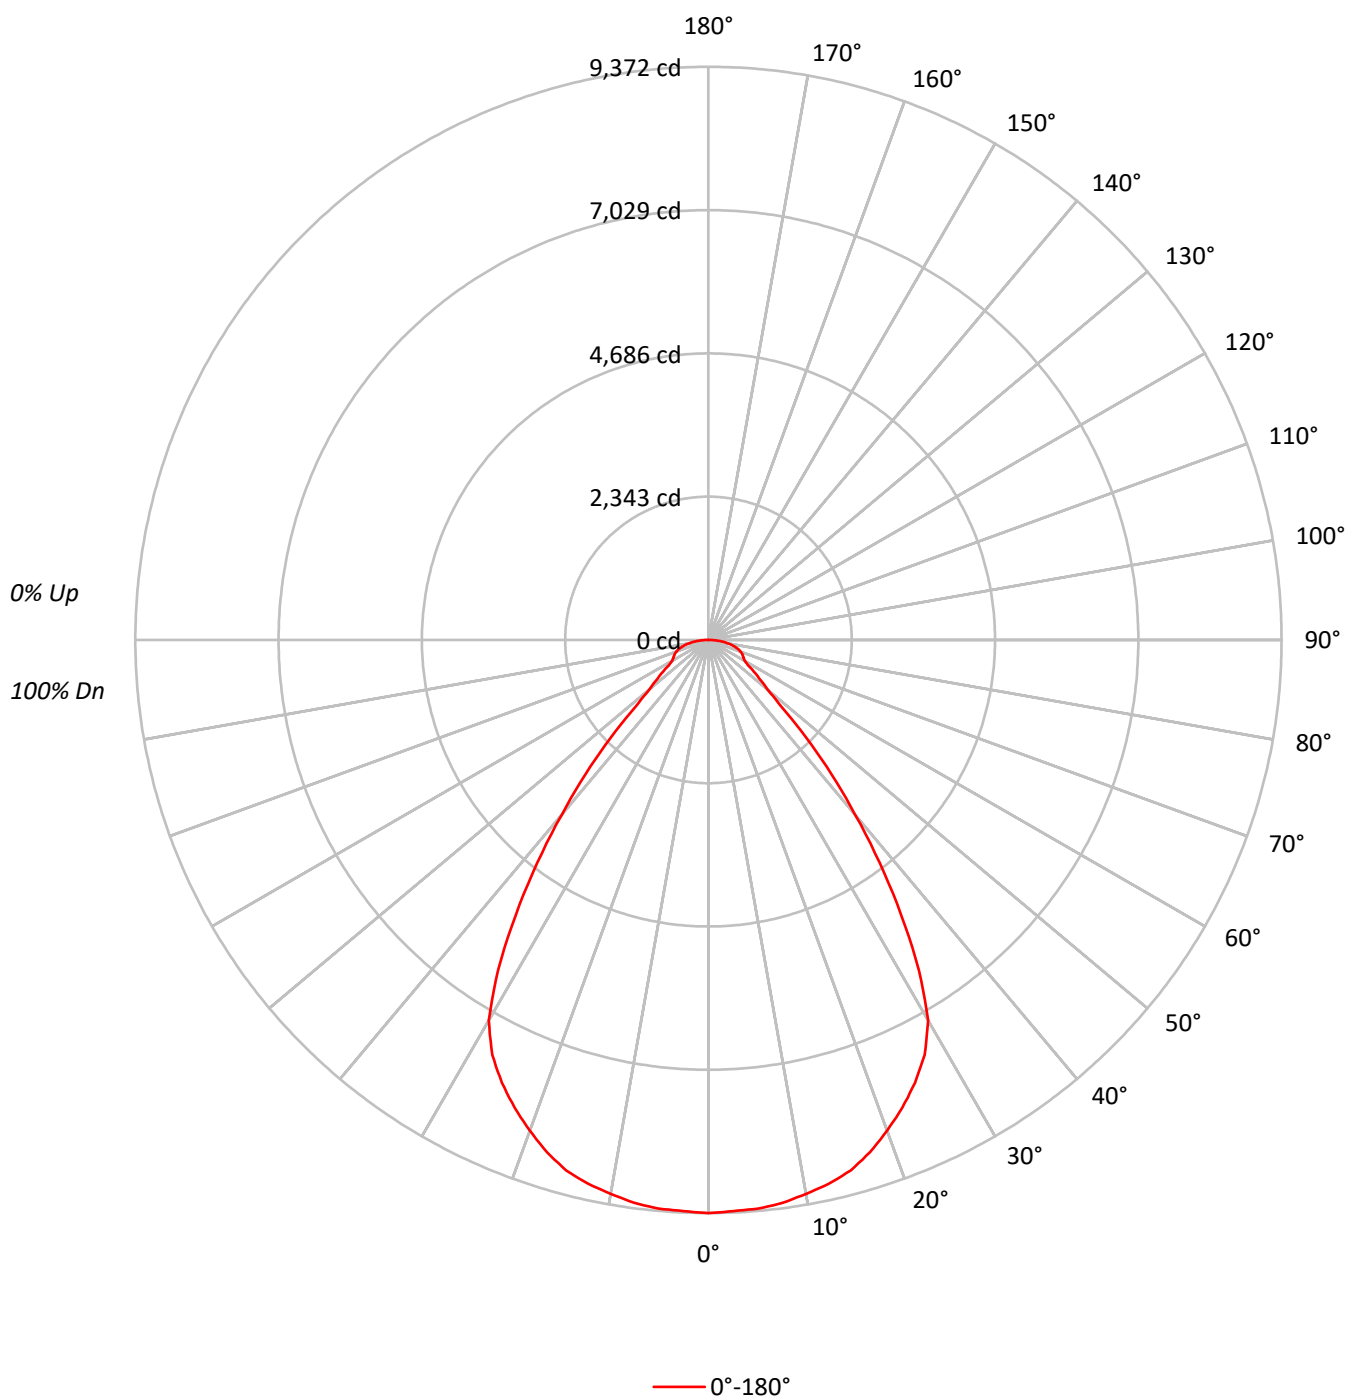



TEST NUMBER: P1504549

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-U-A-06-WHGL-PS (4000K_L16_Medium_120V)

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10			
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	111	108	104	101	109	105	102	100	101	99	96	97	95	94	94	92	91	89		
2	104	97	92	88	101	96	91	87	92	88	85	89	86	83	86	83	81	79		
3	97	89	82	77	95	87	81	76	84	79	75	82	77	74	79	76	73	71		
4	91	81	74	69	89	80	73	68	77	72	67	75	70	67	73	69	66	64		
5	85	74	67	62	83	73	67	61	71	65	61	70	64	60	68	63	60	58		
6	80	69	61	56	78	68	61	56	66	60	55	65	59	55	63	58	55	53		
7	75	63	56	51	73	63	56	51	61	55	51	60	54	50	59	54	50	48		
8	70	59	52	47	69	58	51	47	57	51	46	56	50	46	55	50	46	44		
9	66	55	48	43	65	54	48	43	53	47	43	52	47	43	51	46	43	41		
10	63	51	45	40	62	51	44	40	50	44	40	49	44	40	48	43	39	38		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	76990
5°	76974
10°	76702
15°	76385
20°	74649
25°	72412
30°	68150
35°	55128
40°	40060
45°	26160
50°	16183
55°	13037
60°	11229
65°	12078
70°	13459
75°	14558
80°	15492
85°	15815

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 26160 cd/sqm

TEST NUMBER: P1504549

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-U-A-06-WHGL-PS (4000K_L16_Medium_120V)

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	886.6	6.2
10°-20°	2523.4	17.6
20°-30°	3659.9	25.5
30°-40°	3405.6	23.7
40°-50°	1781.0	12.4
50°-60°	829.3	5.8
60°-70°	617.0	4.3
70°-80°	478.6	3.3
80°-90°	181.0	1.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	7070.0	49.2
0°-40°	10475.6	72.9
0°-60°	13085.9	91.1
0°-90°	14362.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	14362.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	9372	
5°	9335	887
15°	8982	2523
25°	7989	3660
35°	5497	3406
45°	2252	1781
55°	910	829
65°	621	617
75°	459	479
85°	168	181
90°	0	

TEST NUMBER: P1504549

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-U-A-06-WHGL-PS (4000K_L16_Medium_120V)

CANDELA DISTRIBUTION (FULL):

	0°
0°	9372.5
2.5°	9347.1
5°	9334.9
7.5°	9284.1
10°	9195.6
12.5°	9108.1
15°	8982.0
17.5°	8783.6
20°	8539.5
22.5°	8279.2
25°	7989.3
27.5°	7651.6
30°	7184.8
32.5°	6401.6
35°	5497.4
37.5°	4599.3
40°	3735.8
42.5°	2981.1
45°	2251.9
47.5°	1606.0
50°	1266.3
52.5°	1065.9
55°	910.3
57.5°	768.9
60°	683.5
62.5°	649.9
65°	621.4
67.5°	596.0
70°	560.4
72.5°	513.6
75°	458.7
77.5°	396.7
80°	327.5
82.5°	250.2
85°	167.8
87.5°	83.4
90°	0.0

(END OF REPORT)