

Scaled data based on original data using
LM-79-2024 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P1504429

Luminaire Tested: PRLX-UHBS2-1218-MV-L8C5-U-A-06-BLAK-PS (6500K_L12_Medium_120V)

Issue Date: 7/31/2026

Test Information

Test Method: LM-79-2024
Report Number: P1504429
TEST IS SCALED FROM IESNA LM-79-24 TEST DATA (G2-2602-677-41)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 7/31/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-UHBS2-1218-MV-L8C5-U-A-06-BLAK-PS (6500K_L12_Medium_120V)
Description: PrentaLux UHBS2 6-INCH SELECTABLE HIGH BAY 1218 LIGHT ENGINE, DOMIC BLACK SHADE, MEDIUM DISTRIBUTION
LIGHT LEVEL 1 - 12,000 LUMENS
Light Source:
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9290.5 lumens
Efficiency: N/A
Efficacy: 111.9 lumens/watt
Spacing Criteria (0/90/45): 1.12 / 1.12 / 1.05
Luminous Opening: Circular (Dia: 1.29' x H: 0')
CIE Type: Direct

Input Watts (W): 83
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1504429

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-U-A-06-BLAK-PS (6500K_L12_Medium_120V)

Luminous Intensity Polar Plot

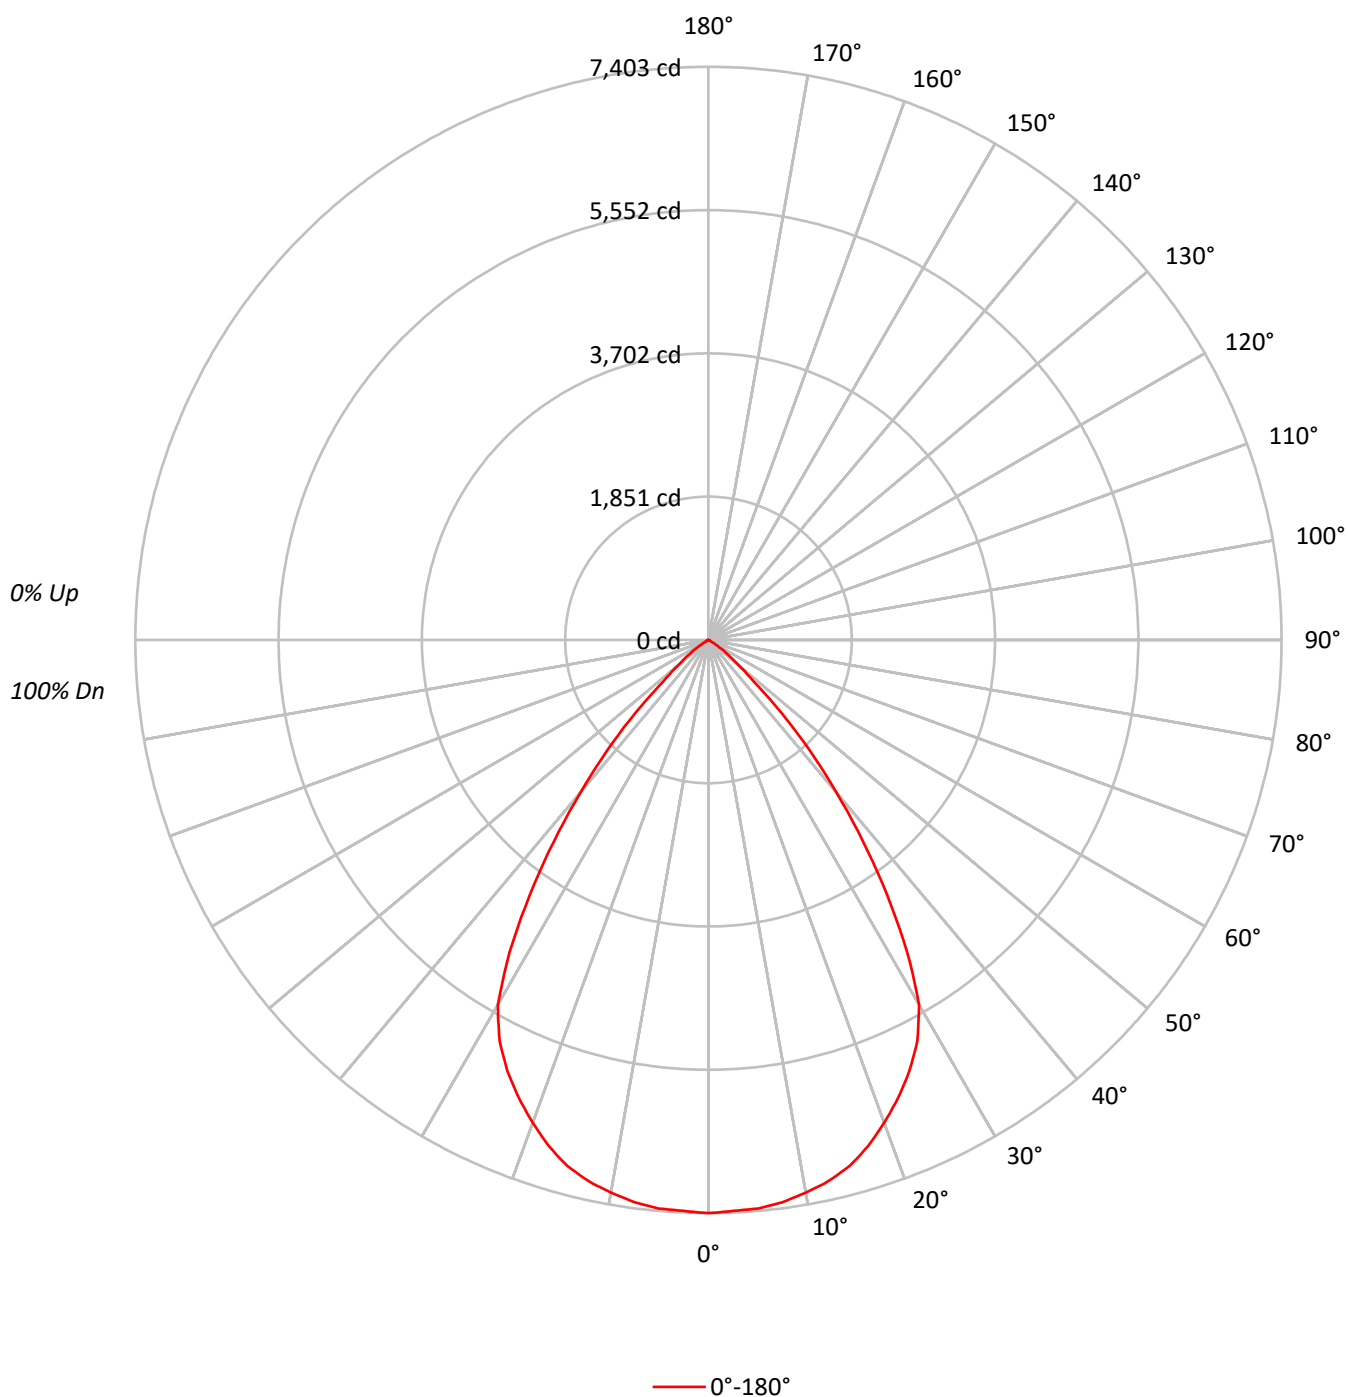

TEST NUMBER: P1504429

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-U-A-06-BLAK-PS (6500K_L12_Medium_120V)

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20
RC	80					70					50					30					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0			
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	93			
2	107	102	97	93	105	100	96	92	97	93	90	94	91	88	91	89	87	85			
3	101	94	88	84	99	92	87	83	90	85	82	87	84	81	85	82	79	78			
4	95	87	81	76	93	86	80	76	83	79	75	81	77	74	79	76	73	71			
5	90	80	74	69	88	79	73	69	78	72	68	76	71	68	74	70	67	66			
6	84	75	68	64	83	74	68	63	72	67	63	71	66	62	70	65	62	60			
7	80	70	63	58	78	69	63	58	68	62	58	66	61	58	65	61	57	56			
8	75	65	58	54	74	64	58	54	63	58	54	62	57	53	61	56	53	52			
9	71	61	54	50	70	60	54	50	59	54	50	58	53	49	57	53	49	48			
10	67	57	51	46	66	56	50	46	56	50	46	55	50	46	54	49	46	45			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	60811
5°	60784
10°	60449
15°	59843
20°	58003
25°	55672
30°	51607
35°	40330
40°	27527
45°	15432
50°	6636
55°	3142
60°	766
65°	379
70°	428
75°	457
80°	483
85°	481

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 15432 cd/sqm

TEST NUMBER: P1504429

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-U-A-06-BLAK-PS (6500K_L12_Medium_120V)

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	699.6	7.5
10°-20°	1975.0	21.3
20°-30°	2810.5	30.3
30°-40°	2489.8	26.8
40°-50°	1059.4	11.4
50°-60°	211.0	2.3
60°-70°	24.2	0.3
70°-80°	15.1	0.2
80°-90°	5.8	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5485.2	59.0
0°-40°	7975.0	85.8
0°-60°	9245.4	99.5
0°-90°	9290.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	9290.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	7403	
5°	7372	700
15°	7037	1975
25°	6142	2811
35°	4022	2490
45°	1328	1059
55°	219	211
65°	20	24
75°	14	15
85°	5	6
90°	0	

TEST NUMBER: P1504429

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-U-A-06-BLAK-PS (6500K_L12_Medium_120V)

CANDELA DISTRIBUTION (FULL):

0°	
0°	7402.9
2.5°	7380.9
5°	7371.5
7.5°	7325.8
10°	7247.0
12.5°	7160.6
15°	7036.9
17.5°	6855.6
20°	6635.3
22.5°	6402.3
25°	6142.3
27.5°	5841.5
30°	5440.8
32.5°	4777.4
35°	4021.7
37.5°	3278.7
40°	2567.0
42.5°	1935.0
45°	1328.4
47.5°	782.8
50°	519.3
52.5°	349.0
55°	219.4
57.5°	107.6
60°	46.6
62.5°	28.0
65°	19.5
67.5°	18.6
70°	17.8
72.5°	16.1
75°	14.4
77.5°	12.7
80°	10.2
82.5°	8.5
85°	5.1
87.5°	2.5
90°	0.0

(END OF REPORT)