

Scaled data based on original data using
LM-79-2024 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P1504565

Luminaire Tested: PRLX-UHBS2-1218-MV-L8C5-U-A-06-WHGL-PS (6500K_L12_Narrow_120V)

Issue Date: 7/31/2026

Test Information

Test Method: LM-79-2024
Report Number: P1504565
TEST IS SCALED FROM IESNA LM-79-24 TEST DATA (G2-2602-677-46)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 7/31/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-UHBS2-1218-MV-L8C5-U-A-06-WHGL-PS (6500K_L12_Narrow_120V)
Description: PrentaLux UHBS2 6-INCH SELECTABLE HIGH BAY 1218 LIGHT ENGINE, DOMIC WHITE
SHADE, NARROW DISTRIBUTION
LIGHT LEVEL 1 - 12,000 LUMENS
Light Source:
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11559.8 lumens
Efficiency: N/A
Efficacy: 139.3 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.98
Luminous Opening: Circular (Dia: 1.29' x H: 0')
CIE Type: Direct

Input Watts (W): 83
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1504565

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-U-A-06-WHGL-PS (6500K_L12_Narrow_120V)

Luminous Intensity Polar Plot

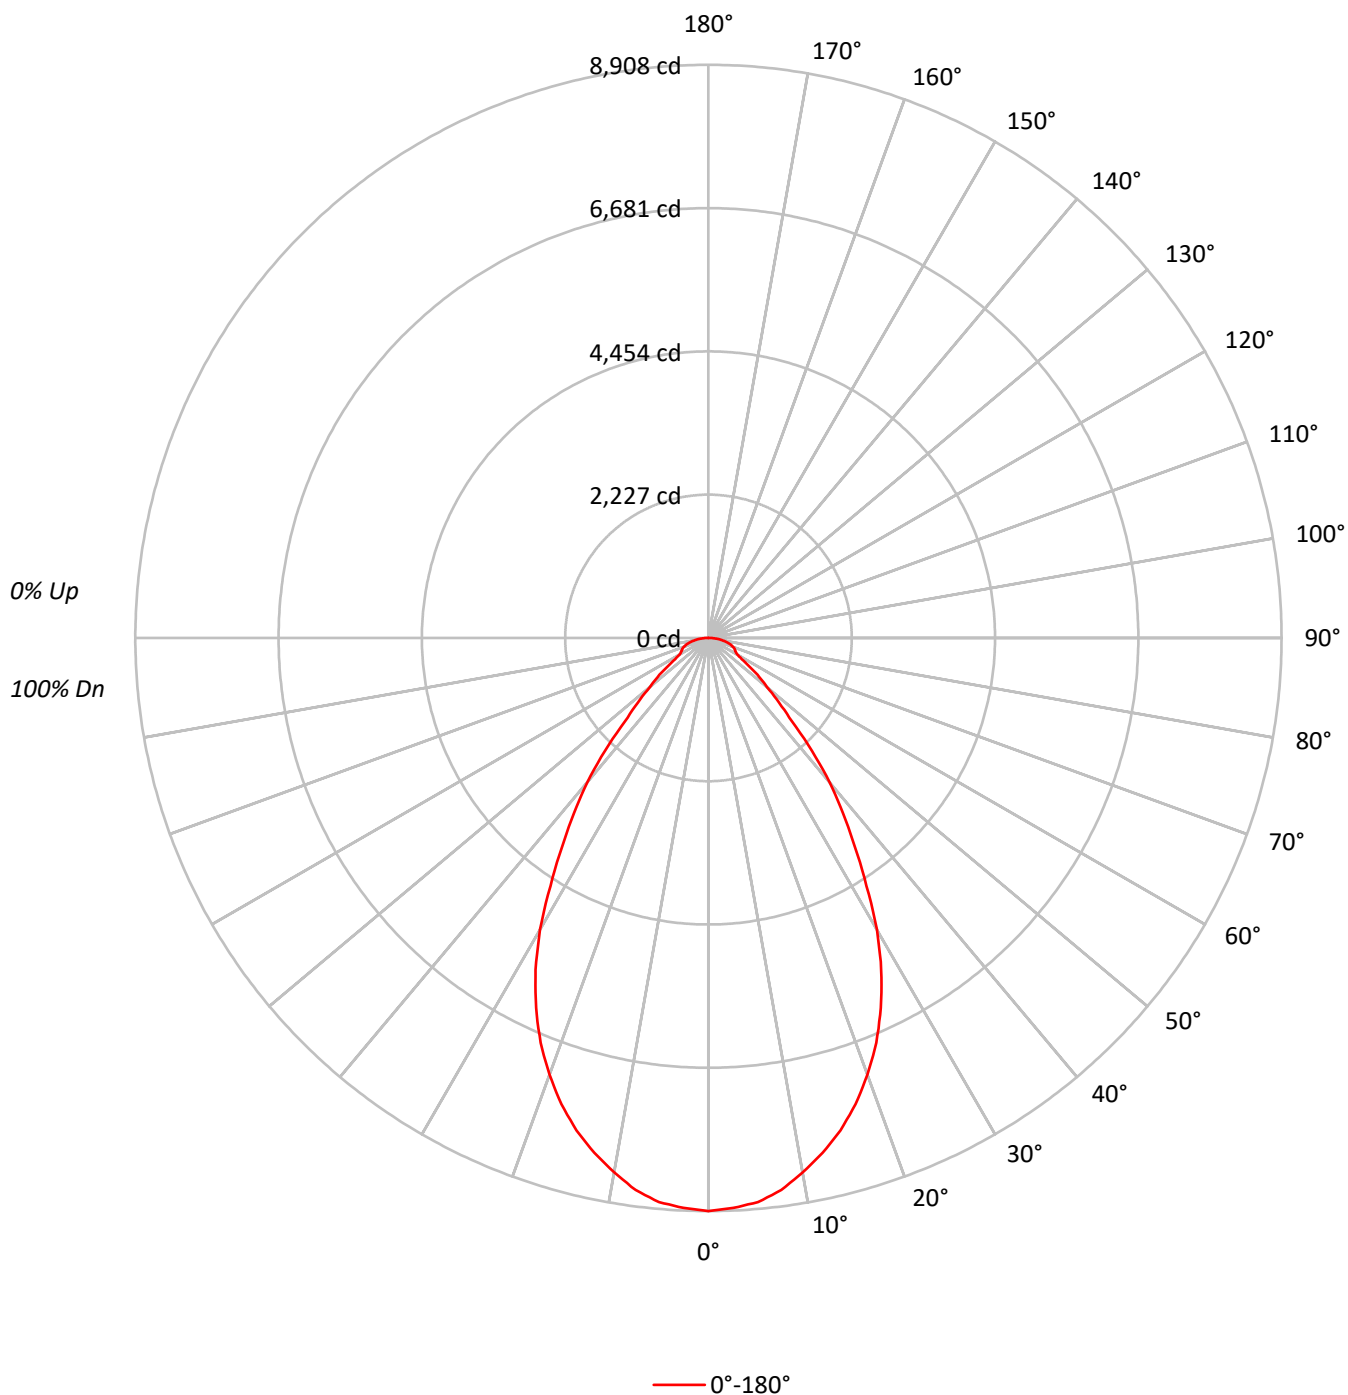



TEST NUMBER: P1504565

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-U-A-06-WHGL-PS (6500K_L12_Narrow_120V)

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10			
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	111	108	105	102	109	106	103	100	102	99	97	98	96	94	94	93	91	89		
2	104	98	93	88	102	96	91	87	93	89	85	90	86	83	87	84	82	80		
3	97	89	83	78	95	88	82	77	85	80	76	82	78	75	80	77	74	72		
4	91	82	75	70	89	81	74	69	78	73	68	76	71	67	74	70	67	65		
5	85	75	68	63	84	74	68	63	72	66	62	71	65	61	69	64	61	59		
6	80	70	62	57	79	69	62	57	67	61	56	66	60	56	64	59	56	54		
7	76	64	57	52	74	64	57	52	62	56	52	61	56	51	60	55	51	50		
8	71	60	53	48	70	59	53	48	58	52	48	57	52	48	56	51	47	46		
9	67	56	49	44	66	56	49	44	54	48	44	54	48	44	53	48	44	42		
10	64	53	46	41	63	52	46	41	51	45	41	50	45	41	49	44	41	39		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	73178
5°	72570
10°	70342
15°	67380
20°	63158
25°	57484
30°	49638
35°	39777
40°	31433
45°	21288
50°	15168
55°	11272
60°	8546
65°	8892
70°	9809
75°	10407
80°	10700
85°	11018

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 21288 cd/sqm

TEST NUMBER: P1504565

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-U-A-06-WHGL-PS (6500K_L12_Narrow_120V)

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	828.3	7.2
10°-20°	2218.3	19.2
20°-30°	2889.2	25.0
30°-40°	2493.8	21.6
40°-50°	1483.8	12.8
50°-60°	722.7	6.3
60°-70°	456.2	3.9
70°-80°	342.0	3.0
80°-90°	125.5	1.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5935.8	51.3
0°-40°	8429.6	72.9
0°-60°	10636.1	92.0
0°-90°	11559.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	11559.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	8908	
5°	8801	828
15°	7923	2218
25°	6342	2889
35°	3967	2494
45°	1832	1484
55°	787	723
65°	458	456
75°	328	342
85°	117	126
90°	0	

TEST NUMBER: P1504565

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-U-A-06-WHGL-PS (6500K_L12_Narrow_120V)

CANDELA DISTRIBUTION (FULL):

0°	
0°	8908.4
2.5°	8866.9
5°	8800.8
7.5°	8655.9
10°	8433.1
12.5°	8195.9
15°	7923.1
17.5°	7598.6
20°	7225.0
22.5°	6812.4
25°	6342.2
27.5°	5816.9
30°	5233.2
32.5°	4571.5
35°	3966.6
37.5°	3437.1
40°	2931.3
42.5°	2379.8
45°	1832.5
47.5°	1488.5
50°	1186.9
52.5°	996.3
55°	787.1
57.5°	612.5
60°	520.2
62.5°	482.1
65°	457.5
67.5°	437.2
70°	408.4
72.5°	371.9
75°	327.9
77.5°	278.7
80°	226.2
82.5°	172.8
85°	116.9
87.5°	58.5
90°	0.0

(END OF REPORT)