

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P1221342

Luminaire Tested: PRLX-UHBS2-1218-MV-L8C5-WHTE-08 (6500K_L16_Wide_120V)

Issue Date: 1/21/2026

Test Information

Test Method: LM-79-2019
Report Number: P1221342
TEST IS SCALED FROM IESNA LM-79-24 TEST DATA (G2-2510-574-2)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/21/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-UHBS2-1218-MV-L8C5-WHTE-08 (6500K_L16_Wide_120V)
Description: PrentaLux UHBS2 SELECTABLE HIGH BAY. 1218 LIGHT ENGINE, WHITE SHADE, WIDE DISTRIBUTION.
LIGHT LEVEL 2 - 16,000 LUMENS
Light Source: 6500K CCT, 80 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14632.2 lumens
Efficiency: N/A
Efficacy: 143.6 lumens/watt
Spacing Criteria (0/90/45): 1.22 / 1.22 / 1.12
Luminous Opening: Vertical Cylinder (Dia: 1.58' x H: 0.67')
CIE Type: Direct

Input Watts (W): 101.9
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1221342

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-WHTE-08 (6500K_L16_Wide_120V)

Luminous Intensity Polar Plot

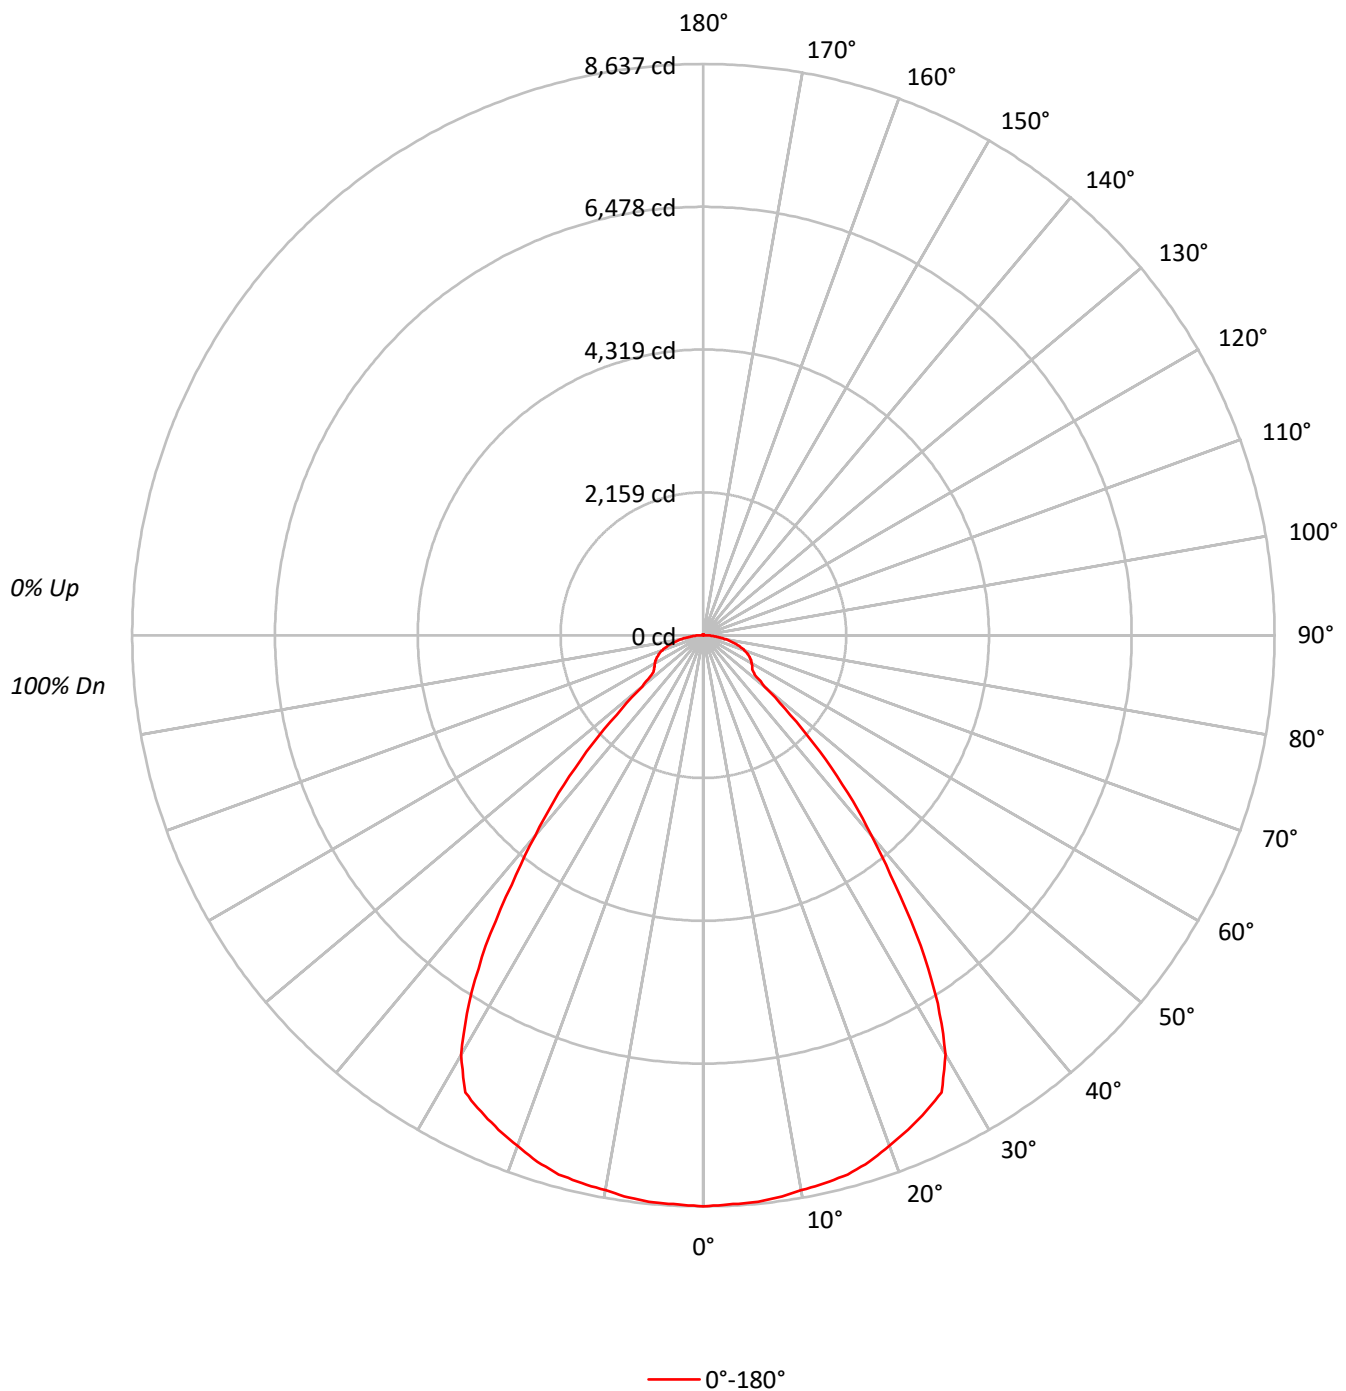

TEST NUMBER: P1221342

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-WHTE-08 (6500K_L16_Wide_120V)

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102
1	111	107	104	101	108	105	102	99	101	98	96	97	95	93	93	92	90
2	103	97	91	87	101	95	90	86	92	87	84	88	85	82	85	83	80
3	96	88	81	76	94	86	80	75	83	78	74	81	76	73	78	75	72
4	90	80	73	67	88	79	72	67	76	71	66	74	69	65	72	68	64
5	84	73	66	60	82	72	65	60	70	64	60	68	63	59	67	62	58
6	79	67	60	55	77	67	60	54	65	59	54	63	58	54	62	57	53
7	74	62	55	50	72	62	54	49	60	54	49	59	53	49	58	52	49
8	69	58	50	45	68	57	50	45	56	50	45	55	49	45	54	48	45
9	65	54	47	42	64	53	46	42	52	46	41	51	45	41	50	45	41
10	62	50	43	39	61	50	43	38	49	43	38	48	42	38	47	42	38

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	47215
5°	45144
10°	43226
15°	41777
20°	40016
25°	38375
30°	35310
35°	27833
40°	19484
45°	12560
50°	6249
55°	4889
60°	4789
65°	4624
70°	4252
75°	3559
80°	2563
85°	1349

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 12560 cd/sqm

TEST NUMBER: P1221342

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-WHTE-08 (6500K_L16_Wide_120V)

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	819.1	5.6
10°-20°	2380.2	16.3
20°-30°	3647.9	24.9
30°-40°	3528.0	24.1
40°-50°	1924.2	13.2
50°-60°	845.9	5.8
60°-70°	755.6	5.2
70°-80°	529.0	3.6
80°-90°	171.5	1.2
90°-100°	2.2	0.0
100°-110°	2.1	0.0
110°-120°	2.6	0.0
120°-130°	3.4	0.0
130°-140°	4.8	0.0
140°-150°	6.5	0.0
150°-160°	5.1	0.0
160°-170°	2.9	0.0
170°-180°	1.1	0.0
0°-30°	6847.2	46.8
0°-40°	10375.3	70.9
0°-60°	13145.3	89.8
0°-90°	14601.5	99.8
90°-120°	6.9	0.0
90°-150°	21.6	0.1
90°-180°	31.0	0.2
0°-180°	14632.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	8637	
5°	8612	819
15°	8442	2380
25°	7952	3648
35°	5736	3528
45°	2496	1924
55°	906	846
65°	768	756
75°	506	529
85°	153	162
90°	2	11
95°	2	2
105°	2	2
115°	3	3
125°	4	3
135°	6	5
145°	10	6
155°	10	5
165°	10	3
175°	11	1
180°	11	

TEST NUMBER: P1221342

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-WHTE-08 (6500K_L16_Wide_120V)

CANDELA DISTRIBUTION (FULL):

0°	
0°	8636.7
2.5°	8616.4
5°	8612.3
7.5°	8577.8
10°	8523.0
12.5°	8487.4
15°	8441.8
17.5°	8346.3
20°	8220.4
22.5°	8092.5
25°	7952.4
27.5°	7797.1
30°	7325.0
32.5°	6598.1
35°	5736.1
37.5°	4760.5
40°	3958.4
42.5°	3234.6
45°	2495.5
47.5°	1780.7
50°	1204.1
52.5°	976.7
55°	905.6
57.5°	876.2
60°	844.7
62.5°	812.2
65°	768.5
67.5°	717.8
70°	657.9
72.5°	587.8
75°	505.6
77.5°	418.3
80°	328.9
82.5°	240.6
85°	153.3
87.5°	71.1
90°	2.0
92.5°	2.0
95°	2.0
97.5°	2.0
100°	2.0
102.5°	2.0
105°	2.0
107.5°	2.0
110°	2.0

TEST NUMBER: P1221342

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-WHTE-08 (6500K_L16_Wide_120V)

CANDELA DISTRIBUTION (continued):

	0°
112.5°	2.0
115°	3.0
117.5°	3.0
120°	3.0
122.5°	3.0
125°	4.1
127.5°	4.1
130°	5.1
132.5°	5.1
135°	6.1
137.5°	7.1
140°	8.1
142.5°	9.1
145°	10.2
147.5°	12.2
150°	12.2
152.5°	12.2
155°	10.2
157.5°	10.2
160°	10.2
162.5°	10.2
165°	10.2
167.5°	10.2
170°	11.2
172.5°	11.2
175°	11.2
177.5°	11.2
180°	11.2

TEST NUMBER: P1221342

CATALOG NUMBER: PRLX-UHBS2-1218-MV-L8C5-WHTE-08 (6500K_L16_Wide_120V)

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.16	15.46	14.53	15.78	16.10	14.16	15.46	14.53	15.78	16.10
	3H	16.33	17.49	16.72	17.82	18.19	16.33	17.49	16.72	17.82	18.19
	4H	17.11	18.19	17.51	18.54	18.93	17.11	18.19	17.51	18.54	18.93
	6H	17.61	18.60	18.03	18.98	19.38	17.61	18.60	18.03	18.98	19.38
	8H	17.74	18.68	18.17	19.08	19.49	17.74	18.68	18.17	19.08	19.49
	12H	17.80	18.70	18.23	19.09	19.52	17.80	18.70	18.23	19.09	19.52
4H	2H	14.81	15.89	15.21	16.24	16.63	14.81	15.89	15.21	16.24	16.63
	3H	17.13	18.03	17.55	18.44	18.85	17.13	18.03	17.55	18.44	18.85
	4H	18.01	18.81	18.44	19.23	19.68	18.01	18.81	18.44	19.23	19.68
	6H	18.61	19.30	19.07	19.75	20.22	18.61	19.30	19.07	19.75	20.22
	8H	18.77	19.42	19.24	19.87	20.34	18.77	19.42	19.24	19.87	20.34
	12H	18.85	19.43	19.34	19.92	20.39	18.85	19.43	19.34	19.92	20.39
8H	4H	18.25	18.91	18.72	19.36	19.83	18.25	18.91	18.72	19.36	19.83
	6H	18.95	19.48	19.45	19.98	20.46	18.95	19.48	19.45	19.98	20.46
	8H	19.16	19.64	19.68	20.16	20.65	19.16	19.64	19.68	20.16	20.65
	12H	19.30	19.72	19.82	20.22	20.79	19.30	19.72	19.82	20.22	20.79
12H	4H	18.26	18.83	18.75	19.32	19.80	18.26	18.83	18.75	19.32	19.80
	6H	18.96	19.44	19.49	19.96	20.46	18.96	19.44	19.49	19.96	20.46
	8H	19.22	19.64	19.74	20.14	20.72	19.22	19.64	19.74	20.14	20.72

END OF REPORT