

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P1221347

Luminaire Tested: PRLX-UHBS2-2436-MV-L8C5-BLAK-08 (3000K_L24_Narrow_120V)

Issue Date: 1/21/2026

Test Information

Test Method: LM-79-2019
Report Number: P1221347
TEST IS SCALED FROM IESNA LM-79-24 TEST DATA (G2-2510-574-22)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/21/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-UHBS2-2436-MV-L8C5-BLAK-08 (3000K_L24_Narrow_120V)
Description: PrentaLux UHBS2 SELECTABLE HIGH BAY. 2436 LIGHT ENGINE, BLACK SHADE, NARROW DISTRIBUTION.
LIGHT LEVEL 1 - 24,000 LUMENS
Light Source: 3000K CCT, 80 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16436.4 lumens
Efficiency: N/A
Efficacy: 106.3 lumens/watt
Spacing Criteria (0/90/45): 1.02 / 1.02 / 0.98
Luminous Opening: Vertical Cylinder (Dia: 1.54' x H: 0.71')
CIE Type: Direct

Input Watts (W): 154.6
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1221347

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-BLAK-08 (3000K_L24_Narrow_120V)

Luminous Intensity Polar Plot

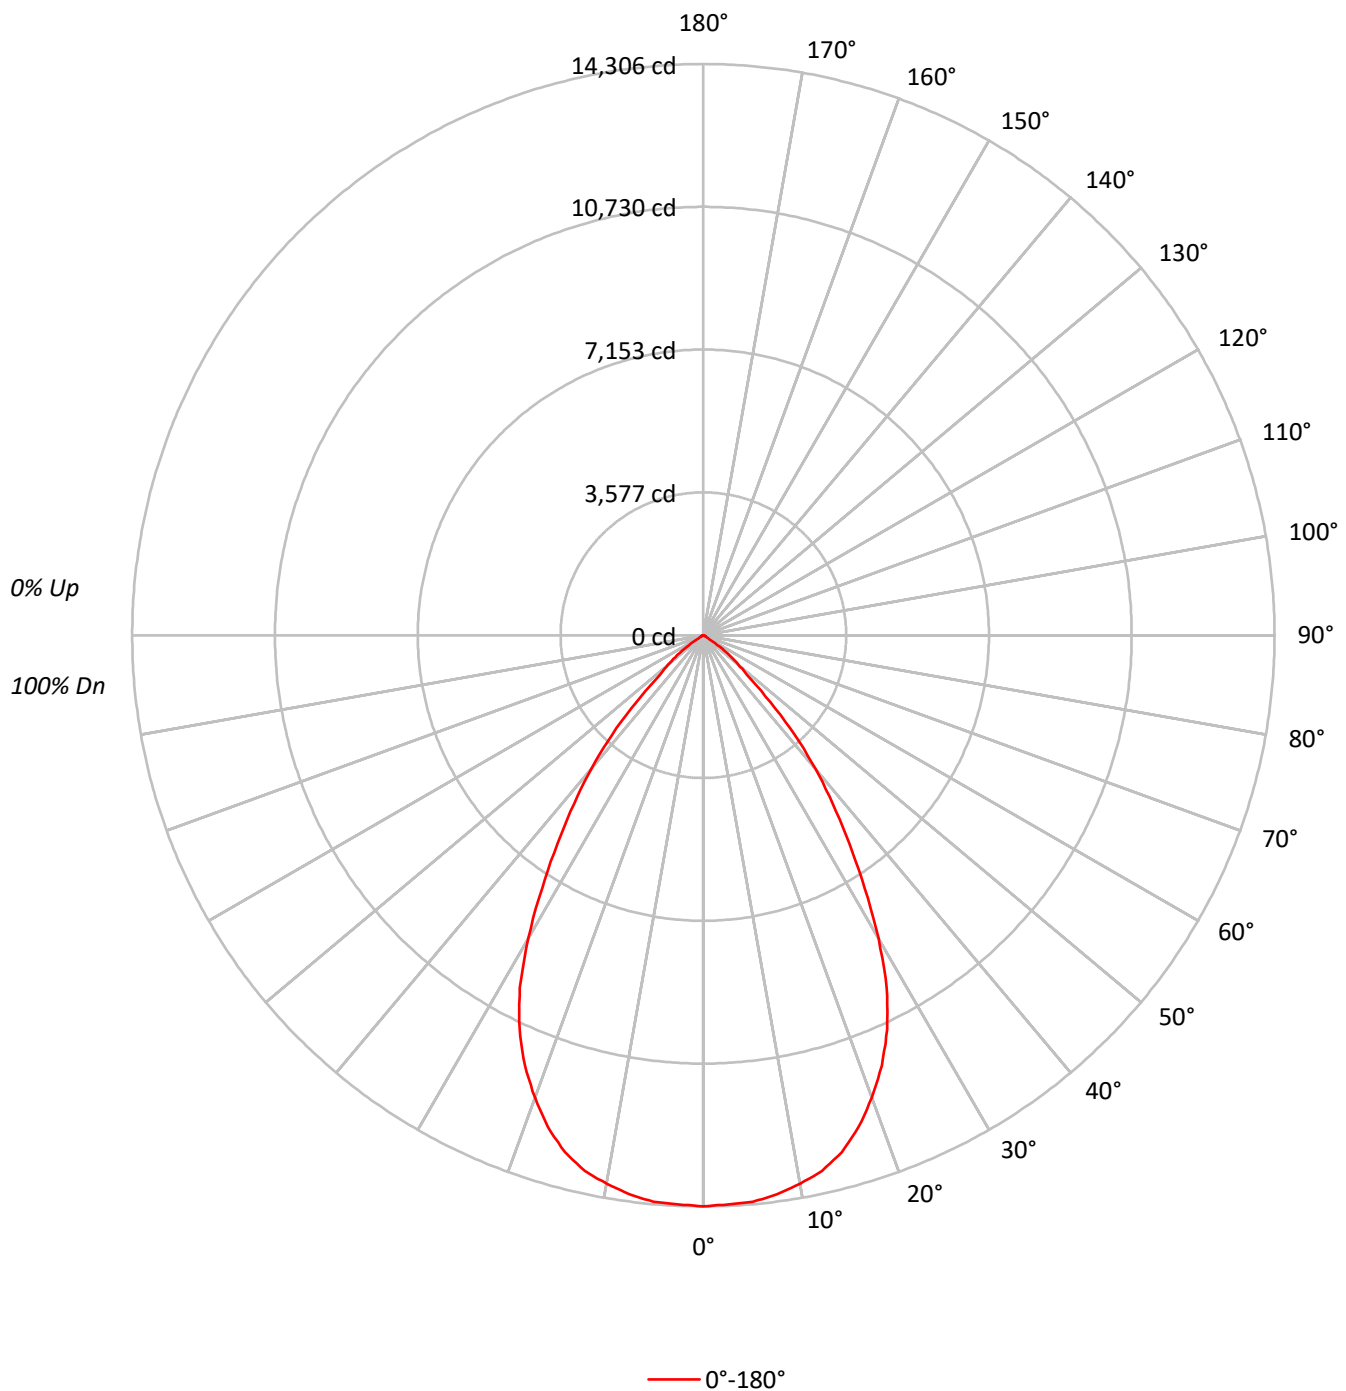

TEST NUMBER: P1221347

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-BLAK-08 (3000K_L24_Narrow_120V)

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102
1	113	110	107	105	111	108	106	103	104	102	100	100	99	97	97	96	94
2	107	102	97	94	105	100	96	93	97	93	91	94	91	89	91	89	87
3	101	94	89	84	99	93	88	84	90	86	82	88	84	81	85	82	80
4	95	87	81	77	93	86	80	76	84	79	75	82	78	74	80	76	73
5	90	81	75	70	88	80	74	70	78	73	69	76	72	68	75	71	68
6	85	75	69	64	83	74	68	64	73	68	64	71	67	63	70	66	63
7	80	70	64	59	79	70	63	59	68	63	59	67	62	58	66	61	58
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54
9	72	62	55	51	71	61	55	51	60	54	51	59	54	50	58	54	50
10	68	58	52	47	67	57	51	47	56	51	47	56	51	47	55	50	47

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	82495
5°	78431
10°	74054
15°	69168
20°	62395
25°	54469
30°	43658
35°	31797
40°	21962
45°	12196
50°	6074
55°	2306
60°	383
65°	186
70°	175
75°	153
80°	122
85°	71

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 12196 cd/sqm

TEST NUMBER: P1221347

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-BLAK-08 (3000K_L24_Narrow_120V)

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1349.9	8.2
10°-20°	3747.0	22.8
20°-30°	4937.0	30.0
30°-40°	3993.8	24.3
40°-50°	1897.4	11.5
50°-60°	444.3	2.7
60°-70°	35.5	0.2
70°-80°	22.7	0.1
80°-90°	8.9	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	10033.9	61.0
0°-40°	14027.7	85.3
0°-60°	16369.4	99.6
0°-90°	16436.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	16436.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	14306	
5°	14243	###
15°	13403	3747
25°	10896	4937
35°	6367	3994
45°	2370	1897
55°	421	444
65°	31	35
75°	22	23
85°	8	9
90°	0	

TEST NUMBER: P1221347

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-BLAK-08 (3000K_L24_Narrow_120V)

CANDELA DISTRIBUTION (FULL):

	0°
0°	14306.3
2.5°	14265.7
5°	14243.2
7.5°	14129.1
10°	13952.0
12.5°	13736.6
15°	13402.6
17.5°	12922.9
20°	12333.0
22.5°	11673.2
25°	10896.3
27.5°	9953.6
30°	8771.4
32.5°	7524.7
35°	6367.3
37.5°	5321.7
40°	4349.7
42.5°	3394.9
45°	2370.4
47.5°	1474.2
50°	1149.2
52.5°	822.6
55°	421.1
57.5°	174.1
60°	66.8
62.5°	37.5
65°	30.8
67.5°	28.5
70°	27.0
72.5°	24.0
75°	21.8
77.5°	18.8
80°	15.8
82.5°	12.0
85°	8.3
87.5°	4.5
90°	0.0

TEST NUMBER: P1221347

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-BLAK-08 (3000K_L24_Narrow_120V)

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	2.53	3.61	2.89	3.92	4.23	2.53	3.61	2.89	3.92	4.23
	3H	2.50	3.44	2.88	3.77	4.14	2.50	3.44	2.88	3.77	4.14
	4H	2.49	3.36	2.90	3.71	4.10	2.49	3.36	2.90	3.71	4.10
	6H	2.47	3.27	2.89	3.64	4.04	2.47	3.27	2.89	3.64	4.04
	8H	2.45	3.20	2.89	3.59	4.00	2.45	3.20	2.89	3.59	4.00
	12H	2.42	3.13	2.85	3.51	3.95	2.42	3.13	2.85	3.51	3.95
4H	2H	2.30	3.17	2.71	3.53	3.91	2.30	3.17	2.71	3.53	3.91
	3H	2.32	3.02	2.73	3.43	3.83	2.32	3.02	2.73	3.43	3.83
	4H	2.34	2.96	2.77	3.38	3.83	2.34	2.96	2.77	3.38	3.83
	6H	2.37	2.90	2.84	3.35	3.82	2.37	2.90	2.84	3.35	3.82
	8H	2.35	2.85	2.82	3.30	3.77	2.35	2.85	2.82	3.30	3.77
	12H	2.32	2.76	2.82	3.25	3.72	2.32	2.76	2.82	3.25	3.72
8H	4H	2.23	2.72	2.70	3.17	3.65	2.23	2.72	2.70	3.17	3.65
	6H	2.28	2.68	2.79	3.18	3.67	2.28	2.68	2.79	3.18	3.67
	8H	2.28	2.64	2.81	3.16	3.66	2.28	2.64	2.81	3.16	3.66
	12H	2.28	2.60	2.80	3.10	3.67	2.28	2.60	2.80	3.10	3.67
12H	4H	2.17	2.61	2.67	3.10	3.57	2.17	2.61	2.67	3.10	3.57
	6H	2.23	2.58	2.76	3.11	3.60	2.23	2.58	2.76	3.11	3.60
	8H	2.25	2.57	2.78	3.07	3.65	2.25	2.57	2.78	3.07	3.65

END OF REPORT