

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P1221348

Luminaire Tested: PRLX-UHBS2-2436-MV-L8C5-BLAK-08 (3000K_L24_Wide_120V)

Issue Date: 1/21/2026

Test Information

Test Method: LM-79-2019
Report Number: P1221348
TEST IS SCALED FROM IESNA LM-79-24 TEST DATA (G2-2510-574-24)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/21/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-UHBS2-2436-MV-L8C5-BLAK-08 (3000K_L24_Wide_120V)
Description: PrentaLux UHBS2 SELECTABLE HIGH BAY. 2436 LIGHT ENGINE, BLACK SHADE, WIDE DISTRIBUTION.
LIGHT LEVEL 1 - 24,000 LUMENS
Light Source: 3000K CCT, 80 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17100.6 lumens
Efficiency: N/A
Efficacy: 110.6 lumens/watt
Spacing Criteria (0/90/45): 1.26 / 1.26 / 1.19
Luminous Opening: Vertical Cylinder (Dia: 1.54' x H: 0.71')
CIE Type: Direct

Input Watts (W): 154.6
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1221348

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-BLAK-08 (3000K_L24_Wide_120V)

Luminous Intensity Polar Plot

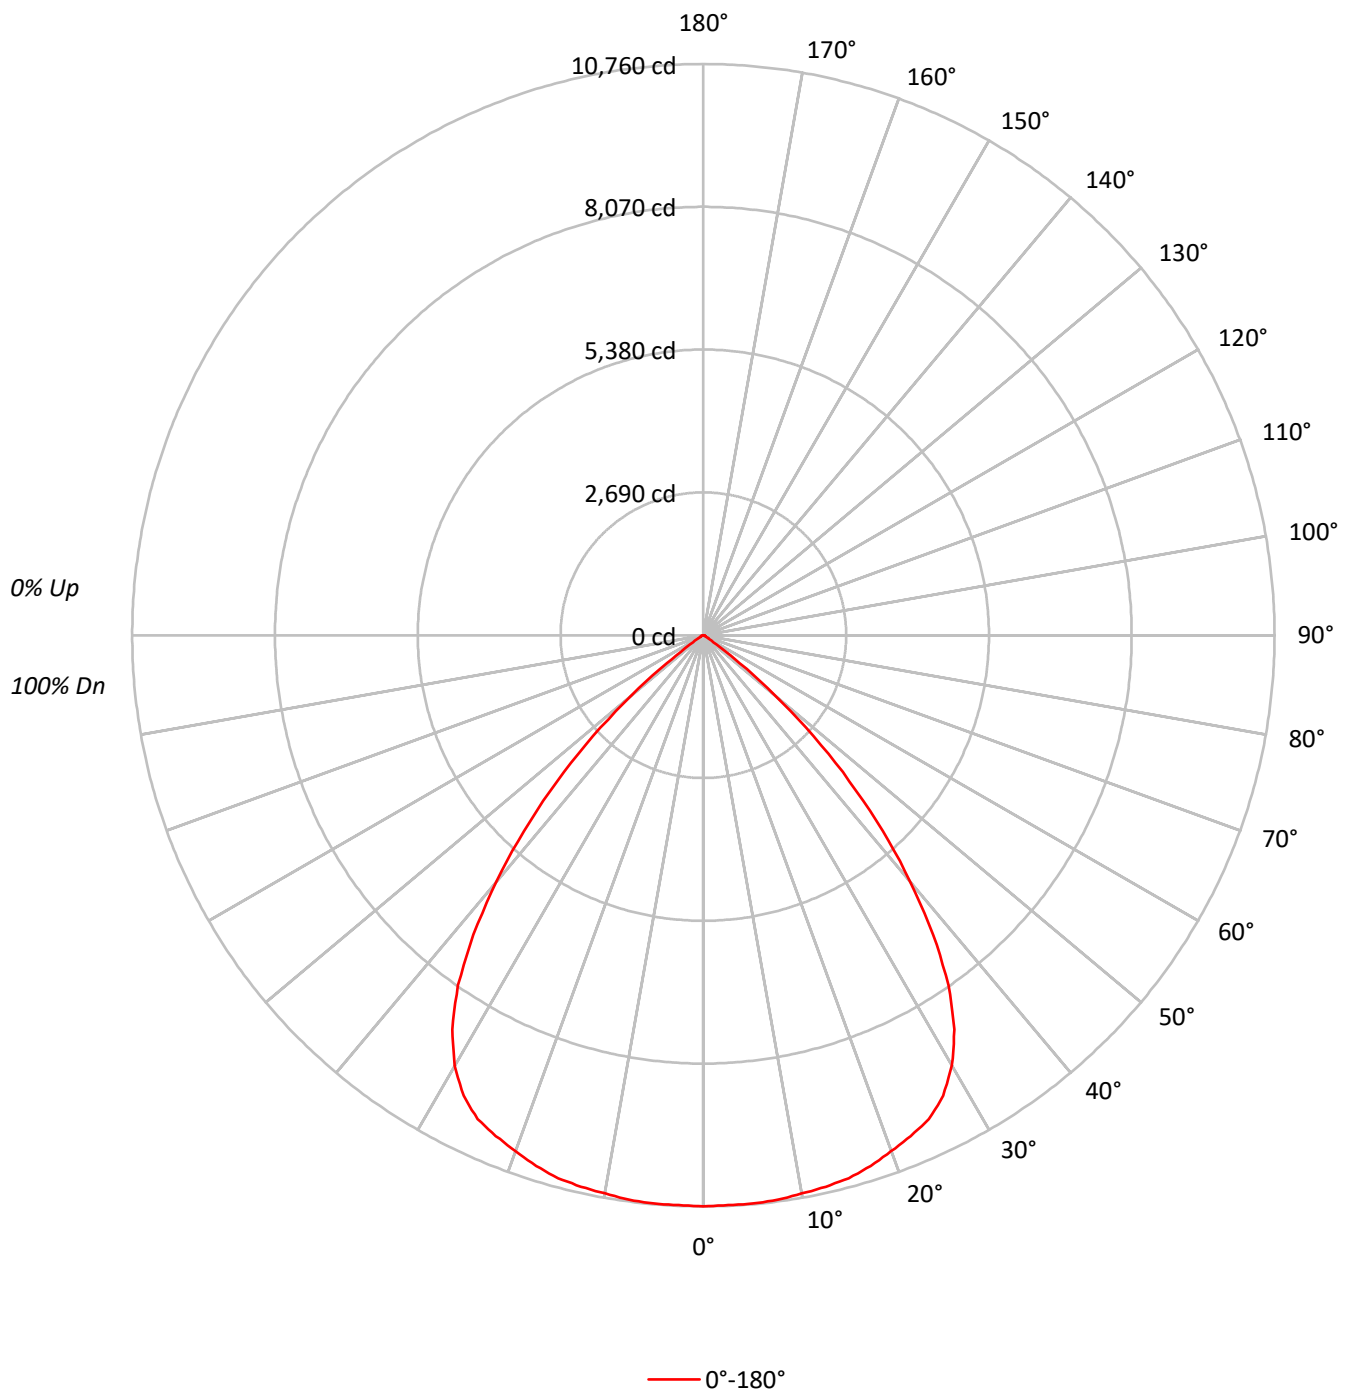

TEST NUMBER: P1221348

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-BLAK-08 (3000K_L24_Wide_120V)

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	113	110	107	104	110	107	105	103	103	101	99	100	98	96	96	95	94	92		
2	106	100	96	92	104	99	95	91	95	92	89	92	90	87	90	87	85	83		
3	100	92	86	82	97	91	85	81	88	84	80	86	82	79	83	80	77	76		
4	93	85	78	73	91	83	78	73	81	76	72	79	75	71	77	73	70	69		
5	88	78	71	66	86	77	71	66	75	70	65	73	68	65	72	67	64	62		
6	82	72	65	60	81	71	65	60	69	64	59	68	63	59	67	62	58	57		
7	77	66	60	55	76	66	59	54	64	58	54	63	58	54	62	57	54	52		
8	73	62	55	50	71	61	54	50	60	54	50	59	53	49	58	53	49	48		
9	68	57	50	46	67	57	50	46	56	50	46	55	49	45	54	49	45	44		
10	64	53	47	42	63	53	47	42	52	46	42	51	46	42	50	45	42	40		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	62044
5°	59187
10°	56684
15°	54641
20°	52343
25°	50278
30°	46598
35°	40227
40°	30606
45°	20035
50°	9280
55°	1677
60°	404
65°	236
70°	223
75°	210
80°	179
85°	110

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 20035 cd/sqm

TEST NUMBER: P1221348

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-BLAK-08 (3000K_L24_Wide_120V)

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1023.8	6.0
10°-20°	2987.5	17.5
20°-30°	4605.2	26.9
30°-40°	4934.7	28.9
40°-50°	2981.0	17.4
50°-60°	480.3	2.8
60°-70°	43.2	0.3
70°-80°	31.2	0.2
80°-90°	13.8	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	8616.5	50.4
0°-40°	13551.2	79.2
0°-60°	17012.4	99.5
0°-90°	17100.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	17100.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	10760	
5°	10748	###
15°	10588	2987
25°	10058	4605
35°	8055	4935
45°	3894	2981
55°	306	480
65°	39	43
75°	30	31
85°	13	14
90°	0	

TEST NUMBER: P1221348

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-BLAK-08 (3000K_L24_Wide_120V)

CANDELA DISTRIBUTION (FULL):

0°	
0°	10759.7
2.5°	10745.5
5°	10748.5
7.5°	10727.5
10°	10679.4
12.5°	10641.1
15°	10587.8
17.5°	10481.3
20°	10346.2
22.5°	10211.0
25°	10057.9
27.5°	9783.2
30°	9362.1
32.5°	8802.2
35°	8055.3
37.5°	7111.1
40°	6061.8
42.5°	5007.2
45°	3894.1
47.5°	2823.0
50°	1755.6
52.5°	863.2
55°	306.2
57.5°	120.8
60°	70.6
62.5°	47.3
65°	39.0
67.5°	36.0
70°	34.5
72.5°	32.3
75°	30.0
77.5°	27.0
80°	23.3
82.5°	18.0
85°	12.8
87.5°	8.3
90°	0.0

TEST NUMBER: P1221348

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-BLAK-08 (3000K_L24_Wide_120V)

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	1.02	0.23	1.33	1.65	0.00	1.02	0.23	1.33	1.65
	3H	0.15	1.16	0.53	1.49	1.86	0.15	1.16	0.53	1.49	1.86
	4H	0.36	1.29	0.76	1.65	2.03	0.36	1.29	0.76	1.65	2.03
	6H	0.57	1.42	0.98	1.79	2.19	0.57	1.42	0.98	1.79	2.19
	8H	0.63	1.43	1.06	1.83	2.23	0.63	1.43	1.06	1.83	2.23
	12H	0.66	1.42	1.09	1.81	2.24	0.66	1.42	1.09	1.81	2.24
4H	2H	0.00	0.69	0.17	1.05	1.43	0.00	0.69	0.17	1.05	1.43
	3H	0.20	0.95	0.62	1.36	1.76	0.20	0.95	0.62	1.36	1.76
	4H	0.52	1.18	0.95	1.61	2.05	0.52	1.18	0.95	1.61	2.05
	6H	0.85	1.42	1.32	1.87	2.35	0.85	1.42	1.32	1.87	2.35
	8H	0.96	1.49	1.43	1.94	2.41	0.96	1.49	1.43	1.94	2.41
	12H	1.02	1.49	1.51	1.97	2.45	1.02	1.49	1.51	1.97	2.45
8H	4H	0.55	1.08	1.02	1.53	2.00	0.55	1.08	1.02	1.53	2.00
	6H	0.97	1.40	1.48	1.91	2.39	0.97	1.40	1.48	1.91	2.39
	8H	1.13	1.52	1.66	2.04	2.54	1.13	1.52	1.66	2.04	2.54
	12H	1.25	1.60	1.77	2.09	2.67	1.25	1.60	1.77	2.09	2.67
12H	4H	0.52	0.99	1.01	1.48	1.95	0.52	0.99	1.01	1.48	1.95
	6H	0.96	1.35	1.49	1.87	2.37	0.96	1.35	1.49	1.87	2.37
	8H	1.16	1.51	1.68	2.00	2.58	1.16	1.51	1.68	2.00	2.58

END OF REPORT