

Scaled data based on original data using  
LM-79-2024 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P1504938

Luminaire Tested: PRLX-UHBS2-2436-MV-L8C5-U-A-04-BLAK-PS (3000K\_L32\_Wide\_120V)

Issue Date: 7/31/2026

**Test Information**

Test Method: LM-79-2024  
Report Number: P1504938  
TEST IS SCALED FROM IESNA LM-79-24 TEST DATA (G2-2602-677-81)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 7/31/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PrentaLux  
Catalog Number: PRLX-UHBS2-2436-MV-L8C5-U-A-04-BLAK-PS (3000K\_L32\_Wide\_120V)  
Description: PrentaLux UHBS2 4-INCH SELECTABLE HIGH BAY 2436 LIGHT ENGINE, DOMIC BLACK SHADE, WIDE DISTRIBUTION  
LIGHT LEVEL 2 - 32,000 LUMENS  
Light Source:  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 26530.2 lumens  
Efficiency: N/A  
Efficacy: 133.1 lumens/watt  
Spacing Criteria (0/90/45): 1.3 / 1.3 / 1.29  
Luminous Opening: Circular (Dia: 1.37' x H: 0')  
CIE Type: Direct

Input Watts (W): 199.4  
Input Voltage (V): 120  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1504938

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-U-A-04-BLAK-PS (3000K\_L32\_Wide\_120V)

### Luminous Intensity Polar Plot

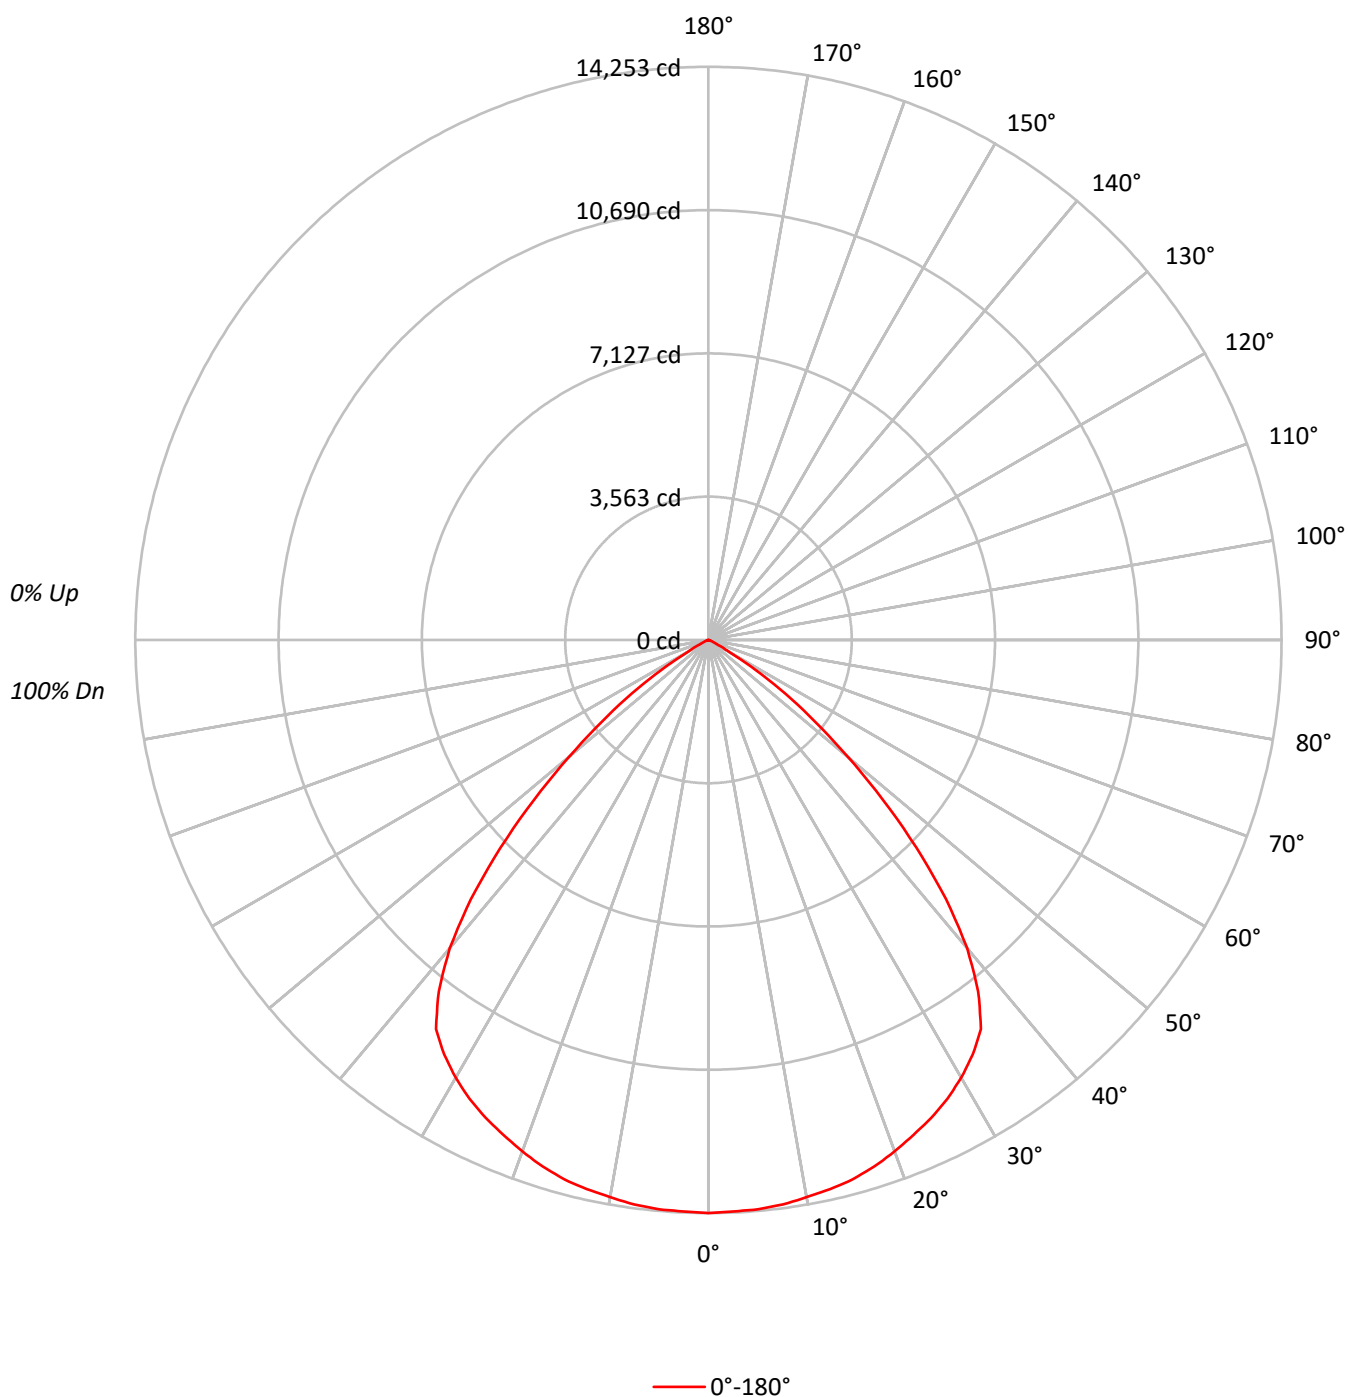

TEST NUMBER: P1504938

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-U-A-04-BLAK-PS (3000K\_L32\_Wide\_120V)

### COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

|     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |  |  |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|--|--|
| RF  | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |  |  |
| RC  | 80  |     |     |     | 70  |     |     |     | 50  |     |     |     | 30  |     |     |     | 10  |     |  |  |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 0   |  |  |
| RCR |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |  |  |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 |  |  |
| 1   | 112 | 109 | 106 | 103 | 110 | 107 | 104 | 102 | 103 | 100 | 99  | 99  | 97  | 96  | 95  | 94  | 93  | 91  |  |  |
| 2   | 105 | 99  | 94  | 90  | 103 | 97  | 93  | 89  | 94  | 90  | 87  | 91  | 88  | 85  | 88  | 86  | 83  | 81  |  |  |
| 3   | 98  | 90  | 84  | 79  | 96  | 89  | 83  | 78  | 86  | 81  | 77  | 83  | 79  | 76  | 81  | 78  | 75  | 73  |  |  |
| 4   | 91  | 82  | 75  | 70  | 89  | 81  | 74  | 69  | 78  | 73  | 69  | 76  | 72  | 68  | 74  | 70  | 67  | 65  |  |  |
| 5   | 85  | 75  | 68  | 62  | 83  | 74  | 67  | 62  | 72  | 66  | 61  | 70  | 65  | 61  | 68  | 64  | 60  | 58  |  |  |
| 6   | 79  | 68  | 61  | 56  | 78  | 68  | 61  | 56  | 66  | 60  | 55  | 64  | 59  | 55  | 63  | 58  | 54  | 53  |  |  |
| 7   | 74  | 63  | 55  | 50  | 73  | 62  | 55  | 50  | 61  | 54  | 50  | 59  | 54  | 50  | 58  | 53  | 49  | 48  |  |  |
| 8   | 70  | 58  | 51  | 46  | 68  | 57  | 50  | 45  | 56  | 50  | 45  | 55  | 49  | 45  | 54  | 49  | 45  | 43  |  |  |
| 9   | 65  | 54  | 46  | 42  | 64  | 53  | 46  | 41  | 52  | 46  | 41  | 51  | 45  | 41  | 50  | 45  | 41  | 39  |  |  |
| 10  | 61  | 50  | 43  | 38  | 60  | 49  | 42  | 38  | 48  | 42  | 38  | 47  | 42  | 38  | 47  | 41  | 38  | 36  |  |  |

**AVERAGE LUMINANCE (cd/sqm):**

|     | 0°     |
|-----|--------|
| 0°  | 104584 |
| 5°  | 104683 |
| 10° | 104821 |
| 15° | 105467 |
| 20° | 105690 |
| 25° | 106159 |
| 30° | 106503 |
| 35° | 105811 |
| 40° | 95838  |
| 45° | 75915  |
| 50° | 51502  |
| 55° | 29900  |
| 60° | 8859   |
| 65° | 2861   |
| 70° | 980    |
| 75° | 593    |
| 80° | 714    |
| 85° | 918    |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle:  $0^\circ$ 

Vertical Angle:  $45^\circ$

Luminance: 75915 cd/sqm

TEST NUMBER: P1504938

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-U-A-04-BLAK-PS (3000K\_L32\_Wide\_120V)

**ZONAL LUMENS:**

| Zone      | Lumens  | % Fixture |
|-----------|---------|-----------|
| 0°-10°    | 1352.0  | 5.1       |
| 10°-20°   | 3918.4  | 14.8      |
| 20°-30°   | 6045.1  | 22.8      |
| 30°-40°   | 7247.2  | 27.3      |
| 40°-50°   | 5593.0  | 21.1      |
| 50°-60°   | 2127.5  | 8.0       |
| 60°-70°   | 209.8   | 0.8       |
| 70°-80°   | 26.1    | 0.1       |
| 80°-90°   | 11.0    | 0.0       |
| 90°-100°  | 0.0     | 0.0       |
| 100°-110° | 0.0     | 0.0       |
| 110°-120° | 0.0     | 0.0       |
| 120°-130° | 0.0     | 0.0       |
| 130°-140° | 0.0     | 0.0       |
| 140°-150° | 0.0     | 0.0       |
| 150°-160° | 0.0     | 0.0       |
| 160°-170° | 0.0     | 0.0       |
| 170°-180° | 0.0     | 0.0       |
| 0°-30°    | 11315.6 | 42.7      |
| 0°-40°    | 18562.9 | 70.0      |
| 0°-60°    | 26283.4 | 99.1      |
| 0°-90°    | 26530.2 | 100.0     |
| 90°-120°  | 0.0     | 0.0       |
| 90°-150°  | 0.0     | 0.0       |
| 90°-180°  | 0.0     | 0.0       |
| 0°-180°   | 26530.2 | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°    | Flux |
|-----|-------|------|
| 0°  | 14253 |      |
| 5°  | 14212 | ###  |
| 15° | 13884 | 3918 |
| 25° | 13112 | 6045 |
| 35° | 11812 | 7247 |
| 45° | 7316  | 5593 |
| 55° | 2337  | 2128 |
| 65° | 165   | 210  |
| 75° | 21    | 26   |
| 85° | 11    | 11   |
| 90° | 0     |      |

TEST NUMBER: P1504938

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-U-A-04-BLAK-PS (3000K\_L32\_Wide\_120V)

**CANDELA DISTRIBUTION (FULL):**

|       | 0°      |
|-------|---------|
| 0°    | 14253.1 |
| 2.5°  | 14224.3 |
| 5°    | 14212.4 |
| 7.5°  | 14159.7 |
| 10°   | 14068.4 |
| 12.5° | 13987.0 |
| 15°   | 13883.7 |
| 17.5° | 13727.8 |
| 20°   | 13535.2 |
| 22.5° | 13321.7 |
| 25°   | 13112.2 |
| 27.5° | 12865.0 |
| 30°   | 12570.1 |
| 32.5° | 12225.6 |
| 35°   | 11812.5 |
| 37.5° | 11015.2 |
| 40°   | 10005.5 |
| 42.5° | 8741.5  |
| 45°   | 7315.7  |
| 47.5° | 5877.0  |
| 50°   | 4511.7  |
| 52.5° | 3345.1  |
| 55°   | 2337.3  |
| 57.5° | 1395.0  |
| 60°   | 603.7   |
| 62.5° | 278.0   |
| 65°   | 164.8   |
| 67.5° | 90.4    |
| 70°   | 45.7    |
| 72.5° | 27.8    |
| 75°   | 20.9    |
| 77.5° | 18.9    |
| 80°   | 16.9    |
| 82.5° | 14.9    |
| 85°   | 10.9    |
| 87.5° | 6.0     |
| 90°   | 0.0     |

(END OF REPORT)