

Scaled data based on original data using
LM-79-2024 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P1505295

Luminaire Tested: PRLX-UHBS2-2436-MV-L8C5-U-B-04-BLAK-PS (3000K_L24_Wide_120V)

Issue Date: 7/31/2026

Test Information

Test Method: LM-79-2024
Report Number: P1505295
TEST IS SCALED FROM IESNA LM-79-24 TEST DATA (G2-2602-677-93)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 7/31/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-UHBS2-2436-MV-L8C5-U-B-04-BLAK-PS (3000K_L24_Wide_120V)
Description: PrentaLux UHBS2 4-INCH SELECTABLE HIGH BAY 2436 LIGHT ENGINE, CONIC BLACK SHADE, WIDE DISTRIBUTION
LIGHT LEVEL 1 - 24,000 LUMENS
Light Source:
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 22264.6 lumens
Efficiency: N/A
Efficacy: 139.7 lumens/watt
Spacing Criteria (0/90/45): 1.31 / 1.31 / 1.3
Luminous Opening: Circular (Dia: 1.38' x H: 0')
CIE Type: Direct

Input Watts (W): 159.4
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1505295

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-U-B-04-BLAK-PS (3000K_L24_Wide_120V)

Luminous Intensity Polar Plot

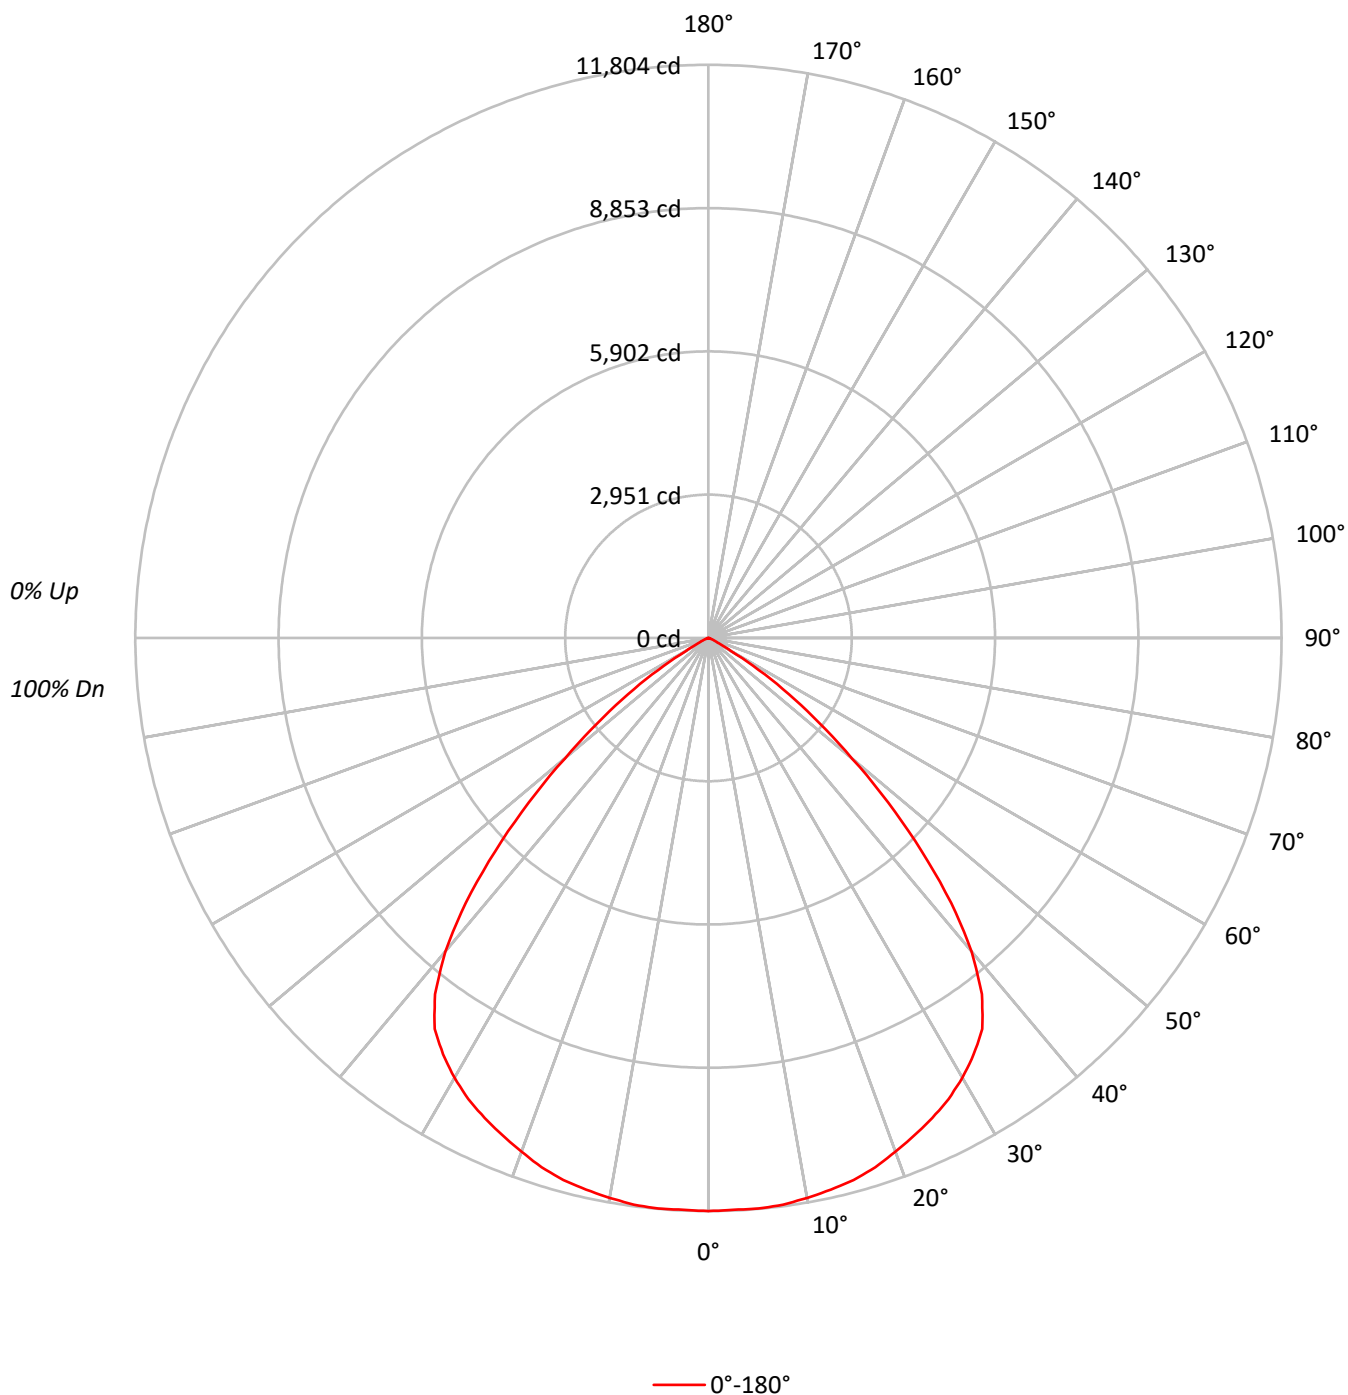



TEST NUMBER: P1505295

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-U-B-04-BLAK-PS (3000K_L24_Wide_120V)

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10			
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	112	109	106	103	110	107	104	102	103	100	98	99	97	96	95	94	93	91		
2	105	99	94	90	103	97	93	89	94	90	87	91	88	85	88	85	83	81		
3	98	90	84	79	96	88	83	78	86	81	77	83	79	76	81	77	74	73		
4	91	82	75	70	89	81	74	69	78	73	68	76	71	68	74	70	67	65		
5	85	75	67	62	83	74	67	62	72	66	61	70	65	61	68	64	60	58		
6	79	68	61	56	78	67	60	55	66	60	55	64	59	55	63	58	54	52		
7	74	63	55	50	73	62	55	50	61	54	50	59	54	49	58	53	49	47		
8	69	58	50	45	68	57	50	45	56	50	45	55	49	45	54	48	45	43		
9	65	53	46	41	64	53	46	41	52	45	41	51	45	41	50	45	41	39		
10	61	49	42	38	60	49	42	38	48	42	38	47	42	37	46	41	37	36		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	84540
5°	84809
10°	85148
15°	85681
20°	85797
25°	86199
30°	86497
35°	85979
40°	78874
45°	62937
50°	43028
55°	25227
60°	7657
65°	2418
70°	829
75°	504
80°	615
85°	748

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 62937 cd/sqm

TEST NUMBER: P1505295

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-U-B-04-BLAK-PS (3000K_L24_Wide_120V)

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1123.3	5.0
10°-20°	3261.1	14.6
20°-30°	5030.0	22.6
30°-40°	6053.8	27.2
40°-50°	4748.3	21.3
50°-60°	1834.9	8.2
60°-70°	181.0	0.8
70°-80°	23.1	0.1
80°-90°	9.2	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	9414.4	42.3
0°-40°	15468.1	69.5
0°-60°	22051.3	99.0
0°-90°	22264.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	22264.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	11804	
5°	11797	###
15°	11556	3261
25°	10908	5030
35°	9834	6054
45°	6214	4748
55°	2020	1835
65°	143	181
75°	18	23
85°	9	9
90°	0	

TEST NUMBER: P1505295

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-U-B-04-BLAK-PS (3000K_L24_Wide_120V)

CANDELA DISTRIBUTION (FULL):

	0°
0°	11804.1
2.5°	11787.6
5°	11796.7
7.5°	11772.0
10°	11708.4
12.5°	11637.5
15°	11555.8
17.5°	11430.4
20°	11257.2
22.5°	11086.4
25°	10908.2
27.5°	10706.9
30°	10459.4
32.5°	10169.0
35°	9834.0
37.5°	9247.5
40°	8436.5
42.5°	7397.8
45°	6213.9
47.5°	5017.7
50°	3861.8
52.5°	2863.6
55°	2020.4
57.5°	1225.1
60°	534.6
62.5°	232.7
65°	142.7
67.5°	77.6
70°	39.6
72.5°	25.6
75°	18.2
77.5°	16.5
80°	14.9
82.5°	12.4
85°	9.1
87.5°	5.0
90°	0.0

(END OF REPORT)