

Scaled data based on original data using
LM-79-2024 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P1505311

Luminaire Tested: PRLX-UHBS2-2436-MV-L8C5-U-B-04-BLAK-PS (4000K_L24_Medium_120V)

Issue Date: 7/31/2026

Test Information

Test Method: LM-79-2024
Report Number: P1505311
TEST IS SCALED FROM IESNA LM-79-24 TEST DATA (G2-2602-677-92)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 7/31/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PrentaLux
Catalog Number: PRLX-UHBS2-2436-MV-L8C5-U-B-04-BLAK-PS (4000K_L24_Medium_120V)
Description: PrentaLux UHBS2 4-INCH SELECTABLE HIGH BAY 2436 LIGHT ENGINE, CONIC BLACK SHADE, MEDIUM DISTRIBUTION
LIGHT LEVEL 1 - 24,000 LUMENS
Light Source:
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 22815.6 lumens
Efficiency: N/A
Efficacy: 146.5 lumens/watt
Spacing Criteria (0/90/45): 1.18 / 1.18 / 1.15
Luminous Opening: Circular (Dia: 1.38' x H: 0')
CIE Type: Direct

Input Watts (W): 155.7
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1505311

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-U-B-04-BLAK-PS (4000K_L24_Medium_120V)

Luminous Intensity Polar Plot

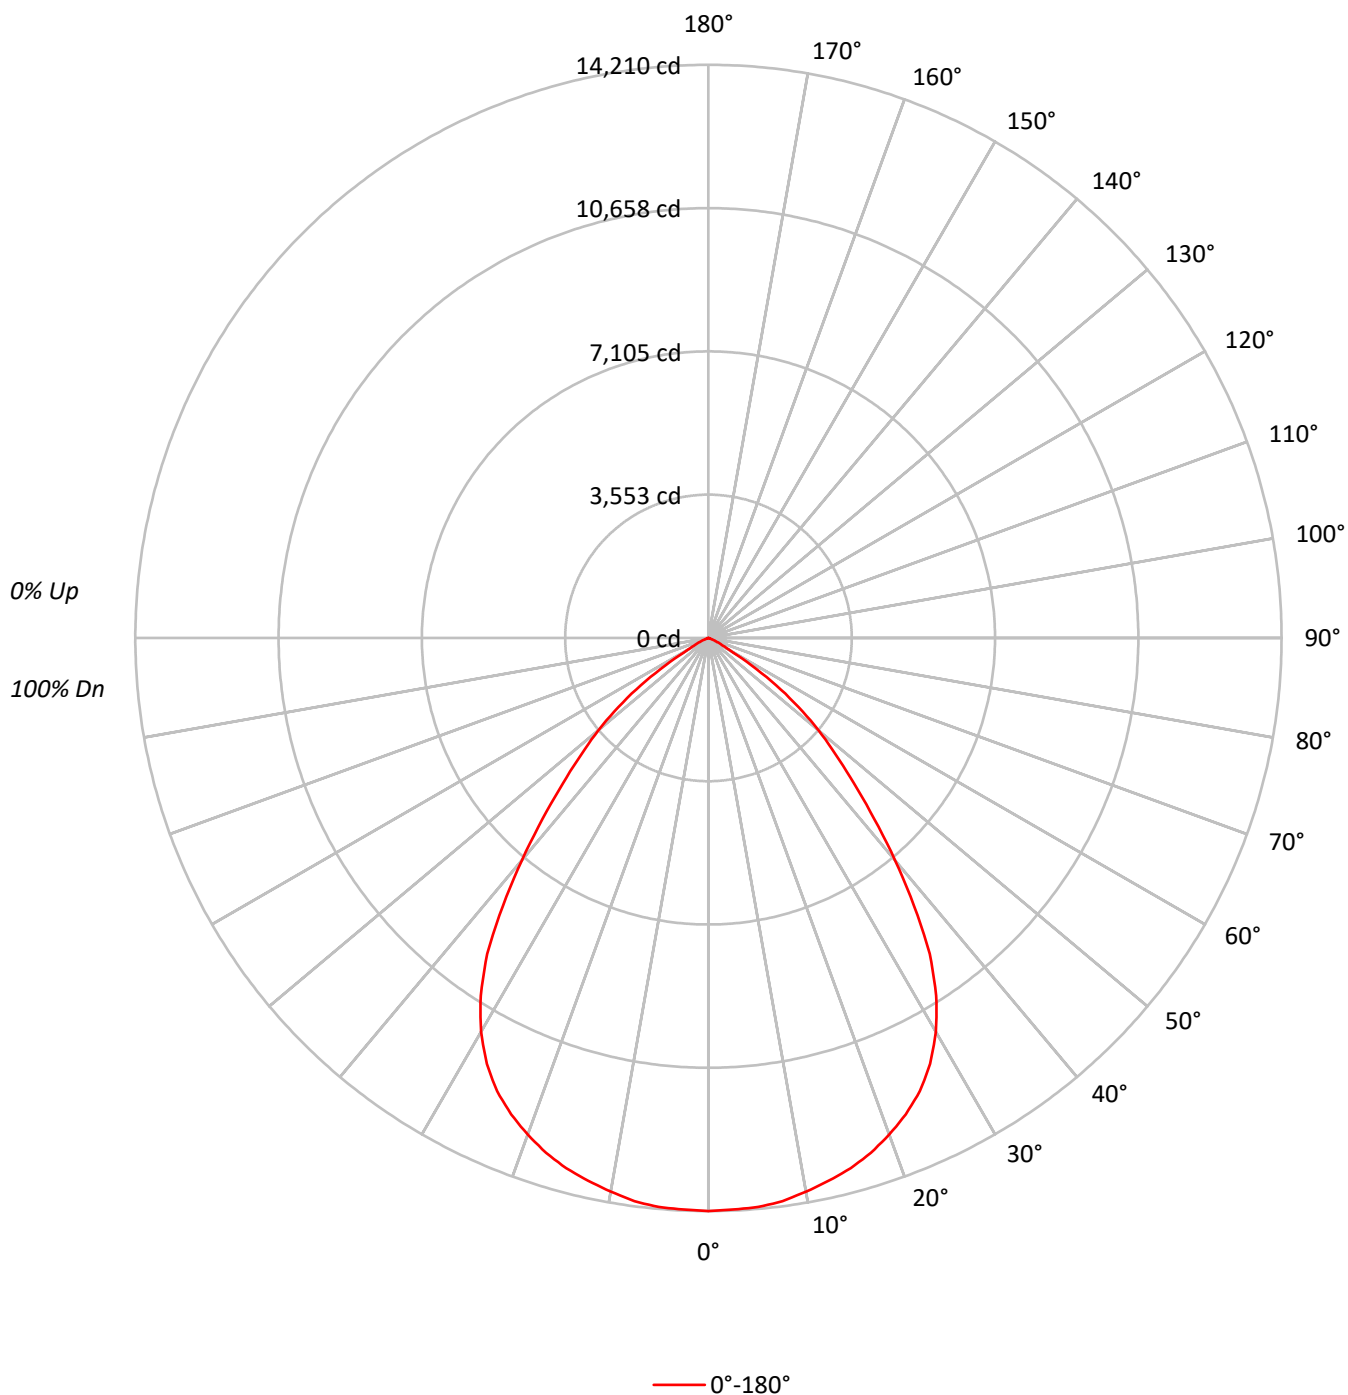

TEST NUMBER: P1505311

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-U-B-04-BLAK-PS (4000K_L24_Medium_120V)

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10			
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	112	109	106	104	110	107	104	102	103	101	99	99	97	96	96	94	93	91		
2	105	100	95	91	103	98	93	90	94	91	88	91	88	86	89	86	84	82		
3	99	91	85	80	96	89	84	79	87	82	78	84	80	77	82	78	76	74		
4	92	83	76	71	90	82	76	71	80	74	70	77	73	69	75	71	68	66		
5	86	76	69	64	84	75	68	64	73	67	63	71	66	62	70	65	62	60		
6	81	70	63	58	79	69	62	57	67	61	57	66	61	56	64	60	56	54		
7	76	64	57	52	74	64	57	52	62	56	52	61	56	51	60	55	51	49		
8	71	60	53	48	70	59	52	48	58	52	47	57	51	47	56	51	47	45		
9	67	55	48	44	65	55	48	44	54	48	43	53	47	43	52	47	43	41		
10	63	52	45	40	62	51	45	40	50	44	40	49	44	40	49	43	40	38		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	101772
5°	101814
10°	101378
15°	100938
20°	99869
25°	97970
30°	93247
35°	83609
40°	67170
45°	51633
50°	39594
55°	25583
60°	8276
65°	4006
70°	1081
75°	429
80°	495
85°	567

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 51633 cd/sqm

TEST NUMBER: P1505311

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-U-B-04-BLAK-PS (4000K_L24_Medium_120V)

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1344.8	5.9
10°-20°	3836.6	16.8
20°-30°	5677.4	24.9
30°-40°	5867.1	25.7
40°-50°	3991.7	17.5
50°-60°	1810.2	7.9
60°-70°	257.4	1.1
70°-80°	23.1	0.1
80°-90°	7.3	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	10858.8	47.6
0°-40°	16725.9	73.3
0°-60°	22527.8	98.7
0°-90°	22815.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	22815.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	14210	
5°	14162	###
15°	13614	3837
25°	12398	5677
35°	9563	5867
45°	5098	3992
55°	2049	1810
65°	236	257
75°	16	23
85°	7	7
90°	0	

TEST NUMBER: P1505311

CATALOG NUMBER: PRLX-UHBS2-2436-MV-L8C5-U-B-04-BLAK-PS (4000K_L24_Medium_120V)

CANDELA DISTRIBUTION (FULL):

	0°
0°	14210.2
2.5°	14183.5
5°	14162.0
7.5°	14082.9
10°	13940.2
12.5°	13783.7
15°	13613.5
17.5°	13385.6
20°	13103.6
22.5°	12784.6
25°	12397.7
27.5°	11902.4
30°	11275.6
32.5°	10513.0
35°	9562.9
37.5°	8376.3
40°	7184.6
42.5°	6083.2
45°	5097.8
47.5°	4265.5
50°	3553.6
52.5°	2812.5
55°	2048.9
57.5°	1259.6
60°	577.8
62.5°	375.7
65°	236.4
67.5°	123.8
70°	51.6
72.5°	25.8
75°	15.5
77.5°	14.6
80°	12.0
82.5°	9.5
85°	6.9
87.5°	4.3
90°	0.0

(END OF REPORT)